


38MA*R
Outdoor Unit Single Zone Ductless System
Sizes 09 to 36

Product Data

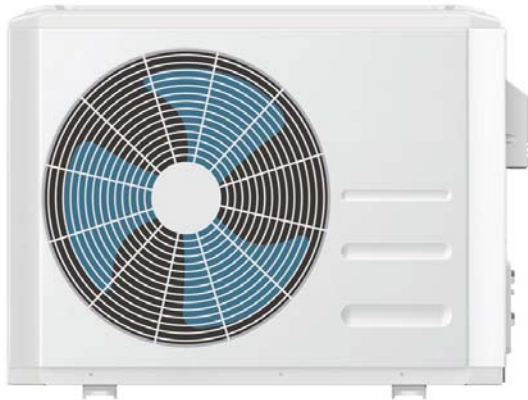

INDUSTRY LEADING FEATURES / BENEFITS

A PERFECT BALANCE BETWEEN BUDGET LIMITS, ENERGY SAVINGS AND COMFORT.

The 38MA*R series ductless split systems are a matched combination of an outdoor condensing unit and an indoor fan coil unit connected only by refrigerant tubing and wires.

The ductless system permits creative solutions to design problems such as:

- Add-ons to current space (an office or family room addition)
- Special space requirements
- When changes in the load cannot be handled by the existing system
- When adding air conditioning to spaces that are heated by hydronic or electric heat and have no ductwork
- Historical renovations or any application where preserving the look of the original structure is essential.

The ideal compliment to your ducted system when it is impractical or prohibitively expensive to use ductwork.

The compact indoor fan coil units take up very little space in the room and do not obstruct windows. The fan coils are attractively styled to blend with most room decors. Advanced system components incorporate innovative technology to provide reliable cooling performance at low sound levels.

LOW SOUND LEVELS

When noise is a concern, the ductless split systems are the answer. The indoor units are whisper quiet. There are no compressors indoors, either in the conditioned space or directly over it, and there is none of the noise usually generated by air being forced through ductwork.

When sound ordinances and proximity to neighbors demand quiet operation, the 38MA*R unit is the right choice. The advanced, horizontal airflow design distributes air more evenly over the coil.

SECURE OPERATION

If security is an issue, outdoor and indoor units are connected only by refrigerant piping and wiring to prevent intruders from crawling through ductwork. In addition, since 38MA*R units can be installed close to an outside wall, coils are protected from vandals and severe weather.

FAST INSTALLATION

This compact ductless split system is simple to install. A mounting bracket is standard with the indoor units and only wire and piping need to be run between the indoor and outdoor units (High Walls). These units are fast and easy to install ensuring minimal disruption to customers in the home or workplace. This makes the 38MA*R ductless split systems the equipment of choice, especially in retrofit situations.

SIMPLE SERVICING AND MAINTENANCE

Removing the top panel on outdoor units provides immediate access to the control compartment, providing a service technician access to check unit operation. In addition, the draw-thru design of the outdoor section means that dirt accumulates on the outside surface of the coil. Coils can be cleaned quickly from the inside using a pressure hose and detergent.

On all indoor units, service and maintenance expense is reduced due to easy-to-use cleanable filters. In addition, these systems have extensive self-diagnostics to assist in troubleshooting.

BUILT-IN RELIABILITY

Ductless split system indoor and outdoor units are designed to provide years of trouble-free operation.

The indoor units include protection against freeze-up and high evaporator temperatures on heat pumps.

The condensing units on heat pumps are protected by a three minute time delay before the compressor starts the over-current protection and the high temperature protection.

INDIVIDUAL ROOM COMFORT

Maximum comfort is provided because each space can be controlled individually based on usage pattern. The air sweep (in some indoor models) feature provided permits optimal room air mixing to eliminate hot and cold spots for occupant comfort. In addition, year-round comfort can be provided with heat pumps.

ECONOMICAL OPERATION

The ductless split system design allows individual room heating or cooling when required. There is no need to run large supply-air fans or chilled water pumps to handle a few spaces with unique load patterns. In addition, because air is moved only in the space required, no energy is wasted while air moves through the ducts.

EASY-TO-USE CONTROLS

The indoor units have microprocessor-based controls to provide the ultimate in comfort and efficiency. The user friendly wireless remote control provides the interface between the user and the unit.

ACCESSORIES

Customizing these ductless split systems to your application is easily accomplished.

Adding a condensate pump accessory to the indoor fan coil provides installation flexibility.


OPTIONAL WIRED CONTROLLER

AGENCY LISTINGS

All systems are listed with AHRI (Air Conditioning, Heating & Refrigeration Institute), and ETL.

MODEL NUMBER NOMENCLATURE

OUTDOOR UNIT

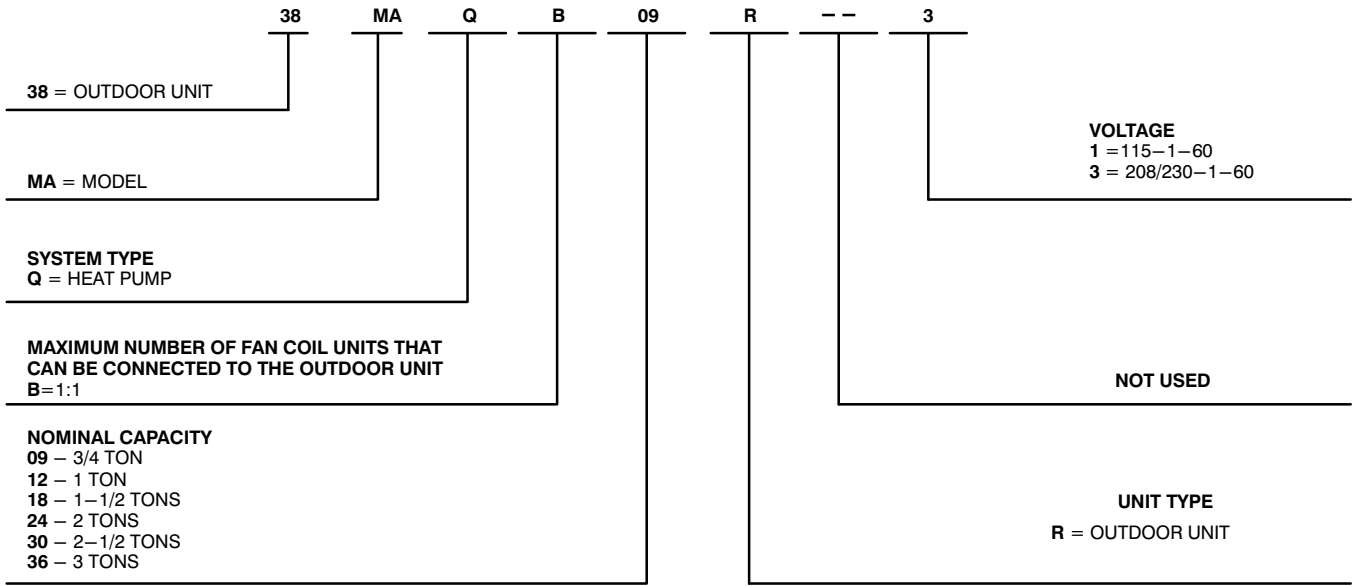

Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.



STANDARD FEATURES AND ACCESSORIES

Ease Of Installation	
Low Voltage Controls	S
Energy Saving Features	
Stop/Start Timer	S
46°F Heating Mode (Heating Setback)	S
Safety And Reliability	
3 Minute Time Delay For Compressor	S
Over Current Protection For Compressor	S
Condenser High Temp Protection in Cooling Mode	S
Ease Of Service And Maintenance	
Diagnostics	S
Liquid Line Pressure Taps	S
Application Flexibility	
Crankcase Heater	S
Base pan Heater	S

Legend

S Standard
A Accessory

ACCESSORIES

ACCESSORY NO.	DESCRIPTION	FOR MODELS
53DS-900---089	INSULATED 25' LINE SET - 1/4" X 3/8"	SIZE 09
53DS-900---008	INSULATED 25' LINE SET - 1/4" X 1/2"	SIZES 12, 18

OUTDOOR UNITS

Crankcase Heater

The crankcase heater is standard on all unit sizes. Heater clamps must be placed around the compressor oil stump.

Base pan Heater

The base pan heater is standard on all unit sizes.

DIMENSIONS – OUTDOOR

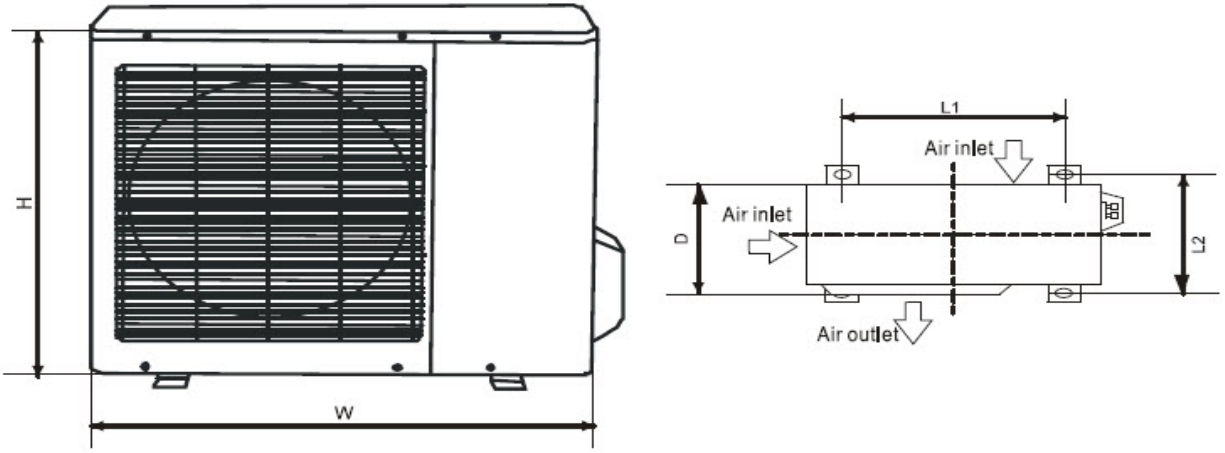


Fig. 1 – Outdoor Unit

38MAR UNIT SIZE		9K	12K	9K	12K	18K	24K	30K	36K
Voltage		115V	115V	208/230V	208/230V	208/230 V	208/230 V	208/230 V	208/230 V
Height (H)	in (mm)	21.81(554)	21.81(554)	21.81(554)	21.81(554)	27.63 (702)	31.89(810)	31.89(810)	31.89(810)
Width (W)	in (mm)	32.09(815)	32.09(815)	32.09(815)	32.09(815)	33.66 (855)	37.24(946)	37.24(946)	37.24(946)
Depth (D)	in (mm)	13.11(333)	13.11(333)	13.11(333)	13.11(333)	14.17 (360)	16.14(410)	16.14(410)	16.14(410)
L1	in (mm)	20.24 (514)	20.24 (514)	20.24 (514)	20.24 (514)	21.26(540)	26.50(673)	26.50(673)	26.50(673)
L2	in (mm)	13.39 (340)	13.39 (340)	13.39 (340)	13.39 (340)	13.78(350)	15.87(403)	15.87(403)	15.87(403)
Operating Weight	Lbs (kg)	82.9(37.6)	82.9(37.6)	91.5(41.5)	91.5(41.5)	118.2(53.6)	145.5(66)	139.8(63.4)	147.3(66.8)

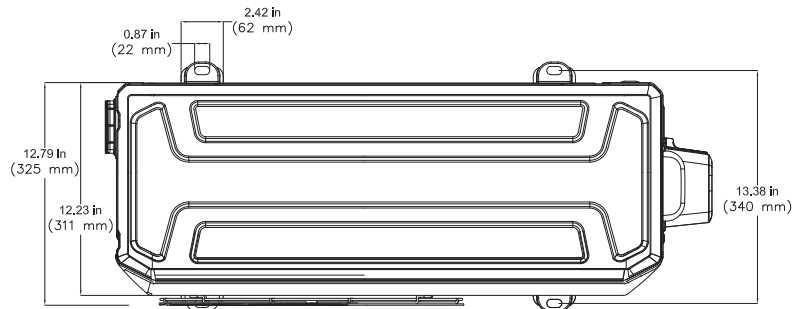
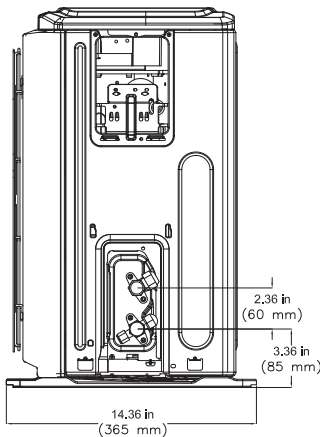
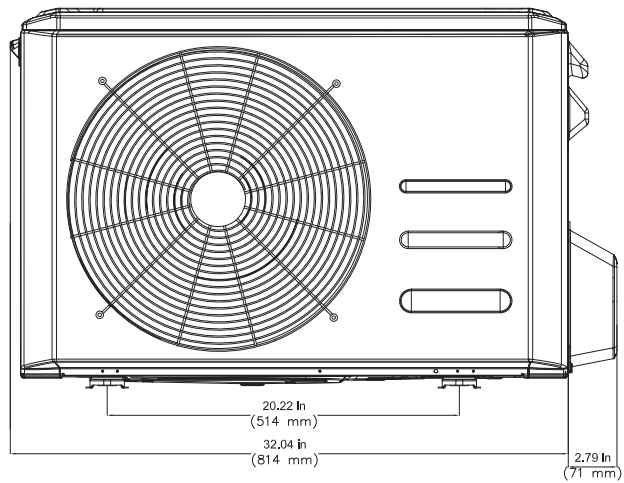
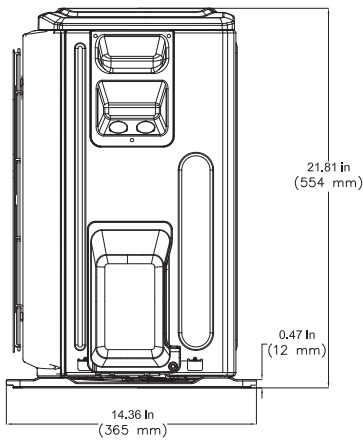


Fig. 2 – Sizes 09K-12K

DIMENSIONS - OUTDOOR (CONT)

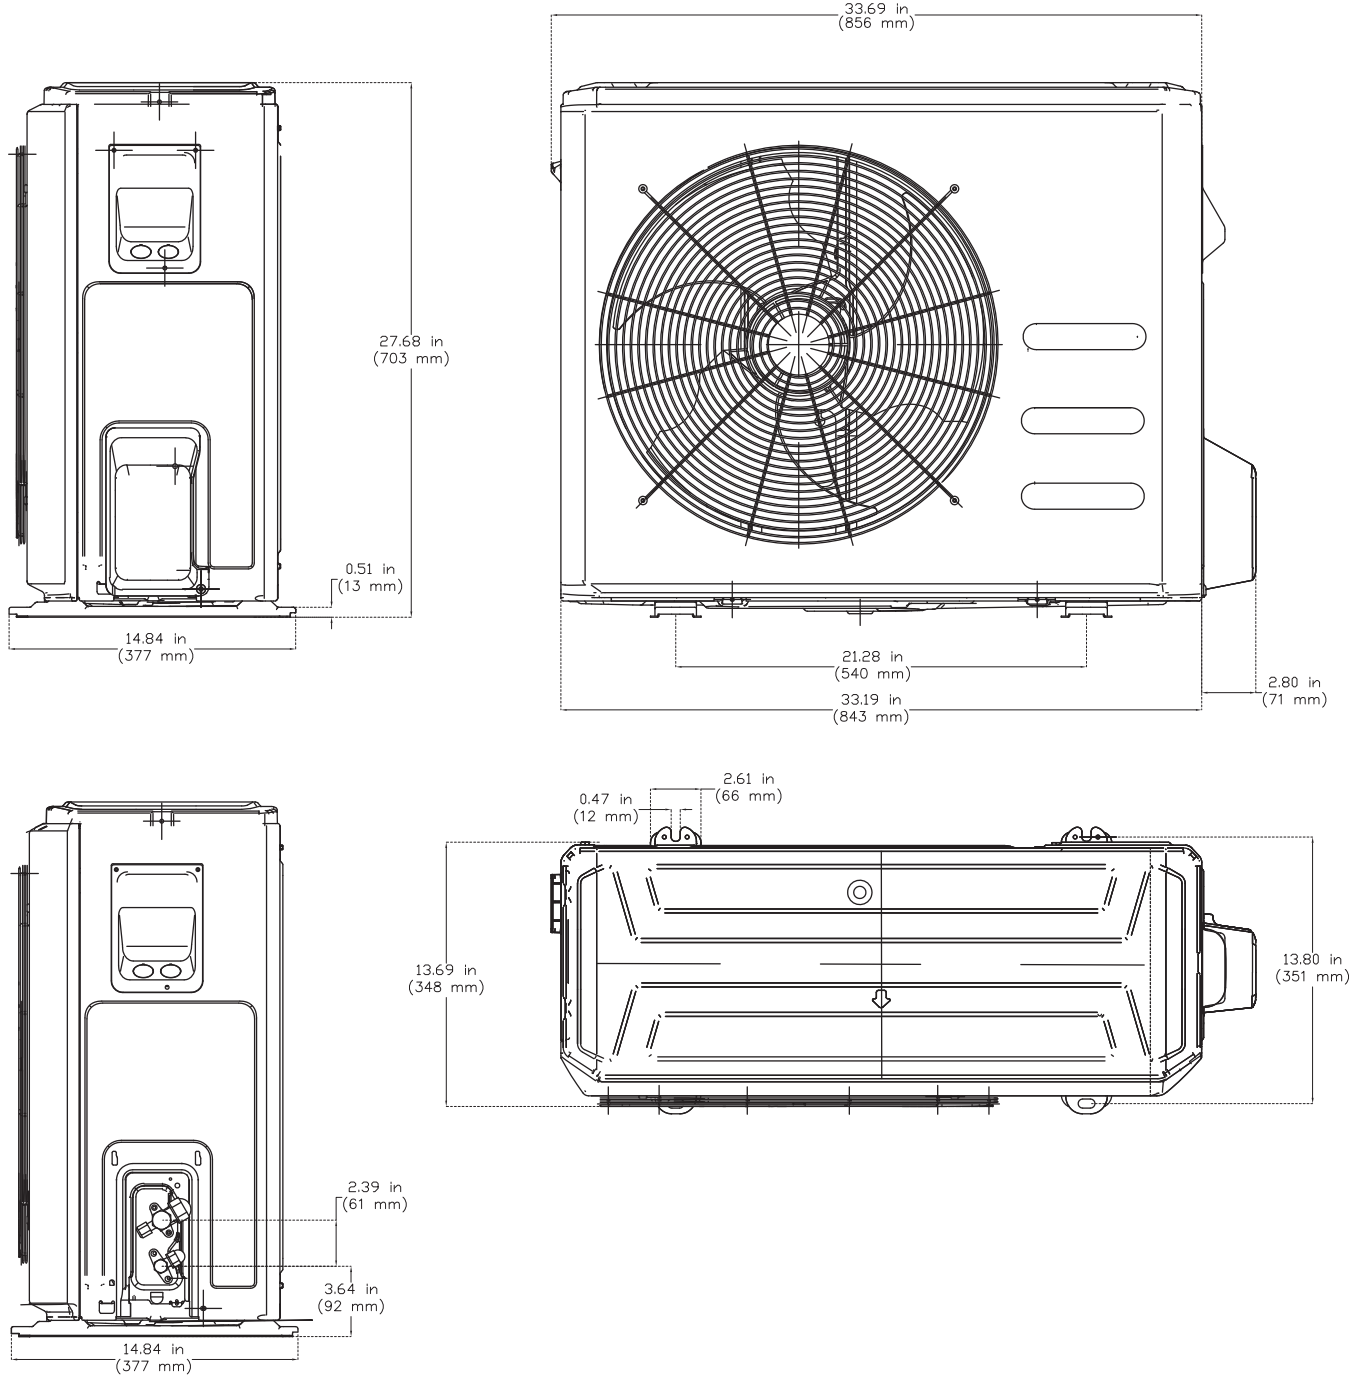


Fig. 3 - Sizes 18K

DIMENSIONS – OUTDOOR (CONT)

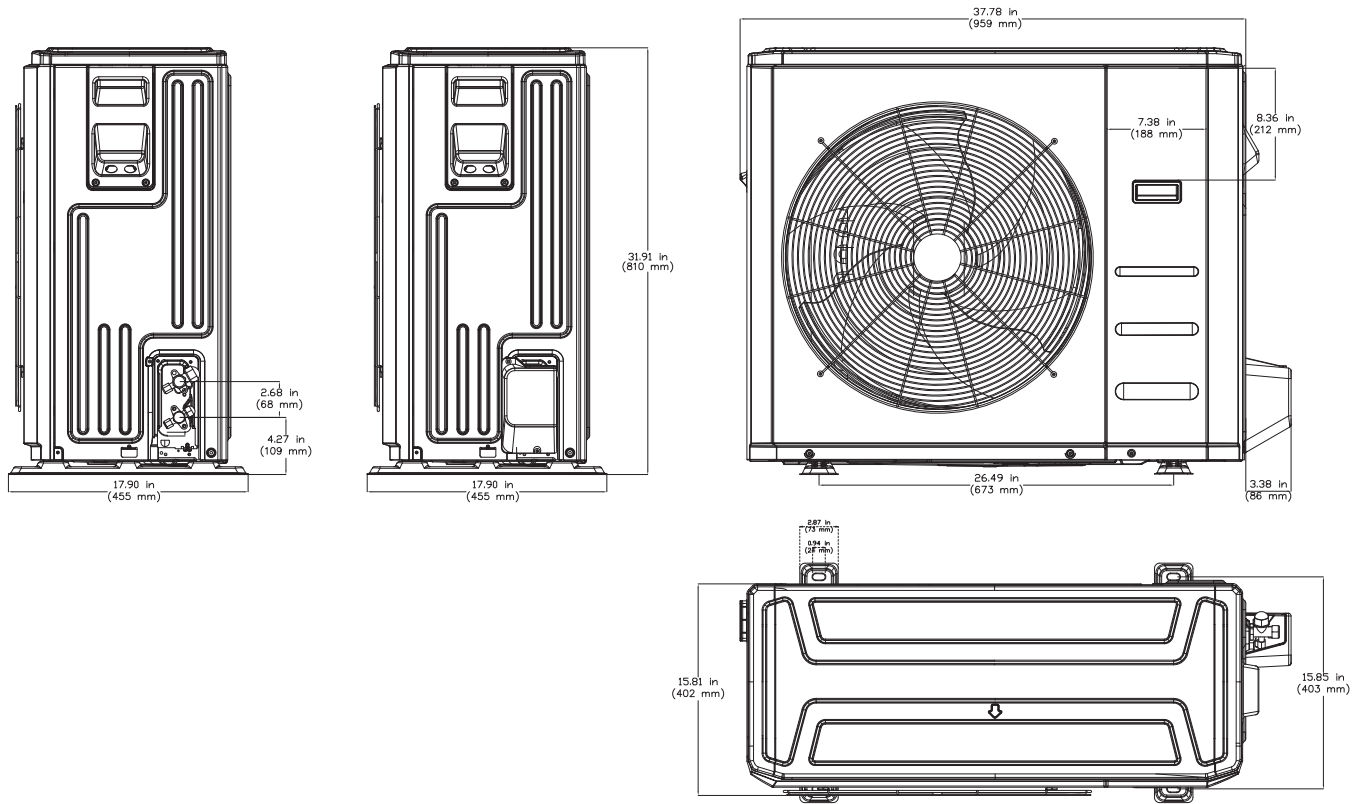


Fig. 4 – Sizes 24K, 30K, and 36K

CLEARANCES – OUTDOOR

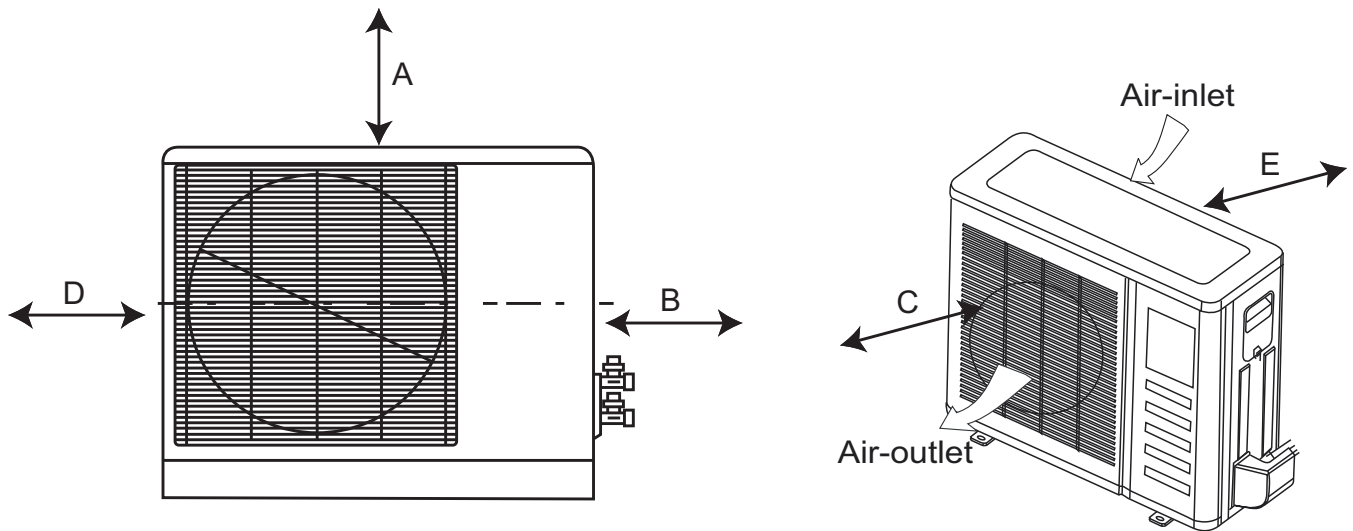


Fig. 5 – Clearances Outdoor

UNIT	MINIMUM VALUE in. (mm)
A	24 (609)
B	24 (609)
C	24 (609)
D	4 (101)
E	4 (101)

SPECIFICATIONS – OUTDOOR HEAT PUMP

System	SIZE		9	12	9	12	18	24	30	36
	Outdoor Model		38MAQB09R--1	38MAQB12R--1	38MAQB09R--3	38MAQB12R--3	38MAQB18R--3	38MAQB24R--3	38MAQB30R--3	38MAQB36R--3
Electrical	Voltage, Phase, Cycle	V/Ph/Hz	115-1-60	115-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60
	MCA	A.	15	15	9	9	18	20	20	25
	MOCOP – Fuse Rating	A.	20	20	15	15	25	30	30	35
Operating Range	Cooling Outdoor DB Min – Max	°F(°C)	-4~122 (-20~50)	-4~122 (-20~50)	-4~122 (-20~50)	-4~122 (-20~50)	-4~122 (-20~50)	-4~122 (-20~50)	-4~122 (-20~50)	-4~122 (-20~50)
	Heating Outdoor DB Min – Max	°F(°C)	-4~86 (-20~30)	-4~86 (-20~30)	-22~86 (-30~30)	-22~86 (-30~30)	-22~86 (-30~30)	-22~86 (-30~30)	-4~86 (-20~30)	-4~86 (-20~30)
Piping	Total Piping Length	ft (m)	82 (25)	82 (25)	82 (25)	82 (25)	98 (30)	98 (30)	164 (50)	164 (50)
	Piping Lift*	ft (m)	32 (10)	32 (10)	32 (10)	32 (10)	65 (20)	65 (20)	82 (25)	82 (25)
	Pipe Connection Size – Liquid	in (mm)	1/4 (6.35)	1/4 (6.35)	1/4 (6.35)	1/4 (6.35)	1/4 (6.35)	3/8 (9.52)	3/8 (9.52)	3/8 (9.52)
	Pipe Connection Size – Suction	in (mm)	3/8 (9.52)	1/2 (12.7)	3/8 (9.52)	1/2 (12.7)	1/2 (12.7)	5/8 (16)	5/8 (16)	5/8 (16)
Refrigerant	Type		R410A	R410A	R410A	R410A	R410A	R410A	R410A	R410A
	Metering Device		EEV	EEV	EEV	EEV	EEV	EEV	EEV	EEV
	Charge	lbs (kg)	2.76 (1.25)	2.76 (1.25)	3.31 (1.5)	3.31 (1.5)	4.30 (1.95)	5.73 (2.60)	6.06 (2.75)	7.50 (3.40)
Outdoor Coil	Face Area	Sq. Ft.	4.5	4.5	4.5	4.5	5.2	8.0	8.0	8.0
	No. Rows		2	2	2	2	2	2	3	3
	Fins per inch		20	20	18	18	18	20	18	18
	Circuits		4	4	4	4	4	4	6	6
Compressor	Type		Hermetic Rotary DC Inverter							
	Model		ASM98D32UFZ	ASM98D32UFZ	ATM115D43UFZ2	ATM115D43UFZ2	ATF235D22UMT	ATF235D22UMT	ATF250D22UMT	ATF250D22UMT
	Oil Type		VG74	VG74	VG74	VG74	VG74	VG74	VG74	VG74
	Oil Charge	Fl. Oz.	13.0	13.0	17.6	17.6	23.6	23.6	23.6	23.6
	Rated Current	RLA	9.0	9.0	5.3	5.7	12.3	14.0	15.0	17.0
Outdoor	Unit Width	in (mm)	32.09 (815)	32.09 (815)	32.09 (815)	32.09 (815)	33.66 (855)	37.24 (946)	37.24 (946)	37.24 (946)
	Unit Height	in (mm)	21.81 (554)	21.81 (554)	21.81 (554)	21.81 (554)	27.63 (702)	31.89 (810)	31.89 (810)	31.89 (810)
	Unit Depth	in (mm)	13.11 (333)	13.11 (333)	13.11 (333)	13.11 (333)	14.17 (360)	16.14 (410)	16.14 (410)	16.14 (410)
	Net Weight	lbs (kg)	82.9 (37.6)	82.9 (37.6)	91.5 (41.5)	91.5 (41.5)	118.2 (53.6)	145.5 (66)	139.8 (63.4)	147.3 (66.8)
	Airflow	CFM	1,200	1,200	1,200	1,200	1,390	2,130	2,130	2,130
	Sound Pressure	dB(A)	52.5	52.5	55.5	56.0	57.5	60.5	60.5	60.5

* Condensing unit above or below indoor unit

PERFORMANCE – HIGH WALL

	Indoor Model	40MAQB09B--1	40MAQB12B--1	40MAQB09B--3	40MAQB12B--3	40MAQB18B--3	40MAQB24B--3	40MAQB30B--3	40MAQB36B--3
		619PAQ009BBMA	619PAQ012BBMA	619PEQ009BBMA	619PEQ012BBMA	619PEQ018BBMA	619PEQ024BBMA	619PEQ030BBMA	619PEQ036BBMA
Energy Star		YES	YES	YES	YES	YES	YES	NO	NO
Cooling Rated Capacity	Btu/h	9,500	12,000	9,000	12,000	17,000	24,000	30,000	36,000
Cooling Cap. Range Min – Max	Btu/h	3500~11000	4000~13000	3500~13000	4000~13800	4500~18800	5500~24500	8000~30500	8000~36200
SEER		24.5	22.0	25.0	22.5	20.0	20.5	19.8	16.0
EER		15	13	14.5	12.5	12.5	12.5	11.5	8.6
Heating Rated Capacity (47°F)	Btu/h	11,000	12,000	10,900	11,800	18,000	24,000	30,000	36,000
Heating Rated Capacity (17°F)	Btu/h	6,500	7,600	6,900	7,800	10,800	17,600	18,500	21,000
Heating Maximum Capacity (17°F)	Btu/h	6,500	7,600	10,900	11,800	18,000	24,000	18,500	21,000
Heating Maximum Capacity (5°F)	Btu/h	4,290	6,490	10,900	11,800	18,000	24,000	16,380	16,380
Heating Cap. Range Min – Max	Btu/h	4500~12500	5000~13500	4500~14500	5000~15500	5500~24000	6000~32000	9000~34000	9000~37000
HSPF		11.2	10.2	11.2	12.0	10.3	10.3	9.4	8.5
COP (47°F)	W/W	3.66	3.40	3.80	3.56	3.14	3.10	2.60	2.56
COP (17°F)	W/W	2.82	2.60	2.74	2.64	2.64	2.64	2.16	2.12
COP (5°F)	W/W	1.50	1.94	1.98	1.98	1.63	1.77	2.20	1.50

PERFORMANCE – CASSETTE

	Indoor Model		40MBQB09C---3	40MBQB12C---3	40MBQB18C---3
			619REQ009CBMA	619REQ012CBMA	619REQ018CBMA
Cassette	Energy Star		YES	YES	YES
	Cooling Rated Capacity	Btu/h	9,000	12,000	16,000
	Cooling Cap. Range Min – Max	Btu/h	3,500~11,000	4,000~13000	4,500~18,000
	SEER		20.0	19.5	20.0
	EER		13.0	12.5	12.5
	Heating Rated Capacity (47°F)	Btu/h	9,000	12,000	18,000
	Heating Rated Capacity (17°F)	Btu/h	6,901	8,257	11,942
	Heating Maximum Capacity (17°F)	Btu/h	9,000	12,000	18,000
	Heating Maximum Capacity (5°F)	Btu/h	9,000	12,000	18,000
	Heating Cap. Range Min – Max	Btu/h	4,500~11,500	5,000~13500	5,500~19,000
	HSPF		10.2	10.2	10.5
	COP (47°F)	W/W	3.30	3.67	3.43
	COP (17°F)	W/W	2.37	2.40	2.55
	COP (5°F)	W/W	1.62	1.62	1.75

PERFORMANCE – DUCTED STYLE

	Indoor Model		40MBQB09D---3	40MBQB12D---3	40MBQB18D---3	40MBQB24D---3
			619REQ009DBMA	619REQ012DBMA	619REQ018DBMA	619REQ024DBMA
Ducted	Energy Star		YES	YES	YES	YES
	Cooling Rated Capacity	Btu/h	9,000	11,500	16,500	24,000
	Cooling Cap. Range Min – Max	Btu/h	3,500~11,000	4,000~13,000	4,500~18,000	5,500~24,500
	SEER		19.0	19.0	19.6	20.5
	EER		13.0	12.5	12.5	12.5
	Heating Rated Capacity (47°F)	Btu/h	10,000	12,000	18,000	24,000
	Heating Rated Capacity (17°F)	Btu/h	6,982	8,492	12,242	17,278
	Heating Maximum Capacity (17°F)	Btu/h	10,000	12,000	18,000	24,000
	Heating Maximum Capacity (5°F)	Btu/h	10,000	12,000	18,000	24,000
	Heating Cap. Range Min – Max	Btu/h	4,500~11,500	5,000~13,500	5,500~19,000	6,000~26,000
	HSPF		10.5	10.2	10.5	11.5
	COP (47°F)	W/W	3.37	3.66	3.57	3.42
	COP (17°F)	W/W	2.55	2.58	2.54	2.71
	COP (5°F)	W/W	1.72	1.72	1.75	1.65

NOTE: For information on sizes 36 and 48, refer to the 38MBQ/538RR product data document.

PERFORMANCE – FLOOR CONSOLE

	INDOOR MODEL		40MBQB09F---3	40MBQB12F---3
			619REQ009FBMA	619REQ012FBMA
Floor Console	Energy Star		YES	YES
	Cooling Rated Capacity	Btu/h	8,500	12,000
	Cooling Cap. Range Min – Max	Btu/h	3,500~11,000	4,000~13,000
	SEER		20.0	19.4
	EER		12.5	12.5
	Heating Rated Capacity (47°F)	Btu/h	9,000	12,000
	Heating Rated Capacity (17°F)	Btu/h	6,831	8,448
	Heating Maximum Capacity (17°F)	Btu/h	9,000	12,000
	Heating Maximum Capacity (5°F)	Btu/h	9,000	12,000
	Heating Cap. Range Min – Max	Btu/h	4,500~11,500	5,000~13,500
	HSPF		10	10.5
	COP (47°F)	W/W	3.34	3.17
	COP (17°F)	W/W	2.5	2.49
	COP (5°F)	W/W	1.49	1.49

COMPATIBILITY TABLE

INDOOR UNIT			OUTDOOR UNIT							
			38MAQB09R-1	38MAQB12R-1	38MAQB09R-3	38MAQB12R-3	38MAQB18R-3	38MAQB24R-3	38MAQB30R-3	38MAQB36R-3
HIGH WALL	40MAQB09B-1	619PAQ009BBMA	•							
	40MAQB12B-1	619PAQ012BBMA		•						
	40MAQB09B-3	619PEQ009BBMA			•					
	40MAQB12B-3	619PEQ012BBMA				•				
	40MAQB18B-3	619PEQ018BBMA					•			
	40MAQB24B-3	619PEQ024BBMA						•		
	40MAQB30B-3	619PEQ030BBMA							•	
CASSETTE	40MAQB36B-3	619PEQ036BBMA								•
	40MBQB09C-3	619REQ009CBMA			•					
	40MBQB12C-3	619REQ012CBMA				•				
DUCTED	40MBQB18C-3	619REQ018CBMA					•			
	40MBQB09D-3	619REQ009DBMA			•					
	40MBQB12D-3	619REQ012DBMA				•				
	40MBQB18D-3	619REQ018DBMA					•			
	40MBQB24D-3	619REQ024DBMA						•		
	40MBQB36D-3	619REQ036DBMA							•	
FLOOR CONSOLE	40MBQB48D-3	619REQ048DBMA								
	40MBQB09F-3	619REQ009FBMA			•					
	40MBQB12F-3	619REQ012FBMA				•				

NOTE: Ducted style units sizes 36 and 48, compatible only with the 38MBQ/538RR outdoor units.

COOLING PERFORMANCE DATA – HIGH WALL

MODEL	COOLING			OUTDOOR CONDITIONS (DB)					
	Indoor Conditions DB			77F (25C)	86F (30C)	95F (35C)	104F (40C)	113F (45C)	122F (50C)
	DB	WB							
09 (115V)	69.8F (21C)	59F (15C)	TC	7.43	7.83	9.74	8.38	6.11	5.11
			SC	6.68	6.69	8.18	7.37	4.36	3.74
			Input	0.35	0.54	0.81	0.80	0.75	0.75
	75.2F (24C)	62.6F (17C)	TC	7.78	9.14	9.89	8.65	6.92	5.83
			SC	3.58	8.11	6.27	5.52	4.85	4.29
			Input	0.35	0.54	0.81	0.80	0.75	0.75
	80.6F (27C)	66.2F (19C)	TC	8.21	9.22	10.41	9.27	7.32	6.00
			SC	7.39	5.88	8.22	7.79	5.11	4.37
			Input	0.35	0.75	0.82	0.81	0.75	0.75
	89.6F (32C)	73.4F (23C)	TC	8.41	9.72	11.59	10.22	8.82	7.51
			SC	3.68	5.76	6.90	6.20	5.55	5.00
			Input	0.36	0.56	0.83	0.82	0.76	0.77
12 (115V)	69.8F (21C)	59F (15C)	TC	8.21	11.75	11.42	9.00	7.85	6.68
			SC	7.06	9.05	8.68	7.38	6.42	5.58
			Input	0.38	0.80	1.04	0.87	0.82	0.81
	75.2F (24C)	62.6F (17C)	TC	8.42	11.84	12.01	9.35	8.32	7.34
			SC	7.28	8.69	8.66	7.62	6.53	5.81
			Input	0.57	0.94	1.25	1.27	0.98	0.94
	80.6F (27C)	66.2F (19C)	TC	8.81	11.95	12.23	9.69	8.87	7.95
			SC	7.49	8.32	8.63	7.85	6.64	6.04
			Input	0.39	0.75	1.06	0.89	0.85	0.82
	89.6F (32C)	73.4F (23C)	TC	9.01	12.15	12.43	9.89	9.07	8.15
			SC	7.70	8.53	8.84	8.06	6.85	6.25
			Input	0.40	0.97	1.30	1.34	0.92	0.85
09 (208-230V)	69.8F (21C)	59F (15C)	TC	12.36	12.58	11.57	9.37	8.95	7.76
			SC	10.51	10.69	9.83	7.96	7.61	6.60
			Input	0.72	0.93	1.21	1.04	0.95	0.90
	75.2F (24C)	62.6F (17C)	TC	12.82	13.04	12.03	9.83	9.41	8.22
			SC	10.90	11.08	10.23	8.36	8.00	6.99
			Input	0.93	1.14	1.42	1.25	1.16	1.11
	80.6F (27C)	66.2F (19C)	TC	13.34	13.45	14.41	11.70	10.32	9.02
			SC	11.34	11.43	12.25	9.95	8.77	7.67
			Input	1.14	1.35	1.63	1.46	1.37	1.32
	89.6F (32C)	73.4F (23C)	TC	13.84	13.95	14.91	12.20	10.82	9.52
			SC	11.76	11.86	12.67	10.37	9.20	8.09
			Input	1.35	1.56	1.84	1.67	1.58	1.53
12 (208-230V)	69.8F (21C)	59F (15C)	TC	12.36	12.58	11.57	9.37	8.95	7.76
			SC	10.51	10.69	9.83	7.96	7.61	6.60
			Input	0.72	0.93	1.21	1.04	0.95	0.90
	75.2F (24C)	62.6F (17C)	TC	12.82	13.04	12.03	9.83	9.41	8.22
			SC	10.90	11.08	10.23	8.36	8.00	6.99
			Input	0.93	1.14	1.42	1.25	1.16	1.11
	80.6F (27C)	66.2F (19C)	TC	13.34	13.45	14.41	11.70	10.32	9.02
			SC	11.34	11.43	12.25	9.95	8.77	7.67
			Input	1.14	1.35	1.63	1.46	1.37	1.32
	89.6F (32C)	73.4F (23C)	TC	13.84	13.95	14.91	12.20	10.82	9.52
			SC	11.76	11.86	12.67	10.37	9.20	8.09
			Input	1.35	1.56	1.84	1.67	1.58	1.53
18 (208-230V)	69.8F (21C)	59F (15C)	TC	16.08	17.64	17.46	15.75	13.02	9.65
			SC	14.15	15.52	15.36	13.86	11.46	8.49
			Input	1.49	1.79	1.90	1.86	1.60	1.30
	75.2F (24C)	62.6F (17C)	TC	17.33	18.89	18.71	17.00	14.27	10.90
			SC	15.25	16.62	16.46	14.96	12.56	9.59
			Input	1.48	1.78	1.89	1.85	1.59	1.29
	80.6F (27C)	66.2F (19C)	TC	18.58	20.14	19.96	18.25	15.52	12.15
			SC	16.54	17.92	17.76	16.24	13.81	10.81
			Input	1.51	1.81	1.92	1.88	1.62	1.32
	89.6F (32C)	73.4F (23C)	TC	18.79	20.35	20.17	18.46	15.73	12.36
			SC	16.72	18.11	17.95	16.43	14.00	11.00
			Input	1.55	1.85	1.96	1.92	1.66	1.36
24 (208-230V)	69.8F (21C)	59F (15C)	TC	23.58	23.21	25.86	18.72	16.25	15.32
			SC	17.69	17.41	19.40	14.04	12.19	11.49
			Input	1.95	2.38	2.56	2.20	2.10	1.87
	75.2F (24C)	62.6F (17C)	TC	25.79	25.42	28.07	20.93	18.46	17.53
			SC	15.25	15.71	15.59	14.33	10.13	8.88
			Input	1.98	2.41	2.59	2.23	2.13	1.90
	80.6F (27C)	66.2F (19C)	TC	29.10	28.40	24.00	22.40	16.98	16.02
			SC	21.83	21.30	18.00	16.80	12.74	12.02
			Input	2.01	2.44	2.62	2.26	2.16	1.93
	89.6F (32C)	73.4F (23C)	TC	31.50	30.80	26.40	24.80	17.22	16.26
			SC	23.63	23.10	19.80	18.60	12.92	12.20
			Input	2.05	2.48	2.66	2.30	2.20	1.97
30 (208-230V)	69.8F (21C)	59F (15C)	TC	26.54	31.04	30.03	23.54	18.22	15.04
			SC	18.84	22.04	21.32	16.71	12.94	10.68
			Input	1.39	1.90	2.25	2.20	2.10	1.87
	75.2F (24C)	62.6F (17C)	TC	26.50	31.00	29.99	23.50	18.18	15.00
			SC	18.82	22.01	21.29	16.69	12.91	10.65
			Input	1.42	1.93	2.28	2.23	2.13	1.90
	80.6F (27C)	66.2F (19C)	TC	26.52	31.02	30.01	23.52	18.20	15.02
			SC	18.30	21.40	20.71	16.23	12.56	10.36
			Input	1.45	1.96	2.31	2.26	2.16	1.93
	89.6F (32C)	73.4F (23C)	TC	26.45	30.95	29.94	23.45	18.13	14.95
			SC	18.78	21.97	21.26	16.65	12.87	10.61
			Input	1.52	2.03	2.38	2.33	2.23	2.00
36 (208-230V)	69.8F (21C)	59F (15C)	TC	26.51	37.29	36.06	28.30	20.56	15.57
			SC	18.82	26.48	25.60	20.09	14.60	11.05
			Input	2.88	3.12	3.99	2.30	2.19	2.09
	75.2F (24C)	62.6F (17C)	TC	26.47	37.25	36.02	28.26	20.52	15.53
			SC	18.79	26.45	25.57	20.06	14.57	11.03
			Input	2.91	3.15	4.02	2.33	2.22	2.12
	80.6F (27C)	66.2F (19C)	TC	26.49	37.27	36.04	28.28	20.54	15.55
			SC	18.28	25.72	24.87	19.51	14.17	10.73
			Input	2.94	3.18	4.05	2.36	2.25	2.15
	89.6F (32C)	73.4F (23C)	TC	26.46	37.24	36.01	28.25	20.51	15.52
			SC	18.79	26.44	25.57	20.06	14.56	11.02
			Input	3.01	3.25	4.12	2.43	2.32	2.22

LEGEND

DB – Dry Bulb
 WB – Wet Bulb
 TC – Total Net Capacity (1000 Btu/hour)
 SC – Sensible Capacity (1000 Btu/hour)
 Input – Total Power (kW)

HEATING PERFORMANCE DATA – HIGH WALL

MODEL	HEATING			OUTDOOR CONDITIONS (DB)										
	Indoor Conditions DB			-13F (-25C)	-4F (-20C)	0F (-17C)	5F (-15C)	17F (-8C)	19.4F (-7C)	24.8F (-4C)	32F (0C)	39.2F (4C)	44.6F (7C)	53.6F (12C)
09 (115V)	59F (15C)	TC	5.02	5.20	6.01	6.71	8.27	9.11	9.87	10.65	10.89	11.08	11.08	11.18
		Input	0.75	0.77	0.79	0.80	0.84	0.90	0.96	1.01	1.04	1.04	1.04	1.04
		COP	1.96	1.98	2.23	2.46	2.89	2.97	3.01	3.09	3.07	3.07	3.07	3.07
	64.4F (18C)	TC	5.02	5.18	5.32	5.46	8.01	8.84	9.63	10.54	10.65	10.82	10.82	11.06
		Input	0.78	0.79	0.80	0.82	0.90	0.94	0.98	1.03	1.08	1.08	1.08	1.08
		COP	1.89	1.92	1.95	1.95	2.61	2.76	2.88	3.00	2.89	3.00	3.00	3.00
	69F (20.5C)	TC	3.80	3.98	4.05	4.29	7.95	8.55	9.43	10.32	10.48	10.55	10.55	10.84
		Input	0.81	0.83	0.83	0.84	0.96	0.98	1.00	1.05	1.11	1.11	1.11	1.11
		COP	1.37	1.41	1.43	1.50	2.43	2.56	2.76	2.88	2.77	2.77	2.77	2.77
	71.6F (22C)	TC	3.70	3.79	3.99	4.11	7.89	8.41	9.23	10.11	10.27	10.32	10.32	10.62
		Input	0.84	0.84	0.85	0.86	0.92	1.02	1.02	1.07	1.15	1.15	1.15	1.15
		COP	1.29	1.32	1.38	1.40	2.51	2.42	2.65	2.77	2.60	2.60	2.60	2.60
12 (115V)	59F (15C)	TC	5.02	5.32	5.62	5.75	8.90	9.54	10.40	11.32	12.42	12.72	12.72	11.78
		Input	0.75	0.78	0.81	0.83	0.98	1.00	1.02	1.10	1.05	1.01	1.01	0.79
		COP	1.96	2.00	2.03	2.03	2.66	2.80	2.99	3.02	3.47	3.47	3.47	4.37
	64.4F (18C)	TC	5.02	5.28	5.72	6.14	8.81	9.32	10.32	11.34	12.32	12.65	12.65	12.05
		Input	0.78	0.82	0.85	0.91	1.01	1.27	1.22	1.26	1.40	1.37	1.37	0.83
		COP	1.89	1.89	1.97	1.98	2.56	2.15	2.48	2.64	2.58	2.71	2.71	4.26
	69F (20.5C)	TC	3.80	4.20	5.32	6.49	8.43	9.12	10.21	11.32	12.12	12.60	12.27	12.27
		Input	0.81	0.82	0.91	0.98	1.03	1.25	1.19	1.19	1.12	1.10	1.10	0.83
		COP	1.37	1.50	1.71	1.94	2.40	2.14	2.51	2.79	3.17	3.36	3.36	4.33
	71.6F (22C)	TC	3.70	4.12	5.21	6.01	8.21	9.02	10.01	11.21	12.01	12.41	12.41	11.14
		Input	0.84	0.88	0.91	1.00	1.05	1.31	1.23	1.21	1.16	1.15	1.15	0.85
		COP	1.29	1.37	1.68	1.76	2.29	2.02	2.39	2.72	3.03	3.16	3.16	3.84
09 (208-230V)	59F (15C)	TC	9.22	10.02	11.20	12.37	15.03	15.26	15.52	14.21	15.29	15.82	17.32	17.32
		Input	1.75	1.73	1.72	1.71	1.69	1.65	1.58	1.52	1.43	1.32	1.32	1.18
		COP	1.54	1.70	1.91	2.12	2.61	2.71	2.88	2.74	3.13	3.51	4.30	4.30
	64.4F (18C)	TC	9.12	9.82	11.02	12.19	14.31	14.76	14.89	14.11	14.93	15.40	16.45	16.45
		Input	1.78	1.74	1.75	1.74	1.72	1.68	1.61	1.55	1.46	1.35	1.21	1.21
		COP	1.50	1.65	1.85	2.05	2.44	2.57	2.71	2.67	3.00	3.34	3.98	3.98
	69F (20.5C)	TC	9.02	9.65	10.85	12.01	13.58	14.25	14.26	14.01	14.56	14.98	15.57	15.57
		Input	1.82	1.79	1.78	1.78	1.76	1.72	1.65	1.59	1.50	1.39	1.25	1.25
		COP	1.45	1.58	1.79	1.98	2.26	2.43	2.53	2.58	2.84	3.16	3.65	3.65
	71.6F (22C)	TC	8.88	9.42	10.65	11.51	13.08	13.75	13.76	13.51	14.06	14.48	15.07	15.07
		Input	1.91	1.91	1.88	1.87	1.85	1.81	1.74	1.68	1.59	1.48	1.34	1.34
		COP	1.36	1.45	1.66	1.80	2.07	2.23	2.32	2.36	2.59	2.87	3.30	3.30
12 (208-230V)	59F (15C)	TC	9.22	10.20	11.02	12.37	15.03	15.26	15.52	14.21	15.29	15.82	17.32	17.32
		Input	1.75	1.70	1.73	1.71	1.69	1.65	1.58	1.52	1.43	1.32	1.18	1.18
		COP	1.54	1.70	1.87	2.12	2.61	2.71	2.88	2.74	3.13	3.51	4.30	4.30
	64.4F (18C)	TC	9.12	10.02	10.98	12.19	14.31	14.76	14.89	14.11	14.93	15.40	16.45	16.45
		Input	1.78	1.75	1.76	1.74	1.72	1.68	1.61	1.55	1.46	1.35	1.21	1.21
		COP	1.50	1.68	1.83	2.05	2.44	2.57	2.71	2.67	3.00	3.34	3.98	3.98
	69F (20.5C)	TC	9.02	9.82	11.81	12.01	13.58	14.25	14.26	14.01	14.56	14.98	15.57	15.57
		Input	1.82	1.81	1.77	1.78	1.76	1.72	1.65	1.59	1.50	1.39	1.25	1.25
		COP	1.45	1.59	1.96	1.98	2.26	2.43	2.53	2.58	2.84	3.16	3.65	3.65
	71.6F (22C)	TC	8.88	9.62	11.74	12.00	13.08	13.75	13.76	13.51	14.06	14.48	15.07	15.07
		Input	1.91	1.90	1.88	1.87	1.85	1.81	1.74	1.68	1.59	1.48	1.34	1.34
		COP	1.36	1.48	1.83	1.88	2.07	2.23	2.32	2.36	2.59	2.87	3.30	3.30
18 (208-230V)	59F (15C)	TC	16.82	17.26	18.02	18.82	23.32	23.55	23.71	23.91	24.14	24.32	26.88	26.88
		Input	3.11	3.12	3.16	3.18	2.87	2.50	2.44	2.37	2.31	2.21	2.27	2.27
		COP	1.59	1.62	1.67	1.73	2.38	2.76	2.85	2.96	3.06	3.23	3.47	3.47
	64.4F (18C)	TC	16.67	17.11	17.98	18.67	23.17	23.40	23.56	23.76	23.99	24.17	26.73	26.73
		Input	3.18	3.22	3.22	3.25	2.94	2.57	2.51	2.44	2.38	2.28	2.34	2.34
		COP	1.54	1.56	1.64	1.68	2.31	2.67	2.75	2.85	2.95	3.11	3.35	3.35
	69F (20.5C)	TC	16.52	17.01	18.01	18.52	23.02	23.25	23.41	23.61	23.84	24.02	26.58	26.58
		Input	3.25	3.26	3.28	3.32	3.01	2.64	2.58	2.51	2.45	2.35	2.41	2.41
		COP	1.49	1.53	1.61	1.63	2.24	2.58	2.66	2.76	2.85	3.00	3.23	3.23
	71.6F (22C)	TC	16.25	16.87	17.98	18.25	22.75	22.98	23.14	23.34	23.57	23.75	26.31	26.31
		Input	3.28	3.28	3.27	3.35	3.04	2.67	2.61	2.54	2.48	2.38	2.44	2.44
		COP	1.45	1.51	1.61	1.60	2.19	2.52	2.60	2.69	2.79	2.92	3.16	3.16
24 (208-230V)	59F (15C)	TC	16.66	22.54	24.56	25.24	26.02	26.85	27.56	27.87	28.89	29.79	31.92	31.92
		Input	3.95	9.94	3.94	4.02	3.89	3.82	3.72	3.72	3.71	3.28	3.22	3.22
		COP	1.24	0.66	1.83	1.84	1.96	2.06	2.17	2.20	2.28	2.66	2.91	2.91
	64.4F (18C)	TC	16.59	22.32	24.32	24.10	25.78	26.05	26.59	27.58	28.51	29.75	31.85	31.85
		Input	3.90	3.91	3.93	4.03	3.92	3.76	3.68	3.66	3.60	3.24	3.17	3.17
		COP	1.25	1.67	1.81	1.75	1.93	2.03	2.12	2.21	2.32	2.69	2.94	2.94
	69F (20.5C)	TC	16.52	21.02	24.00	24.03	25.71	25.98	26.52	27.51	28.44	29.68	31.78	31.78
		Input	3.85	3.91	3.96	3.98	3.87	3.71	3.63	3.61	3.55	3.19	3.12	3.12
		COP	1.26	1.58	1.78	1.77	1.95	2.05	2.14	2.23	2.35	2.73	2.99	2.99
	71.6F (22C)	TC	16.65	20.05	24.02	24.16	25.84	26.11	26.65	27.64	28.57	29.81	31.91	31.91
		Input	3.64	3.68	3.72	3.77	3.66	3.50	3.42	3.40	3.34	2.98	2.91	2.91
		COP	1.34	1.60	1.89	1.88	2.07	2.19	2.28	2.38	2.51	2.93	3.21	3.21
30 (208-230V)	59F (15C)	TC	16.42	17.02	17.56	18.93	23.16	23.22	23.42	23.56	25.85	27.79	28.60	28.60
		Input	2.17	2.19	2.18	2.17	2.24	2.23	2.20	2.21	2.24	2.25	2.00	2.00
		COP	2.22	2.28	2.36	2.56	3.03	3.05	3.12	3.12	3.38	3.62	4.19	4.19
	64.4F (18C)	TC	15.58	16.45	17.02	17.45	20.45	22.52	23.40	23.54	24.52	27.61	27.62	27.62
		Input	2.16	2.19	2.14	2.16	2.21	2.23	2.32	2.35	2.35	2.45	2.24	2.24
		COP	2.11	2.20	2.33	2.37	2.71	2.96	2.96	2.94	3.06	3.30	3.61	3.61
	69F (20.5C)	TC	14.32	15.02	15.88	16.38	19.61	21.85	22.98	24.63	26.75	30.08	31.02	31.02
		Input	2.18	2.13	2.16	2.18	2.20	2.25	2.42	2.58	2.64	2.74	2.39	2.39
		COP	1.93	2.07	2.15	2.20	2.61	2.85	2.78	2.80	2.97	3.22	3.80	3.80
	71.6F (22C)	TC	14.20	14.85	15.78	16.24	19.54	21.67	22.54	23.41	24.21	30.06	31.05	31.05
		Input	2.15	2.16	2.20	2.17	2.24	2.23	2.20	2.21	2.24	2.25	2.00	2.00
		COP	1.94	2.01	2.10	2.19	2.56							

COOLING PERFORMANCE DATA – CASSETTE

MODEL	COOLING			OUTDOOR CONDITIONS					
	Indoor Conditions			77F (25C)	86F (30C)	95F (35C)	104F (40C)	113F (45C)	122F (50C)
	DB	WB							
09 (208-230V)	69.8F (21C)	59F (15C)	TC	10.19	10.27	10.06	8.16	7.98	7.16
			SC	7.75	7.70	7.64	6.77	6.47	6.09
			Input	0.72	0.93	1.23	1.06	0.95	0.90
	75.2F (24C)	62.6F (17C)	TC	11.32	11.52	11.01	8.99	8.78	7.85
			SC	8.49	8.76	8.37	7.19	7.11	6.52
			Input	0.72	0.95	1.24	1.07	0.98	0.95
	80.6F (27C)	66.2F (19C)	TC	12.03	12.59	11.85	9.66	9.43	8.52
			SC	8.30	8.56	8.29	7.44	7.64	6.99
			Input	0.73	0.96	1.25	1.08	1.03	0.98
	89.6F (32C)	73.4F (23C)	TC	12.86	13.45	12.35	10.32	10.12	9.25
			SC	9.64	10.09	9.39	8.26	8.20	7.49
			Input	0.74	1.01	1.28	1.16	1.09	1.01
12 (208-230V)	69.8F (21C)	59F (15C)	TC	10.19	10.27	10.06	8.16	7.98	7.16
			SC	7.75	7.70	7.64	6.77	6.47	6.09
			Input	0.72	0.93	1.23	1.06	0.95	0.90
	75.2F (24C)	62.6F (17C)	TC	11.32	11.52	11.01	8.99	8.78	7.85
			SC	8.49	8.76	8.37	7.19	7.11	6.52
			Input	0.72	0.95	1.24	1.07	0.98	0.95
	80.6F (27C)	66.2F (19C)	TC	12.03	12.59	11.85	9.66	9.43	8.52
			SC	8.30	8.56	8.29	7.44	7.64	6.99
			Input	0.73	0.96	1.25	1.08	1.03	0.98
	89.6F (32C)	73.4F (23C)	TC	12.86	13.45	12.35	10.32	10.12	9.25
			SC	9.64	10.09	9.39	8.26	8.20	7.49
			Input	0.74	1.01	1.28	1.16	1.09	1.01
18 (208-230V)	69.8F (21C)	59F (15C)	TC	11.21	12.77	17.16	12.51	11.87	10.88
			SC	9.48	10.04	12.22	10.02	9.49	8.81
			Input	0.66	1.07	1.90	1.50	1.39	1.26
	75.2F (24C)	62.6F (17C)	TC	12.46	14.33	18.30	13.60	12.91	12.13
			SC	9.72	10.45	12.62	10.22	9.68	9.10
			Input	0.69	1.26	1.92	1.35	1.32	1.23
	80.6F (27C)	66.2F (19C)	TC	13.67	16.73	19.15	15.51	14.46	13.67
			SC	9.88	11.34	12.64	11.17	10.85	9.84
			Input	1.00	1.51	1.94	1.56	1.44	1.31
	89.6F (32C)	73.4F (23C)	TC	14.25	17.41	19.74	16.98	15.57	14.47
			SC	10.27	11.74	13.27	11.61	11.28	10.74
			Input	1.02	1.59	1.96	1.61	1.50	1.38

LEGEND

DB – Dry Bulb
 WB – Wet Bulb
 TC – Total Net Capacity (1000 Btu/hour)
 SC – Sensible Capacity (1000 Btu/hour)
 Input – Total Power (kW)

HEATING PERFORMANCE DATA – CASSETTE

MODEL	HEATING			OUTDOOR CONDITIONS (DB)										
	Indoor Conditions			-13F (-25C)	-4F (-20C)	0F (-17C)	5F (-15C)	17F (-8C)	19.4F (-7C)	24.8F (-4C)	32F (0C)	39.2F (4C)	44.6F (7C)	53.6F (12C)
09 (208-230V)	59F (15C)	TC		8.23	9.58	10.31	11.01	13.28	13.57	13.99	14.39	14.90	15.56	16.99
		Input		1.68	1.76	1.76	1.76	1.80	1.76	1.63	1.44	1.41	1.38	1.36
		COP		1.44	1.60	1.72	1.83	2.17	2.26	2.51	2.92	3.11	3.30	3.66
	64.4F (18C)	TC		7.75	9.12	10.01	10.72	12.81	13.04	13.39	13.58	14.19	15.15	16.39
		Input		1.70	1.78	1.82	1.82	1.89	1.81	1.67	1.48	1.46	1.43	1.42
		COP		1.34	1.51	1.61	1.72	1.99	2.11	2.35	2.69	2.85	3.10	3.38
	69F (20.5C)	TC		7.32	8.74	9.76	10.47	12.46	12.57	12.76	12.85	13.76	14.62	15.88
		Input		1.72	1.80	1.90	1.90	1.98	1.89	1.72	1.50	1.51	1.50	1.49
		COP		1.25	1.43	1.51	1.62	1.85	1.95	2.17	2.51	2.67	2.85	3.12
	71.6F (22C)	TC		7.02	8.35	9.47	10.22	12.01	12.06	12.26	12.36	13.27	14.13	15.39
		Input		1.74	1.83	1.93	1.92	2.01	1.91	1.77	1.54	1.58	1.55	1.53
		COP		1.18	1.34	1.44	1.56	1.75	1.85	2.03	2.35	2.46	2.67	2.95
12 (208-230V)	59F (15C)	TC		8.48	9.86	10.62	11.34	13.68	13.97	14.41	14.82	15.34	16.03	17.49
		Input		1.72	1.80	1.80	1.81	1.84	1.80	1.67	1.48	1.44	1.42	1.39
		COP		1.44	1.61	1.73	1.84	2.18	2.28	2.53	2.94	3.12	3.32	3.68
	64.4F (18C)	TC		7.98	9.40	10.31	11.04	13.20	13.43	13.79	13.99	14.62	15.61	16.88
		Input		1.74	1.82	1.87	1.87	1.93	1.86	1.71	1.52	1.50	1.47	1.46
		COP		1.34	1.51	1.62	1.73	2.00	2.12	2.36	2.70	2.86	3.11	3.40
	69F (20.5C)	TC		7.54	9.01	10.05	12.22	12.83	12.94	13.14	13.23	14.17	15.06	16.36
		Input		1.77	1.85	1.95	1.98	2.03	1.94	1.77	1.55	1.56	1.55	1.53
		COP		1.25	1.43	1.51	1.81	1.85	1.95	2.17	2.51	2.67	2.85	3.12
	71.6F (22C)	TC		7.23	8.60	9.75	10.52	12.37	12.42	12.63	12.73	13.66	14.55	15.85
		Input		1.78	1.87	1.98	1.97	2.06	1.96	1.81	1.58	1.62	1.59	1.57
		COP		1.19	1.34	1.44	1.56	1.76	1.86	2.04	2.36	2.47	2.68	2.96
18 (208-230V)	59F (15C)	TC		13.81	17.11	18.18	21.00	21.86	22.11	23.06	24.69	25.80	26.81	28.10
		Input		2.45	2.73	2.62	2.97	2.76	2.69	2.62	2.66	2.47	2.35	2.22
		COP		1.65	1.84	2.03	2.07	2.32	2.41	2.58	2.72	3.06	3.35	3.71
	64.4F (18C)	TC		13.12	16.32	17.45	20.23	21.07	21.36	22.12	23.45	24.53	25.78	26.80
		Input		2.53	2.78	2.83	3.09	2.87	2.75	2.68	2.74	2.56	2.42	2.26
		COP		1.52	1.72	1.81	1.92	2.15	2.28	2.42	2.51	2.81	3.12	3.48
	69F (20.5C)	TC		12.59	15.67	16.68	19.01	20.59	20.89	21.34	22.54	23.79	24.63	25.40
		Input		2.55	2.82	2.89	3.18	2.93	2.82	2.77	2.81	2.67	2.53	2.43
		COP		1.45	1.63	1.69	1.75	2.06	2.17	2.26	2.35	2.61	2.85	3.06
	71.6F (22C)	TC		12.09	14.72	15.97	18.15	20.16	20.34	20.91	21.53	22.57	23.53	24.00
		Input		2.67	2.82	2.98	3.32	3.25	3.19	2.95	2.75	2.60	2.59	2.40
		COP		1.35	1.53	1.57	1.60	1.82	1.87	2.08	2.29	2.54	2.67	2.93

LEGEND

DB – Dry Bulb
 TC – Total Net Capacity (1000 Btu/hour)
 Input – Total Power (kW)

COOLING PERFORMANCE DATA – DUCTED STYLE

MODEL	COOLING		OUTDOOR CONDITIONS (DB)						
	Indoor Conditions			77F (25C)	86F (30C)	95F (35C)	104F (40C)	113F (45C)	122F (50C)
	DB	WB							
09 (208-230V)	69.8F (21C)	59F (15C)	TC	9.81	9.82	10.21	7.97	7.66	7.02
			SC	7.26	7.36	7.25	6.69	6.13	5.69
			Input	0.72	0.93	1.23	1.06	0.98	0.91
	75.2F (24C)	62.6F (17C)	TC	10.89	11.01	10.89	8.66	8.33	7.83
			SC	7.73	7.82	7.84	6.76	6.67	6.42
			Input	0.72	0.94	1.23	1.06	1.00	0.94
	80.6F (27C)	66.2F (19C)	TC	11.74	12.11	11.87	9.62	9.12	8.62
			SC	7.63	8.11	8.19	7.31	7.39	7.07
			Input	0.74	0.96	1.25	1.08	1.01	0.97
	89.6F (32C)	73.4F (23C)	TC	12.25	12.60	12.23	10.53	9.82	9.13
			SC	7.96	8.44	8.44	8.00	7.96	7.48
			Input	0.76	0.99	1.27	1.12	1.06	0.98
12 (208-230V)	69.8F (21C)	59F (15C)	TC	9.81	9.82	10.21	7.97	7.66	7.02
			SC	7.26	7.36	7.25	6.69	6.13	5.69
			Input	0.72	0.93	1.23	1.06	0.98	0.91
	75.2F (24C)	62.6F (17C)	TC	10.89	11.01	10.89	8.66	8.33	7.83
			SC	7.73	7.82	7.84	6.76	6.67	6.42
			Input	0.72	0.94	1.23	1.06	1.00	0.94
	80.6F (27C)	66.2F (19C)	TC	11.74	12.11	11.87	9.62	9.12	8.62
			SC	7.63	8.11	8.19	7.31	7.39	7.07
			Input	0.74	0.96	1.25	1.08	1.01	0.97
	89.6F (32C)	73.4F (23C)	TC	12.25	12.60	12.23	10.53	9.82	9.13
			SC	7.96	8.44	8.44	8.00	7.96	7.48
			Input	0.76	0.99	1.27	1.12	1.06	0.98
18 (208-230V)	69.8F (21C)	59F (15C)	TC	11.29	12.79	17.20	12.58	11.90	10.90
			SC	9.50	10.06	12.27	10.08	9.47	8.91
			Input	0.66	1.07	1.89	1.49	1.40	1.26
	75.2F (24C)	62.6F (17C)	TC	12.46	14.33	18.29	13.58	12.87	12.14
			SC	9.72	10.55	12.58	10.23	9.67	9.09
			Input	0.69	1.25	1.94	1.35	1.33	1.23
	80.6F (27C)	66.2F (19C)	TC	13.67	16.73	19.15	15.51	14.46	13.67
			SC	9.89	11.34	12.65	11.18	10.85	9.84
			Input	1.01	1.52	1.94	1.56	1.43	1.31
	89.6F (32C)	73.4F (23C)	TC	14.26	17.42	19.74	16.97	15.57	14.47
			SC	10.28	11.73	13.26	11.63	11.23	10.76
			Input	1.03	1.58	1.97	1.60	1.51	1.38
24 (208-230V)	69.8F (21C)	59F (15C)	TC	23.20	22.99	21.24	18.40	16.65	15.82
			SC	17.63	17.47	16.57	15.09	12.21	11.79
			Input	2.02	2.45	2.71	2.60	2.11	1.88
	75.2F (24C)	62.6F (17C)	TC	25.42	25.13	27.89	21.12	18.56	17.58
			SC	15.24	15.65	15.56	14.51	14.85	14.42
			Input	2.05	2.48	2.75	2.64	2.14	1.91
	80.6F (27C)	66.2F (19C)	TC	28.14	27.61	25.21	21.99	19.98	18.02
			SC	19.42	19.05	17.90	16.72	15.98	14.78
			Input	2.10	2.52	2.79	2.68	2.16	1.94
	89.6F (32C)	73.4F (23C)	TC	30.15	30.08	28.64	22.68	20.22	19.22
			SC	21.41	21.36	20.91	17.01	16.18	15.76
			Input	2.12	2.58	2.81	2.72	2.20	1.97

LEGEND

DB – Dry Bulb
 WB – Wet Bulb
 TC – Total Net Capacity (1000 Btu/hour)
 SC – Sensible Capacity (1000 Btu/hour)
 Input – Total Power (kW)

HEATING PERFORMANCE DATA – DUCTED STYLE

MODEL	HEATING		OUTDOOR CONDITIONS (DB)										
	Indoor Conditions DB		-13F (-25C)	-4F (-20C)	0F (-17C)	5F (-15C)	17F (-8C)	19.4F (-7C)	24.8F (-4C)	32F (0C)	39.2F (4C)	44.6F (7C)	53.6F (12C)
09 (208-230V)	59F (15C)	TC	8.66	9.42	10.50	11.19	12.70	12.99	13.75	14.62	15.31	15.96	17.20
		Input	1.70	1.76	1.80	1.81	1.85	1.87	1.67	1.41	1.39	1.33	1.30
		COP	1.49	1.57	1.71	1.81	2.01	2.04	2.42	3.03	3.24	3.52	3.88
	64.4F (18C)	TC	8.60	9.22	10.01	11.13	12.50	13.00	13.70	14.43	14.91	15.42	16.62
		Input	1.82	1.89	1.83	1.85	1.88	1.89	1.70	1.49	1.45	1.39	1.36
		COP	1.39	1.43	1.60	1.76	1.95	2.02	2.36	2.84	3.02	3.26	3.59
	69F (20.5C)	TC	8.35	8.91	9.25	11.07	12.21	12.73	13.67	14.27	14.68	15.02	16.10
		Input	1.99	2.05	1.92	1.89	1.90	1.90	1.78	1.56	1.57	1.44	1.41
		COP	1.23	1.27	1.41	1.72	1.88	1.96	2.26	2.68	2.74	3.06	3.34
	71.6F (22C)	TC	8.25	8.71	9.00	10.87	12.01	12.43	13.35	14.01	14.30	14.66	15.67
		Input	2.00	2.10	1.96	1.93	1.93	1.94	1.81	1.62	1.60	1.50	1.48
		COP	1.21	1.22	1.35	1.65	1.83	1.87	2.16	2.54	2.61	2.87	3.11
12 (208-230V)	59F (15C)	TC	8.88	9.66	10.76	11.47	13.01	13.31	14.09	14.98	15.69	16.36	17.63
		Input	1.74	1.80	1.84	1.86	1.90	1.91	1.71	1.45	1.42	1.36	1.33
		COP	1.49	1.57	1.71	1.81	2.01	2.04	2.42	3.03	3.24	3.52	3.88
	64.4F (18C)	TC	8.81	9.45	10.26	11.41	12.81	13.32	14.04	14.79	15.28	15.81	17.04
		Input	1.86	1.94	1.88	1.90	1.93	1.93	1.74	1.53	1.48	1.42	1.39
		COP	1.39	1.43	1.60	1.76	1.95	2.02	2.36	2.84	3.02	3.26	3.59
	69F (20.5C)	TC	8.56	9.13	9.48	12.30	12.51	13.04	14.01	14.63	15.05	15.40	16.50
		Input	2.03	2.10	1.97	1.99	1.95	1.95	1.82	1.60	1.61	1.47	1.45
		COP	1.23	1.27	1.41	1.82	1.88	1.96	2.26	2.68	2.74	3.06	3.34
	71.6F (22C)	TC	8.46	8.92	9.22	11.14	12.31	12.74	13.68	14.36	14.66	15.02	16.06
		Input	2.04	2.15	2.00	1.98	1.98	1.99	1.86	1.66	1.64	1.54	1.51
		COP	1.23	1.27	1.41	1.82	1.88	1.96	2.26	2.68	2.74	3.06	3.34
18 (208-230V)	59F (15C)	TC	13.81	17.01	18.08	21.10	21.76	22.02	23.01	24.59	25.70	26.71	28.22
		Input	2.46	2.72	2.60	2.97	2.76	2.69	2.62	2.66	2.47	2.33	2.21
		COP	1.65	1.83	2.04	2.08	2.31	2.40	2.57	2.71	3.05	3.35	3.75
	64.4F (18C)	TC	13.06	16.23	17.36	20.13	21.00	21.27	22.02	23.36	24.43	25.67	26.69
		Input	2.52	2.79	2.83	3.08	2.88	2.74	2.68	2.72	2.58	2.43	2.25
		COP	1.52	1.71	1.80	1.92	2.14	2.27	2.41	2.52	2.78	3.10	3.47
	69F (20.5C)	TC	12.51	15.56	16.60	18.92	20.50	20.79	21.22	22.45	23.69	24.52	25.29
		Input	2.53	2.81	2.89	3.17	2.92	2.83	2.77	2.83	2.66	2.52	2.43
		COP	1.45	1.62	1.69	1.75	2.06	2.15	2.25	2.32	2.61	2.85	3.05
	71.6F (22C)	TC	12.00	14.61	15.87	18.05	20.07	20.26	20.82	21.42	22.48	23.44	23.89
		Input	2.68	2.80	2.98	3.33	3.25	3.18	2.95	2.76	2.61	2.58	2.39
		COP	1.31	1.53	1.56	1.59	1.81	1.87	2.07	2.28	2.52	2.66	2.93
24 (208-230V)	59F (15C)	TC	17.61	21.66	23.69	26.56	27.33	27.63	28.87	29.61	30.56	31.86	34.75
		Input	3.40	3.68	3.98	3.98	3.53	3.48	3.35	3.26	3.05	2.89	2.77
		COP	1.52	1.73	1.75	1.95	2.27	2.32	2.52	2.66	2.94	3.23	3.68
	64.4F (18C)	TC	16.89	20.82	23.02	25.87	26.98	27.01	27.98	28.58	29.51	30.75	33.66
		Input	3.58	3.81	4.02	4.03	3.92	3.86	3.52	3.43	3.23	3.01	2.83
		COP	1.38	1.60	1.68	1.88	2.02	2.05	2.33	2.44	2.67	2.99	3.49
	69F (20.5C)	TC	16.52	20.44	22.75	25.04	26.35	26.68	27.22	27.94	28.94	29.72	32.52
		Input	3.85	4.13	4.29	4.44	4.20	4.11	3.73	3.61	3.44	3.21	3.07
		COP	1.26	1.45	1.56	1.65	1.84	1.90	2.14	2.27	2.47	2.71	3.10
	71.6F (22C)	TC	15.65	19.05	21.02	23.16	23.84	24.11	25.65	26.64	27.57	28.81	30.91
		Input	3.97	4.19	4.33	4.51	4.32	4.22	3.82	3.68	3.34	3.28	2.98
		COP	1.15	1.33	1.42	1.51	1.61	1.67	1.98	2.12	2.42	2.57	3.04

LEGEND

DB – Dry Bulb
 TC – Total Net Capacity (1000 Btu/hour)
 Input – Total Power (kW)

COOLING PERFORMANCE DATA – FLOOR CONSOLE

MODEL	COOLING		OUTDOOR CONDITIONS (DB)						
	Indoor Conditions		77F (25C)	86F (30C)	95F (35C)	104F (40C)	113F (45C)	122F (50C)	
	DB	WB							
09 (208-230V)	69.8F (21C)	59F (15C)	TC	8.47	8.26	7.79	6.49	6.04	5.53
			SC	6.35	6.28	6.00	5.39	4.89	4.70
			Input	0.68	0.88	1.15	1.00	0.93	0.91
	75.2F (24C)	62.6F (17C)	TC	9.56	9.06	8.33	7.12	6.75	6.12
			SC	7.45	6.88	6.50	5.77	5.47	5.20
			Input	0.70	0.89	1.16	1.01	0.97	0.93
	80.6F (27C)	66.2F (19C)	TC	10.59	9.90	9.30	7.78	7.32	6.86
			SC	6.25	7.03	6.51	5.91	5.93	5.76
			Input	0.70	0.91	1.18	1.02	1.00	0.96
	89.6F (32C)	73.4F (23C)	TC	11.87	11.02	10.11	8.56	8.02	7.66
			SC	8.42	7.83	7.38	6.42	6.10	6.13
			Input	0.73	0.95	1.22	1.08	1.01	0.99
12 (208-230V)	69.8F (21C)	59F (15C)	TC	8.47	8.26	7.79	6.49	6.04	5.53
			SC	6.35	6.28	6.00	5.39	4.89	4.70
			Input	0.68	0.88	1.15	1.00	0.93	0.91
	75.2F (24C)	62.6F (17C)	TC	9.56	9.06	8.33	7.12	6.75	6.12
			SC	7.45	6.88	6.50	5.77	5.47	5.20
			Input	0.70	0.89	1.16	1.01	0.97	0.93
	80.6F (27C)	66.2F (19C)	TC	10.59	9.90	9.30	7.78	7.32	6.86
			SC	6.25	7.03	6.51	5.91	5.93	5.76
			Input	0.70	0.91	1.18	1.02	1.00	0.96
	89.6F (32C)	73.4F (23C)	TC	11.87	11.02	10.11	8.56	8.02	7.66
			SC	8.42	7.83	7.38	6.42	6.10	6.13
			Input	0.73	0.95	1.22	1.08	1.01	0.99

LEGEND

DB – Dry Bulb
 WB – Wet Bulb
 TC – Total Net Capacity (1000 Btu/hour)
 SC – Sensible Capacity (1000 Btu/hour)
 Input – Total Power (kW)

HEATING PERFORMANCE DATA – FLOOR CONSOLE

MODEL	HEATING		OUTDOOR CONDITIONS (DB)										
	Indoor Conditions		-13F (-25C)	-4F (-20C)	0F (-17C)	5F (-15C)	17F (-3C)	19.4F (-7C)	24.8F (-4C)	32F (0C)	39.2F (4C)	44.6F (7C)	53.6F (12C)
09 (208-230V)	59F (15C)	TC	8.13	8.67	9.36	10.42	12.64	12.89	13.25	13.68	13.97	14.30	16.03
		Input	1.72	1.75	1.87	1.86	1.86	1.79	1.60	1.45	1.43	1.42	1.38
		COP	1.39	1.45	1.47	1.64	2.00	2.11	2.42	2.77	2.86	2.95	3.40
	64.4F (18C)	TC	8.02	8.57	9.18	10.19	12.13	12.38	12.67	13.05	13.76	14.39	15.32
		Input	1.77	1.81	1.89	1.91	1.96	1.77	1.62	1.48	1.47	1.44	1.47
		COP	1.33	1.39	1.43	1.56	1.82	2.05	2.30	2.59	2.75	2.92	3.07
	69F (20.5C)	TC	7.95	8.41	9.02	9.99	11.54	11.77	12.13	12.45	13.55	14.45	14.25
		Input	1.81	1.84	1.90	1.97	2.01	1.98	1.62	1.51	1.49	1.46	1.54
		COP	1.29	1.34	1.39	1.49	1.68	1.74	2.20	2.42	2.67	2.90	2.71
	71.6F (22C)	TC	7.85	8.37	9.00	9.59	11.14	11.36	11.77	12.06	13.36	14.19	13.62
		Input	1.85	1.87	1.95	1.99	2.10	2.07	1.66	1.56	1.50	1.48	1.50
		COP	1.25	1.31	1.35	1.41	1.56	1.61	2.08	2.27	2.61	2.81	2.67
12 (208-230V)	59F (15C)	TC	8.34	8.88	9.60	10.68	12.96	13.21	13.59	14.02	14.32	14.66	16.43
		Input	1.76	1.79	1.91	1.91	1.90	1.83	1.64	1.48	1.47	1.46	1.41
		COP	1.39	1.45	1.47	1.64	2.00	2.11	2.42	2.77	2.86	2.95	3.40
	64.4F (18C)	TC	8.22	8.78	9.41	10.44	12.44	12.69	12.98	13.38	14.11	14.75	15.71
		Input	1.81	1.86	1.93	1.96	2.01	1.81	1.66	1.51	1.50	1.48	1.50
		COP	1.33	1.39	1.43	1.56	1.82	2.05	2.30	2.59	2.75	2.92	3.07
	69F (20.5C)	TC	8.15	8.62	9.25	12.01	11.83	12.06	12.44	12.76	13.89	14.81	14.61
		Input	1.86	1.89	1.94	2.00	2.06	2.03	1.66	1.55	1.52	1.50	1.58
		COP	1.29	1.34	1.39	1.76	1.68	1.74	2.20	2.42	2.67	2.90	2.71
	71.6F (22C)	TC	8.05	8.58	9.22	9.83	11.41	11.64	12.06	12.36	13.70	14.54	13.96
		Input	1.89	1.91	1.99	2.04	2.15	2.12	1.70	1.59	1.54	1.52	1.54
		COP	1.25	1.31	1.35	1.41	1.56	1.61	2.08	2.27	2.61	2.81	2.67

LEGEND

DB – Dry Bulb
 TC – Total Net Capacity (1000 Btu/hour)
 Input – Total Power (kW)

APPLICATION DATA

UNIT SELECTION

Select equipment that either matches or supports slightly more than the anticipated peak load. This provides better humidity control, fewer unit cycles, and less part-load operation.

For units used in spaces with high sensible loads, base equipment selection on unit sensible load, not on total anticipated load. Adjust for anticipated room wet bulb temperature to avoid undersizing the equipment.

UNIT MOUNTING (OUTDOOR)

Refer to the unit's installation instructions for further details.

Unit leveling – For reliable operation, units should be level in all planes.

Clearance – Minimum clearance (see Fig. 5) must be provided for airflow. The condensing units are designed for free-flow application. Air inlets and outlets should not be restricted.

Unit location – A location which is convenient to installation and not exposed to strong winds. A location that can bear the weight of the outdoor unit and where the outdoor unit can be mounted in a level position.

Do not install the indoor or outdoor units in a location with special environmental conditions. For those applications, contact your sales representative.

SYSTEM OPERATING CONDITIONS

OPERATING RANGE MIN / MAX °F (°C)		
	COOLING	HEATING
Outdoor DB (Sizes 9 & 12 115V)	-4 / 122 (-20 / 50)	-4 / 86 (-20 / 30)
Outdoor DB (Sizes 9 – 24 208/230V)	-4 / 122 (-20 / 50)	-22 / 86 (-30 / 30)
Outdoor DB (sizes 30 & 36)	-4 / 122 (-20 / 50)	-4 / 86 (-20 / 30)

NON-OPERATING TEMPERATURE RANGE MIN / MAX °F (°C)	
Outdoor DB	-49–140 (-45–60)

NOTE: Reference the product installation instructions for more information.

CUT IN/OUT TEMPERATURES °F (°C)									
		Standby Mode				Running Mode			
		COOLING		HEATING		COOLING		HEATING	
		Cut In	Cut Out	Cut In	Cut Out	Cut In	Cut Out	Cut In	Cut Out
9K	(115V)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)
12K	(115V)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)
9K	(208/230V)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-40 (-40)	-25.6 (-32)	-40 (-40)
12K	(208/230V)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-40 (-40)	-25.6 (-32)	-40 (-40)
18K	(208/230V)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-40 (-40)	-25.6 (-32)	-40 (-40)
24K	(208/230V)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-35 (-31)	-25.6 (-32)	-40 (-40)	-25.6 (-32)	-40 (-40)
30K	(208/230V)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)
36K	(208/230V)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)	-7.6 (-22)	-13 (-25)

METERING DEVICES

The outdoor unit has an electronic expansion valve to manage the refrigerant flow of the connected fan coil.

DRAIN CONNECTIONS

Install drains to meet the local sanitation codes.

See the physical dimension tables for the drain sizes.

REFRIGERANT LINES

General refrigerant line sizing:

1. The outdoor units are shipped with a full charge of R410A refrigerant. All charges, line sizing, and capacities are based on runs of 25 ft. (7.6 m). For runs over 25 ft. (7.6 m), review the *Long Line Applications* section for the proper charge adjustments.
2. Refrigerant lines should not be buried in the ground. If it is necessary to bury the lines, do not bury more than 36-in (914 mm). Provide a minimum 6-in (152 mm) vertical rise to the service valves to prevent refrigerant migration.
3. Both lines must be insulated. Use a minimum of 1/2-in. (12.7 mm) thick insulation. Closed-cell insulation is recommended in all long-line applications.
4. Special consideration should be given to isolating the interconnecting tubing from the building structure. Isolate the tubing so vibration or noise is not transmitted into the structure.

Long Line Applications:

1. No change in line sizing is required.
2. Add refrigerant per the following table.

ADDITIONAL CHARGE TABLE

UNIT SIZE	TOTAL LINE LENGTH ft		ADDITIONAL CHARGE, oz/ft. ft (m)		
	Min	Max	10 – 25 (3 – 8)	>25 – 82 (8 – 25)	>82 – 164 (25 – 50)
9	10	82	None	0.16	
12					
18					
24					
30					
36	164	0.32	0.32		

WIRING

All wires must be sized per NEC (National Electrical Code) or CEC (Canadian Electrical Code) and local codes. Use Electrical Data table MCA (minimum circuit amps) and MOCP (maximum over current protection) to correctly size the wires and the disconnect fuse or breakers respectively. Per the caution note, only stranded copper conductors with a 600 volt rating and double insulated copper wire must be used.

The use of BX cable is not recommended.

Recommended Connection Method for Power and Communication Wiring

Power and Communication Wiring:

The main power is supplied to the outdoor unit. The field supplied 14/3 power/communication wiring from the outdoor unit to indoor unit consists of four (4) wires and provides the power for the indoor unit. Two wires are high voltage AC power, one is communication wiring and the other is a ground wire.

Recommended Connection Method for Power and Communication Wiring (To minimize communication wiring interference)

Power Wiring:

The main power is supplied to the outdoor unit. The field supplied power wiring from the outdoor unit to indoor unit consists of three (3) wires and provides the power for the indoor unit. Two wires are high voltage AC power and one is a ground wire.

To minimize voltage drop, the factory recommended wire size is 14/2 stranded with a ground.

Communication Wiring:

A separate shielded Stranded copper conductor only, with a 600 volt rating and double insulated copper wire, must be used as the communication wire from the outdoor unit to the indoor unit. Please use a separate shielded 16GA stranded control wire.

CAUTION

EQUIPMENT DAMAGE HAZARD

Failure to follow this caution may result in equipment damage or improper operation.

- Wires should be sized based on NEC and local codes.
- Use copper conductors only with a 600 volt rating and double insulated copper wire.

CAUTION

EQUIPMENT DAMAGE HAZARD

Failure to follow this caution may result in equipment damage or improper operation.

- Be sure to comply with local codes while running wire from the indoor unit to the outdoor unit.
- Every wire must be connected firmly. Loose wiring may cause the terminal to overheat or result in unit malfunction. A fire hazard may also exist. Ensure all wiring is tightly connected.
- No wire should touch the refrigerant tubing, compressor or any moving parts.
- Disconnecting means must be provided and shall be located within sight and readily accessible from the air conditioner.
- Connecting cable with conduit shall be routed through the hole in the conduit panel.

AIR FLOW DATA

UNIT SIZE	9K (115V)	12K (115V)	9K (208/230V)	12K (208/230V)	18K (208/230V)	24K (208/230V)	30K (208/230V)	36K (208/230V)
Outdoor (CFM)	1200	1200	1200	1200	1390	2130	2130	2130

SOUND PRESSURE


Estimated sound pressure level when 38MAR unit is paired with High Walls Indoor	9K (115V)	12K (115V)	9K (208/230V)	12K (208/230V)	18K (208/230V)	24K (208/230V)	30K (208/230V)	36K (208/230V)
Outdoor sound pressure level (heat pump models)	dBa	52.5	52.5	55.5	56	57.5	60.5	60.5

Estimated sound pressure when 38MAR unit is paired with the Indoor Cassette	9K (208/230V)	12K (208/230V)	18K (208/230V)	
Outdoor sound pressure level (heat pump models)	dBa	54	56	59

Estimated sound pressure when 38MAR unit is paired with the Indoor Console	9K (208/230V)	12K (208/230V)	
Outdoor sound pressure level (heat pump models)	dBa	57	56

Estimated sound pressure when 38MAR unit is paired with Ducted Indoor	9K (230V)	12K (230V)	18K (208/230V)	24K (208/230V)	
Outdoor sound pressure level (heat pump models)	dBa	56	56	58	59

OUTDOOR UNIT SOUND PRESSURE TEST CONDITIONS

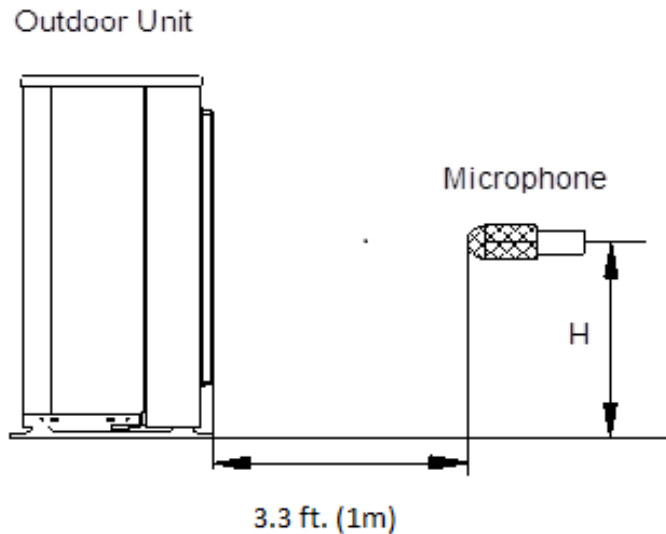

NOTE: H=0.5 x Height of outdoor unit

	INDOOR CONDITION		OUTDOOR CONDITION	
	DB	WB	DB	WB
Cooling	80.6F (27C)	66.2F (19C)	95F (35C)	75.2F (24C)
Heating	68F (20C)	59F (15C)	44.6F (7C)	42.8F (6C)

ELECTRICAL DATA

MAR OUTDOOR UNIT SIZE	9K	12K	9K	12K	18K	24K	30K	36K
Power Supply	Volts-PH-Hz	115-1-60	115-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60
	Max - Min* Oper. Voltage	126-104	126-104	253-187	253-187	253-187	253-187	253-187
	MCA	15	15	9	9	18	20	20
	Max Fuse/ CB AMP	20	20	15	15	25	30	30
Compressor	Volts-PH-Hz	115-1-60	115-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60	208/230-1-60
	RLA	9	9	5.25	5.65	12.3	14	15

*Permissible limits of the voltage range at which the unit will operate satisfactorily.

LEGEND

FLA - Full Load Amps
MCA - Minimum Circuit Amps
RLA - Rated Load Amps

WIRING DIAGRAMS

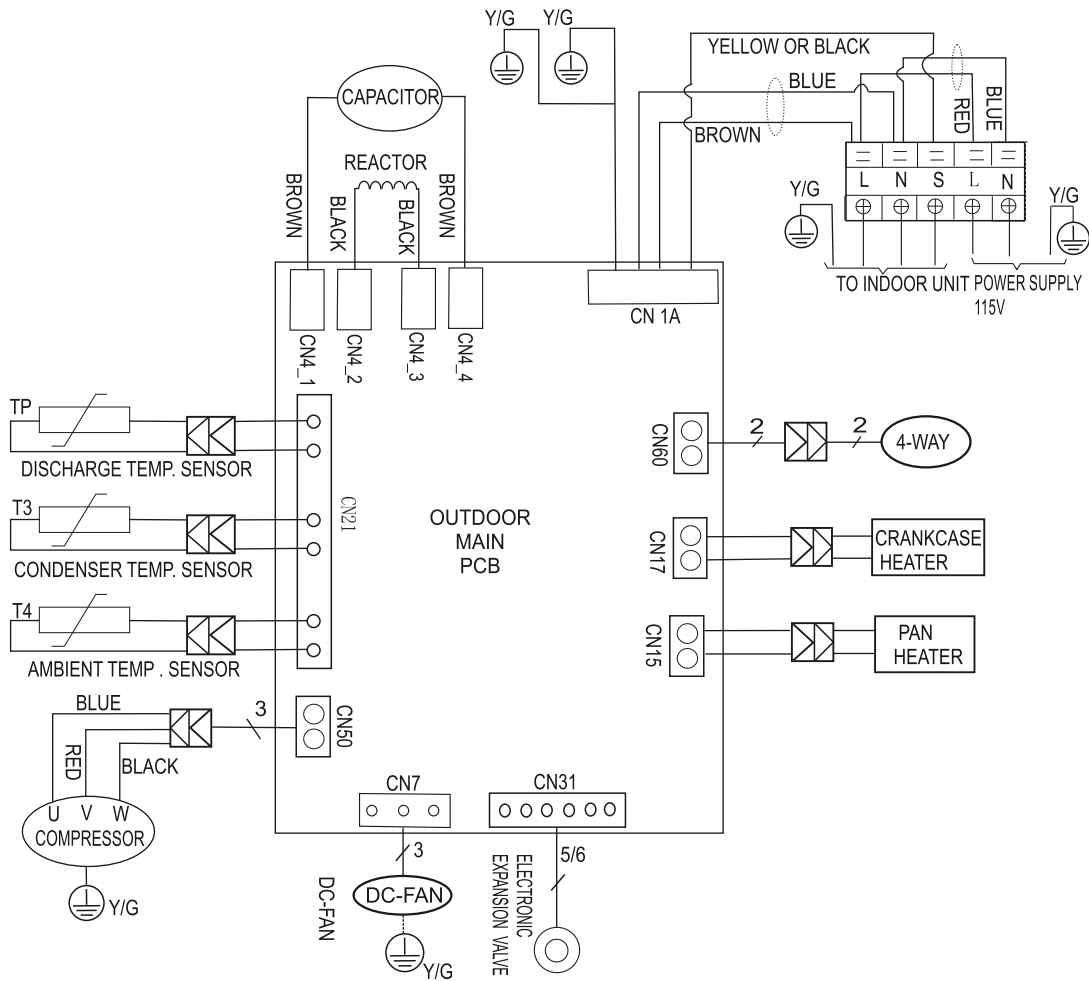


Fig. 6 – Wiring Diagram Sizes 09K-12K (115V)

CODE	PART NAME	CODE	PART NAME
CN1A	INPUT:115V High voltage connector with L/N/Ground/Signal	CN60	Output:115 VAC for 4-way valve control
CN4_1 CN4_2 CN4_3 CN4_4	Output: 115VAC High voltage connector for power factor corrector (PFC)	CN50	Output: PWM for UVW to control Compressor(0-320VAC)
CN7	Output: PWM for UVW to control the outdoor fan (0-320VAC)	CN21	Input: Temperature acquisition (0-5VDC)
CN15	Output:1 15VAC High voltage to control base pan heater	CN31	Connector for electronic expansion valve (0-12VDC)
CN17	Output:1 15VAC High voltage to control crankcase heater		

WIRING DIAGRAMS (CONTINUED)

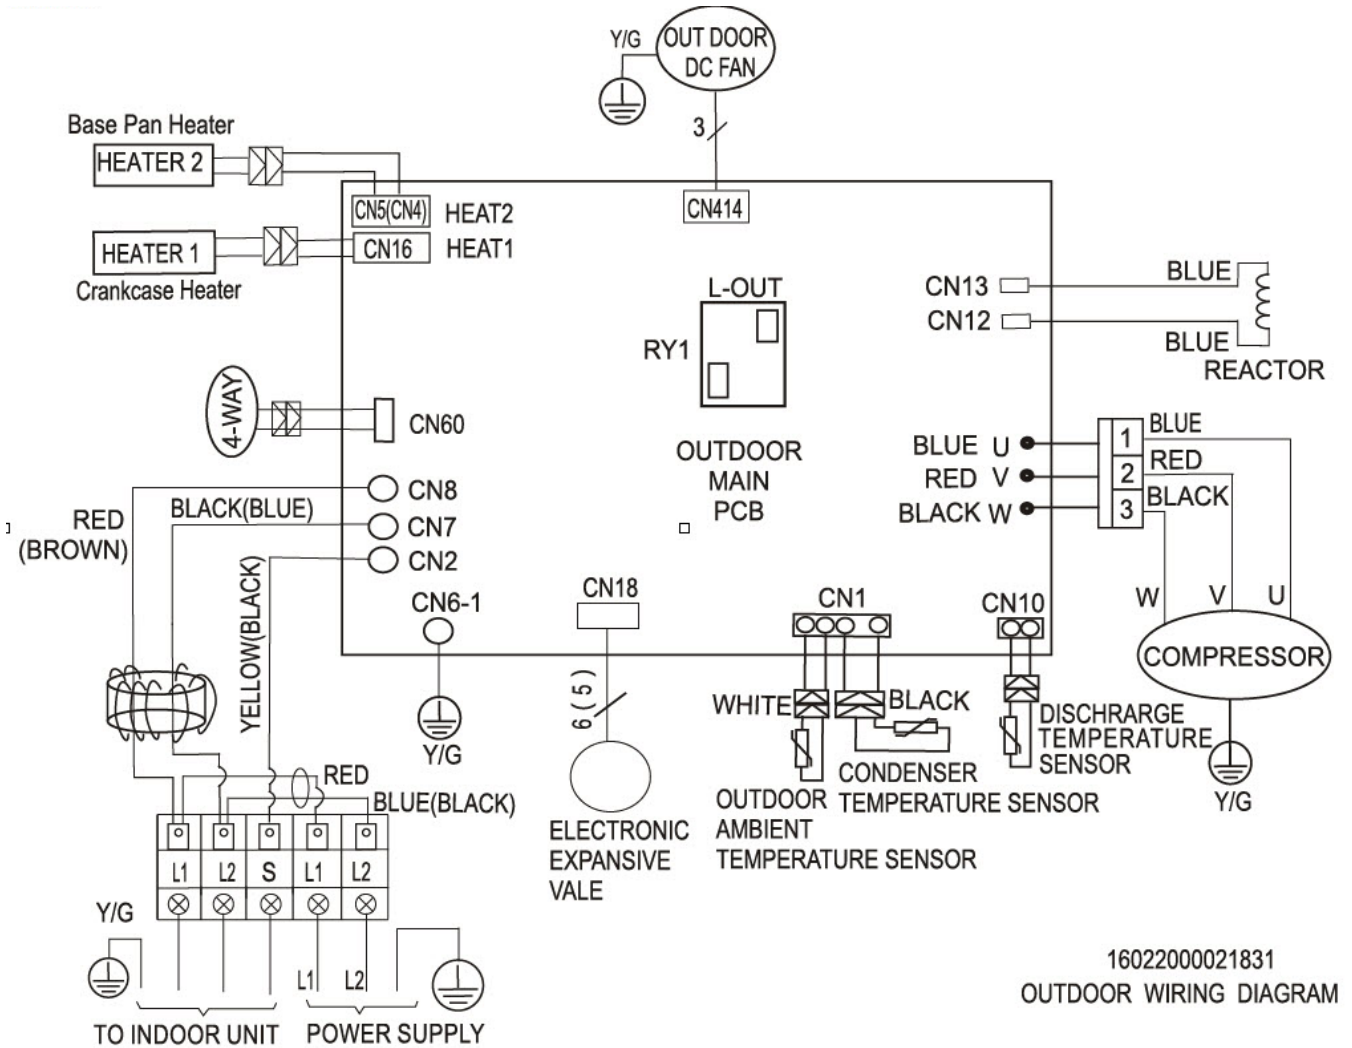


Fig. 7 – Wiring Diagram – Sizes 09K, 12K, 18K (230V)

CODE	PART NAME	CODE	PART NAME
CN2	Output: high voltage signal (to indoor unit)	CN12,CN13	Output: High voltage to reactor
CN7, 8	Input: 220 VAC High voltage (from indoor unit)	U V W	Output: Pulse (0–320VDC) to compressor
CN60	Output: 220 VAC for 4–way valve control	CN10	Input: Pin1–Pin2 (0–5V) from discharge temperature sensor
CN16	Output: 220 VAC High voltage to control crankcase heater	CN1	Input: Pin1, Pin3, Pin4, Pin5 (0–5V) from condenser and outdoor ambient temperature sensors
CN414	Output: Pulse (0–320VDC) to outdoor fan motor	CN6–1	Ground Connector
CN5 (CN4)	Output: 220 VAC High voltage to control base pan heater	CN18	Output:Pin5&6 (12V) to electronic expansion valve

WIRING DIAGRAMS (CONTINUED)

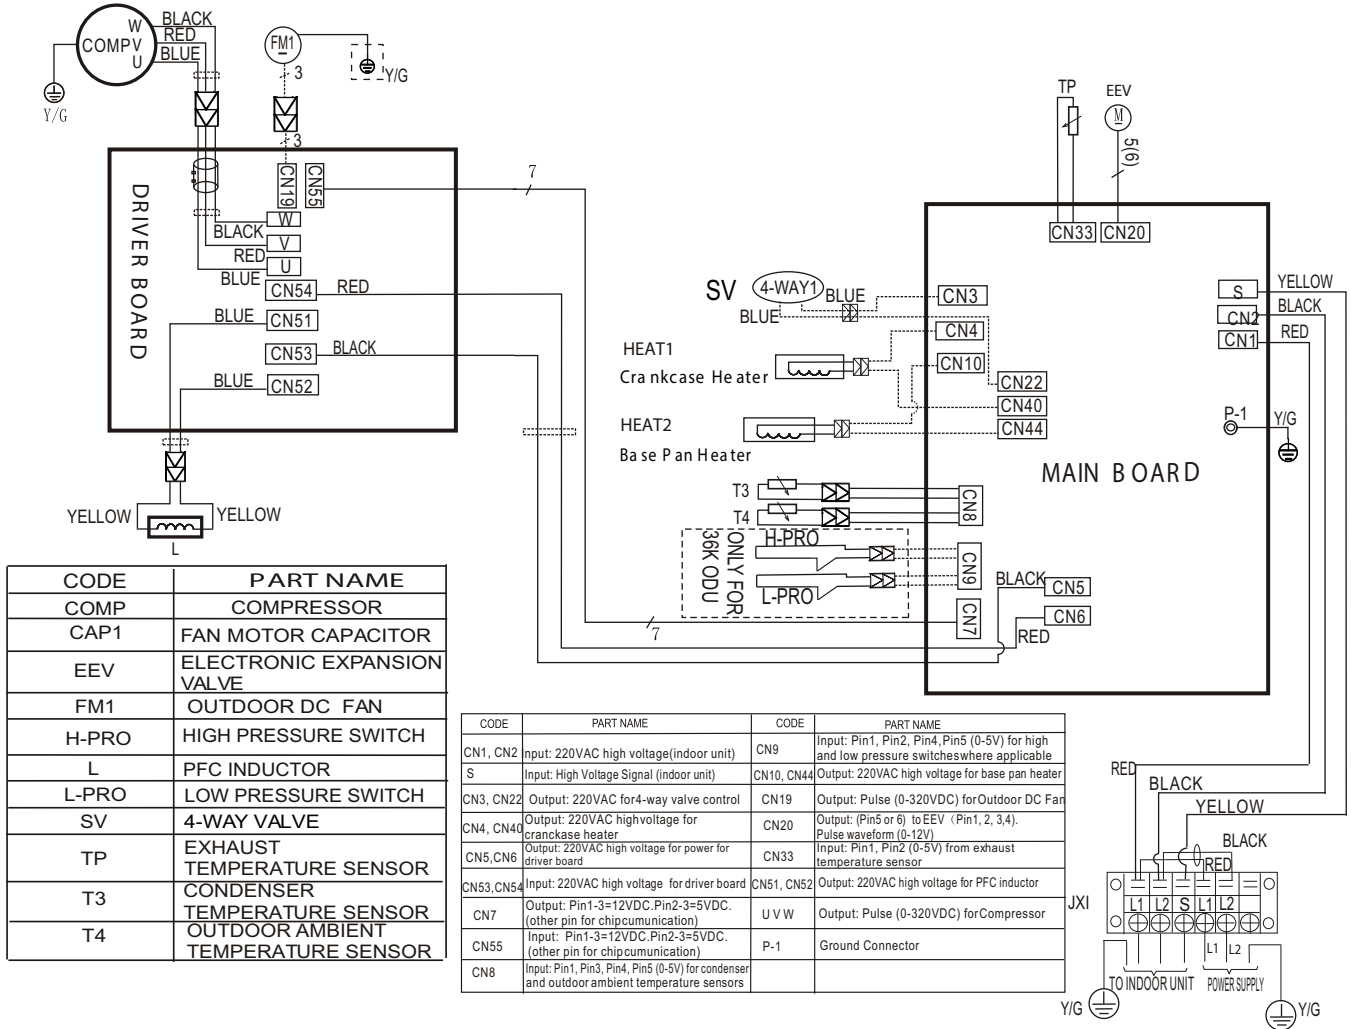


Fig. 8 – Wiring Diagram Sizes 24K-36K

GUIDE SPECIFICATIONS

HORIZONTAL DISCHARGE OUTDOOR UNITS

Size Range: 3/4 to 3 Ton Nominal Cooling and Heating Capacity

Carrier Model Number: 38MA*R

PART 1 – GENERAL

1.01 System Description

- A. Outdoor air-cooled split system compressor sections suitable for on-the-ground, rooftop, wall hung or balcony mounting. Units consist of a rotary compressor, an air-cooled coil, propeller-type draw-through outdoor fan, reversing valve (HP), accumulator (HP units), metering device(s), and a control box. Units discharge air horizontally as shown on the contract drawings. Units function as the outdoor component of an air-to-air heat pump system.
- B. Units are to be used in a refrigeration circuit matched to ductless heat pump fan coil units.

1.02 Agency Listings

- A. Unit construction complies with ANSI/ASHRAE 15, latest revision, and with the NEC.
- B. Units are evaluated in accordance with UL standard 1995.
- C. Units are listed in the CEC directory.
- D. Unit cabinet is capable of withstanding 500-hour salt spray test per Federal Test Standard No. 141 (method 6061).
- E. Air-cooled condenser coils are leak tested at 550 psig.

1.03 Delivery, Storage, And Handling

Units are shipped in one piece and are stored and handled per unit manufacturer's recommendations.

1.04 Warranty (For Inclusion By Specifying Engineer)

PART 2 – PRODUCTS

2.01 Equipment

A. General:

Factory assembled, single piece, air-cooled outdoor unit. Contained within the unit enclosure is all the factory wiring, piping, controls, and the compressor.

B. Unit Cabinet:

- 1. Unit cabinet is constructed of galvanized steel, bonderized and coated with a baked-enamel finish on the inside and outside.
- 2. Unit access panels is removable with minimal screws and provides full access to the compressor, fan, and control components.
- 3. The outdoor compartment is isolated and has an acoustic lining to assure quiet operation.

C. Fans:

- 1. Outdoor fans are the direct drive propeller type, and discharges air horizontally. Fans draw air through the outdoor coil.
- 2. Outdoor fan motors are totally enclosed, single phase motors with class E insulation and permanently lubricated ball bearings. Motor shall be protected by internal thermal overload protection.
- 3. The shaft has inherent corrosion resistance.
- 4. Fan blades are non-metallic and statically and dynamically balanced.
- 5. Outdoor fan openings are equipped with a PVC metal/mesh coated protection grille over the fan.

D. Compressor:

- 1. Compressor is the fully hermetic rotary type.
- 2. Compressor is equipped with an oil system, operating oil charge, and a motor.
- 3. Motor is NEMA rated class E, suitable for operation in a refrigerant atmosphere.
- 4. Compressor assembly is installed on rubber vibration isolators.

E. Outdoor Coil:

The coil is constructed of aluminum blue hydrophilic pre-coated fins mechanically bonded to seamless copper tubes, which are cleaned, dehydrated, and sealed.

F. Refrigeration Components:

Refrigerant circuit components include a brass external liquid line service valve with service gage port connections, a suction line service valve with a service gage connection port, service gage port connections on compressor suction and discharge lines with Schrader type fittings with brass caps, accumulator, reversing valve.

G. Controls and Safeties:

Operating controls and safeties are factory selected, assembled, and tested. The minimum control functions include the following:

- 1. Controls:
 - a. A time delay control sequence is provided standard through the fan coil board
 - b. Automatic outdoor fan motor protection.
- 2. Safeties:
 - a. System diagnostics
 - b. Compressor motor current and temperature overload protection
 - c. Outdoor fan failure protection.

H. Electrical Requirements:

- 1. Unit operates on single-phase, 60 Hz power at 115V for unit sizes 09-12 and 208/230V for unit sizes 09, 12, 18, 24, 30 and 36, as specified.
- 2. Unit electrical power has a single point connection.
- 3. Unit Control voltage to the indoor fan coil is 0-15V DC.
- 4. All power and control wiring must be installed per NEC and all local electrical codes.
- 5. The unit has high and low voltage terminal block connections.

