



OIL FIRED LOWBOY FURNACE SPECIFICATIONS

MODEL NO.	VLF-BBP (Front Flue) or VLR-BBP (Rear Flue) (BECKETT AF)				VLF-BNP (Front Flue) or VLR-BNP (Rear Flue) (BECKETT NX)			
	High Fire	Med-High Fire	Med-Low Fire [5]	Low Fire	High Fire	Med-High Fire	Med-Low Fire [5]	Low Fire
HEATING CAPACITY								
HEAT INPUT RATE (BTUH)	140,000	119,000	105,000	84,000	140,000	119,000	105,000	84,000
OUTPUT BTUH [1]	114,000	98,000	86,000(F) 88,000(R)	70,000	114,000	98,000	89,000(F) 90,000(R)	70,000
SEASONAL EFFICIENCY [2]	83.0% (Front Flue) / 85.0% (Rear Flue)				85.9% (Front Flue) / 86.0% (Rear Flue)			
LARGEST REC A/C [3]	4 Tons				4 Tons			
NOMINAL TEMP RISE	70° F				70° F			
HEAT EXCHANGER AREA (SQ. FT.)	27.8 (front flue) / 30.0 (rear flue)				27.8 (front flue) / 30.0 (rear flue)			
CASING HEIGHT	41.5"				41.5"			
CASING WIDTH	22.25"				22.25"			
CASING DEPTH	47"				47"			
NOMINAL FLUE OUTLET DIA.	6"				6"			
APPROX SHIPPING WEIGHT (LBS)	300				300			
APPROVAL AGENCY	ETL				ETL			
QTY AND SIZE OF PERMANENT FILTERS	(2) 10" X 20"				(2) 10" X 20"			
ELECTRICAL REQUIREMENTS	120v / 60hz / 1ph				120v / 60hz / 1ph			
TOTAL CURRENT (AMPS)	10.2				10.2			
MAX FUSE SIZE (AMPS)	15				15			
HEIGHT FROM FLOOR TO CENTER OF FLUE	37.5" (front flue opens upw ard)				37.5" (front flue opens upw ard)			
	31" (rear flue exists horizontally rearw ard)				31" (rear flue exists horizontally rearw ard)			
SUPPLY AIR OUTLET SIZE	20" X 20"				20" X 20"			
RETURN AIR INLET SIZE	20" x 12.5"				20" x 12.5"			
	ACCESSORY ITEMS							
PROGRAMMABLE T-STAT STD/DELUXE	350164 / 350165				350164 / 350165			
FURNACE PARTS KIT	AOPS2676				AOPS2676			
OPTIONAL 4 TON AIRFLOW KIT	S00S4141				S00S4141			
BURNER FRESH AIR VENT KIT	AOPS7482				AOPS8413			
BLOCKED VENT KIT [4]	AOPS2688				AOPS2688			

1 OUTPUT BTUH BASED ON ANNUAL FUEL UTILIZATION EFFICIENCY RATED BY MANUFACTURER.

2 SEASONAL EFFICIENCY (ALSO CALLED AFUE - ANNUAL FUEL UTILIZATION EFFICIENCY) RATINGS ARE BASED ON TESTS FOLLOWING U.S. DEPARTMENT OF ENERGY TEST PROCEDURES.

3 TO PERMIT LARGEST RECOMMENDED AIR CONDITIONING (AT .5 STATIC PRESSURE), OPTIONAL BLOWER UPGRADE KIT IS REQUIRED.

4 NOT TO BE USED IN SIDEWALL VENT APPLICATIONS, USE ONLY WHEN CHIMNEY VENTED.

5 AFUE RATINGS AS SHIPPED.

SEE NEXT PAGE FOR MORE DATA-

OIL FIRED HORIZONTAL/COUNTERFLOW FURNACE SPECIFICATIONS

MODEL NO.	VC-BBP (BECKETT AF)				VC-BNP (BECKETT NX)			
	High Fire	Med-High Fire	Med-Low Fire	Low Fire	High Fire	Med-High Fire	Med-Low Fire	Low Fire
HEATING CAPACITY								
HEAT INPUT RATE (BTUH)	140,000	119,000	105,000	84,000	140,000	119,000	105,000	84,000
OUTPUT BTUH[1]	113,000	97,000	86,000	69,000	113,000	97,000	90,000	69,000
SEASONAL EFFICIENCY[2]	83.0%				86.0%			
LARGEST REC A/C[3]	4 Tons				4 Tons			
NOMINAL TEMP RISE	70°				70°			
HEAT EXCHANGER AREA (SQ. FT.)	27.8				27.8			
CASING HEIGHT	22.25" (in horizontal configuration, flue exits horizontally forward)				22.25" (in horizontal configuration, flue exits horizontally forward)			
	61.25" (in counterflow /vertical configuration)				61.25" (in counterflow /vertical configuration)			
CASING WIDTH	61.25" (in horizontal configuration)"				61.25" (in horizontal configuration)"			
	22.25" (in counterflow /vertical configuration)				22.25" (in counterflow /vertical configuration)			
CASING DEPTH	22.25"				22.25"			
NOMINAL FLUE OUTLET DIA.	6"				6"			
APPROX SHIPPING WEIGHT (LBS)	280				280			
APPROVAL AGENCY	ETL				ETL			
QTY AND SIZE OF PERMANENT FILTERS	NONE SUPPLIED				NONE SUPPLIED			
ELECTRICAL REQUIREMENTS	120v / 60hz / 1ph				120v / 60hz / 1ph			
TOTAL CURRENT (AMPS)	10.2				10.2			
MAX FUSE SIZE (AMPS)	15				15			
HEIGHT FROM FLOOR TO CENTER OF FLUE SIDE/TOP	11" (in horizontal configuration flue exits horizontally forward)				11" (in horizontal configuration flue exits horizontally forward)			
	30.5" (in counterflow /vertical configuration, flue exits horizontally)				30.5" (in counterflow /vertical configuration, flue exits horizontally)			
SUPPLY AIR OUTLET SIZE	16" X 16"				16" X 16"			
RETURN AIR INLET SIZE	16" X 16"				16" X 16"			
	ACCESSORY ITEMS							
PROGRAMMABLE T-STAT STD/DELUXE	350164 / 350165				350164 / 350165			
FURNACE PARTS KIT	AOPS2676				AOPS2676			
COMBUSTIBLE FLOOR BASE	VC-BASE				VC-BASE			
OPTIONAL 4 TON AIRFLOW KIT	S00S4140				S00S4140			
BURNER FRESH AIR VENT KIT	AOPS7482				AOPS8413			
BLOCKED VENT KIT[4]	AOPS2688				AOPS2688			

1 OUTPUT BTUH BASED ON ANNUAL FUEL UTILIZATION EFFICIENCY RATED BY MANUFACTURER.

2 SEASONAL EFFICIENCY (ALSO CALLED AFUE - ANNUAL FUEL UTILIZATION EFFICIENCY) RATINGS ARE BASED ON TESTS FOLLOWING U.S. DEPARTMENT OF ENERGY TEST PROCEDURES.

3 TO PERMIT LARGEST RECOMMENDED AIR CONDITIONING (AT .5 STATIC PRESSURE), OPTIONAL BLOWER UPGRADE KIT IS REQUIRED


4 NOT TO BE USED IN SIDEWALL VENT APPLICATIONS, USE ONLY WHEN CHIMNEY VENTED.

SEE NEXT PAGE FOR MORE DATA-

Model Number Digit	1	2	3	4	5	6
	Model	Configuration	Flue	Design Change	Burner	Blower Motor
Oil Furnace Model Nomenclature Example Model Numbers	V	L	F	-B	B	P
V=Product Line Designation	V					
L = Lowboy, C = Counterflow/Horizontal		L				
F = Front, R = Rear (VL series option only)			F			
Design Change				-B		
Burner B= Beckett AF, N=Beckett NX					B	
Blower Motor P=PSC						P


SEE NEXT PAGE FOR MORE DATA-

OIL FIRED LOWBOY FRONT FLUE FURNACE SPECIFICATIONS

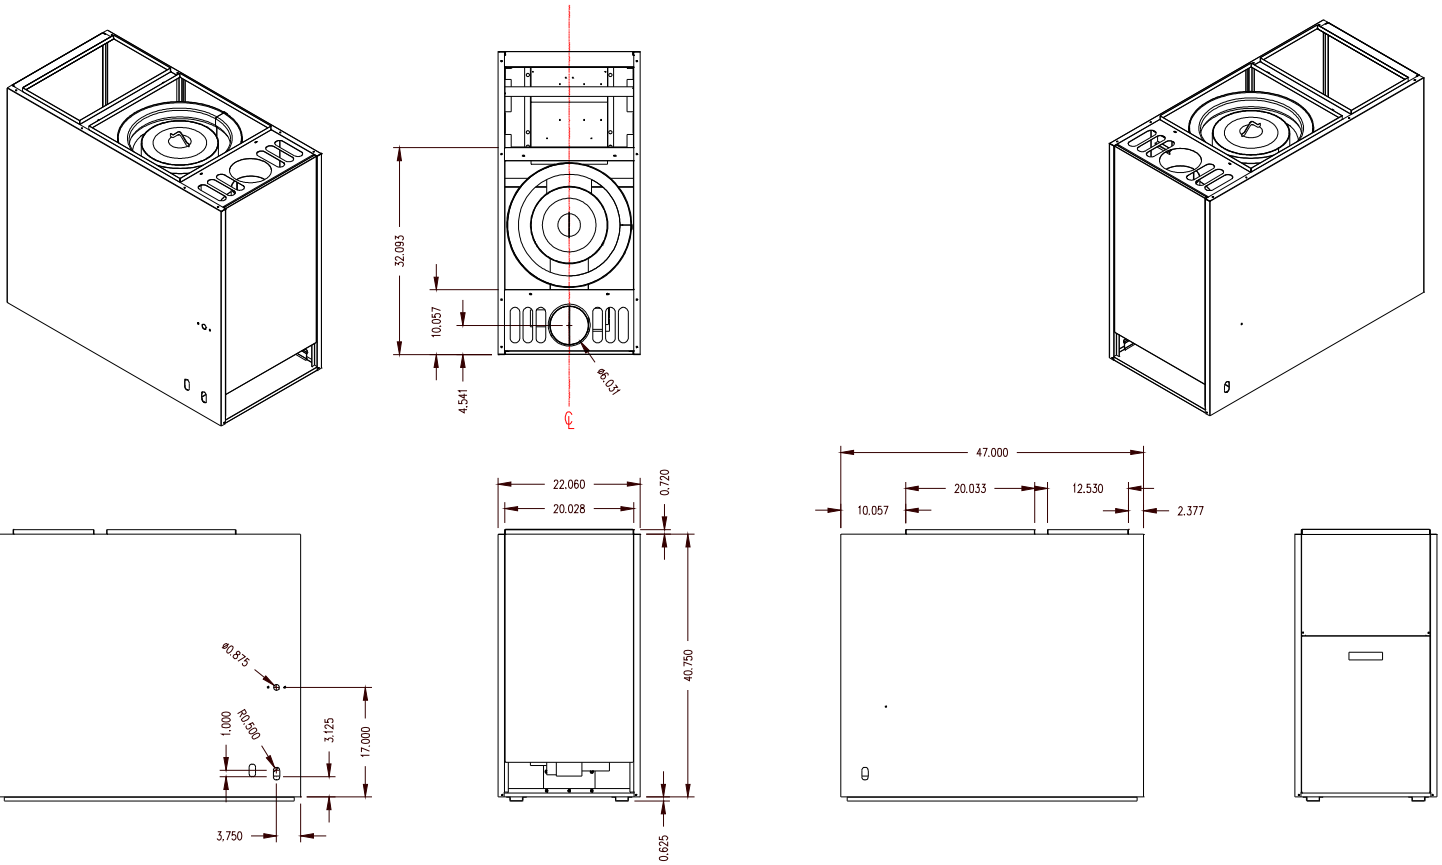


SEE NEXT PAGE FOR MORE DATA-

OIL FIRED LOWBOY REAR FLUE FURNACE SPECIFICATIONS

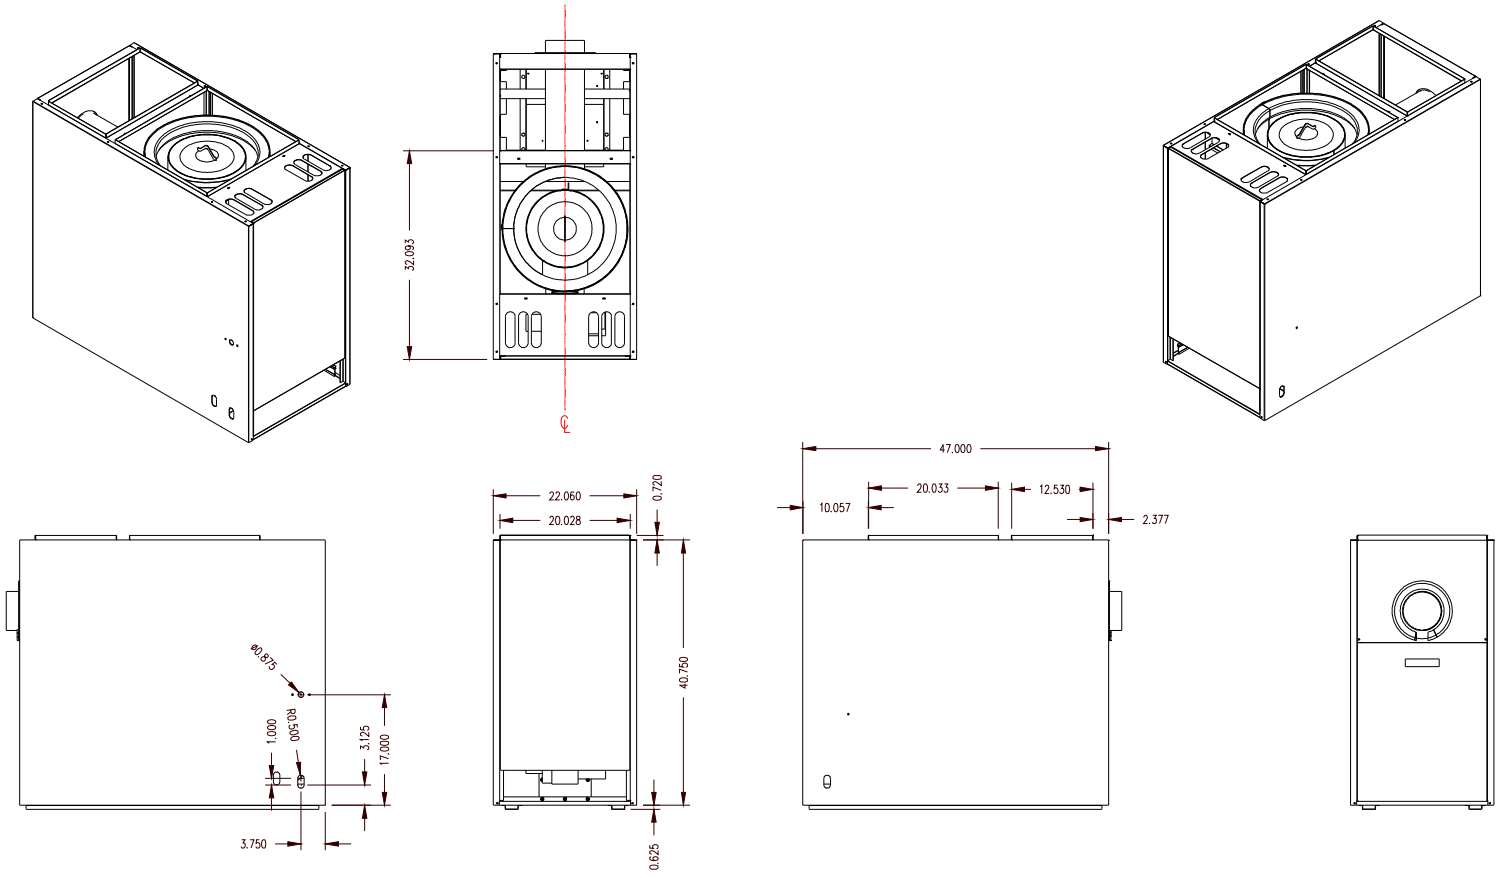


SEE NEXT PAGE FOR MORE DATA-

OIL FIRED HORIZONTAL/COUNTERFLOW FURNACE SPECIFICATIONS

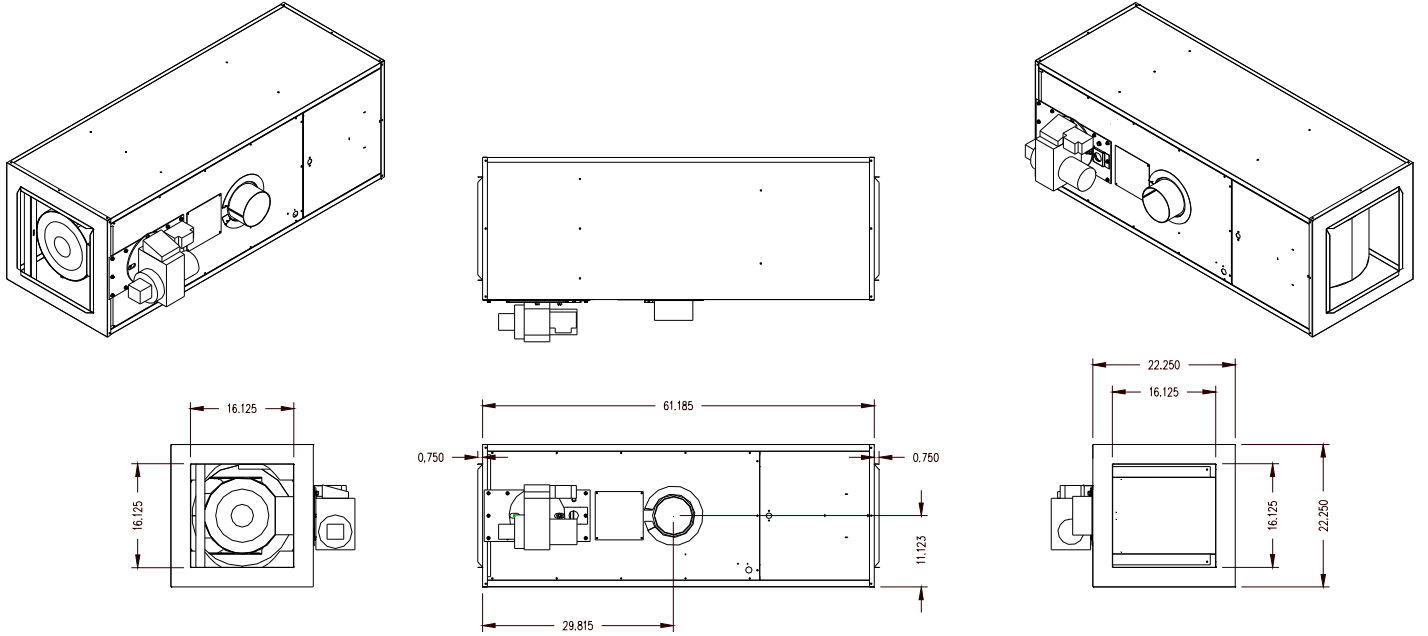

COMBUSTIBLE FLOOR BASE

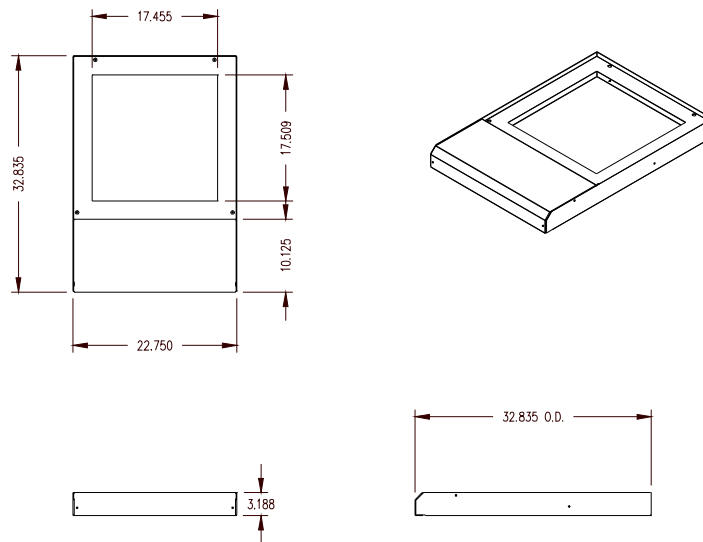

SEE NEXT PAGE FOR MORE DATA-

BLOWER DATA:	VLFF*	VLR*	VC*
BLOWER MODEL DIRECT DRIVE	10-9R		
MOTOR H.P.	½ HP		
MOTOR TYPE & NUMBER OF SPEEDS	Permanent split capacitor, 4		
HIGH SPEED AIRFLOW (SCFM) @ 0.5 IN. W.G. EXTERNAL STATIC PRESSURE:	1400	1400	1350

BLOWER DATA:	VLFF*	VLR*	VC*
OPTIONAL 4TON AIRFLOW KIT			
BLOWER MODEL DIRECT DRIVE	10-9R	10-9R	12-9T
MOTOR H.P.	¾ HP		
MOTOR TYPE & NUMBER OF SPEEDS	Permanent split capacitor, 4		
HIGH SPEED AIRFLOW (SCFM) @ 0.5 IN. W.G. EXTERNAL STATIC PRESSURE:	1564	1538	1648

BURNER DATA	R.W. BECKETT pressure atomizing type, Model AF			
AIR TUBE LENGTH (IN.)	5.875, effective			
BURNER HEAD TYPE:	Fixed, flame retention			
FUEL TYPE:	#2 distillate (domestic heating oil)			
NOZZLE RATING (GPH):	1.0	0.85	0.75	0.6
SPRAY ANGLE (DEG.):	80°			
SPRAY PATTERN:	HOLLOW			
OIL PUMP PRESSURE (PSIG):	130 PSI			
COMBUSTION CHAMBER TYPE:	Preformed, refractory (ceramic fiber matrix material)			

BURNER DATA	R.W. BECKETT pressure atomizing type, Model NX			
AIR TUBE LENGTH (IN.)	5.75, effective			
BURNER HEAD TYPE:	Adjustable			
FUEL TYPE:	#2 distillate (domestic heating oil)			
NOZZLE RATING (GPH):	0.85	0.75	0.65	0.55
SPRAY ANGLE (DEG.):	60°			
SPRAY PATTERN:	Semi Solid (W)			
OIL PUMP PRESSURE (PSIG):	175 PSI			
COMBUSTION CHAMBER TYPE:	Preformed, refractory (ceramic fiber matrix material)			

CLEARANCES	VLFF*	VLR*	VC*
	MINIMUM CLEARANCES TO COMBUSTIBLE MATERIALS:		
SIDES	3"	3"	3"
FRONT (SERVICE ACCESS)	8"	3"	22"
REAR	3"	3"	3"
FLUE	9"	9"	9"
TOP PLENUM	3"	3"	3"
SIDES PLENUM	3"	3"	3"

SEE NEXT PAGE FOR MORE DATA-

VLF*
3 TON Models

ALTERATIONS REQ'D FOR A/C @ DESIGN EXTERNAL STATIC PRESSURE					
COOLING UNIT	Heating Speed by Input				Recommended CLG Speed
	Low Fire	ML Fire	MH Fire	High Fire	
	84,000	105,000	119,000	140,000	
24,000	Low	ML	MH	High	Low
30,000	Low	ML	MH	High	ML
36,000	Low	ML	MH	High	MH
42,000	Low	ML	MH	High	High
48,000					

Speed Tap\ Static Pressure	Furnace Airflow (CFM) vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	999	993	975	956	931	888	807
ML	1173	1156	1134	1108	1082	1043	989
MH	1372	1331	1290	1246	1200	1146	1079
High	1688	1648	1595	1522	1447	1373	1309
	Blower Motor Current Draw (Amps) vs. External Static Pressure (in. WC.)						
Low	5.24	4.96	4.76	4.50	4.30	4.08	3.73
ML	5.95	5.78	5.56	5.33	5.07	4.81	4.54
MH	6.97	6.60	6.28	5.95	5.69	5.40	5.07
High	8.83	8.57	8.33	7.95	7.65	7.36	7.14

SEE NEXT PAGE FOR MORE DATA -

VLF*
3 Ton

Speed Tap\ Static Pressure	High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	106	106	108	110	113	119	131
ML	90	91	93	95	98	101	107
MH	77	79	82	85	88	92	98
High	63	64	66	69	73	77	81

Speed Tap\ Static Pressure	Med-High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	91	91	93	95	97	102	112
ML	77	78	80	82	84	87	92
MH	66	68	70	73	76	79	84
High	54	55	57	60	63	66	69

Speed Tap\ Static Pressure	Med-Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	81	81	83	84	87	91	100
ML	69	70	71	73	74	77	81
MH	59	61	62	65	67	70	75
High	48	49	51	53	56	59	62

Speed Tap\ Static Pressure	Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	65	65	66	68	70	73	80
ML	55	56	57	58	60	62	66
MH	47	49	50	52	54	57	60
High	38	39	41	43	45	47	50



Recommended Operation Range

SEE NEXT PAGE FOR MORE DATA -

VLF*
4 TON Models

ALTERATIONS REQ'D FOR A/C @ DESIGN EXTERNAL STATIC PRESSURE					
COOLING UNIT	Heating Speed by Input				Recommended CLG Speed
	Low Fire	ML Fire	MH Fire	High Fire	
	84,000	105,000	119,000	140,000	
24,000	Low	ML	MH	High	Low
30,000	Low	ML	MH	High	Low
36,000	Low	ML	MH	High	ML
42,000	Low	ML	MH	High	MH
48,000	Low	ML	MH	High	High

Speed Tap\ Static Pressure	Furnace Airflow (CFM) vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	1103	1106	1080	1056	1023	981	858
ML	1358	1339	1309	1264	1216	1167	1098
MH	1620	1572	1511	1443	1376	1311	1224
High	1920	1822	1730	1649	1564	1483	1397
	Blower Motor Current Draw (Amps) vs. External Static Pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	5.39	5.12	4.86	4.64	4.37	4.16	3.70
ML	6.55	6.33	6.04	5.72	5.44	5.11	4.80
MH	7.68	7.24	6.92	6.56	6.21	5.93	5.54
High	11.3	11	10.7	10.5	10.3	10.1	9.98

SEE NEXT PAGE FOR MORE DATA -

VL^F*
4 Ton

Speed Tap\ Static Pressure	High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	96	95	98	100	103	108	123
ML	78	79	81	84	87	90	96
MH	65	67	70	73	77	81	86
High	55	58	61	64	67	71	76

Speed Tap\ Static Pressure	Med-High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	82	82	84	86	89	92	106
ML	67	68	69	72	75	78	83
MH	56	58	60	63	66	69	74
High	47	50	52	55	58	61	65

Speed Tap\ Static Pressure	Med-Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	73	73	75	76	79	82	94
ML	59	60	62	64	66	69	73
MH	50	51	53	56	59	61	66
High	42	44	47	49	52	54	58

Speed Tap\ Static Pressure	Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	59	59	60	61	63	66	76
ML	48	48	50	51	53	56	59
MH	40	41	43	45	47	49	53
High	34	36	37	39	41	44	46



Recommended Operation Range

SEE NEXT PAGE FOR MORE DATA –

VLR*
3 TON Models

ALTERATIONS REQ'D FOR A/C @ DESIGN EXTERNAL STATIC PRESSURE					
COOLING UNIT	Heating Speed by Input				Recommended CLG Speed
	Low Fire	ML Fire	MH Fire	High Fire	
	84,000	105,000	119,000	140,000	
24,000	Low	ML	MH	High	Low
30,000	Low	ML	MH	High	ML
36,000	Low	ML	MH	High	MH
42,000	Low	ML	MH	High	High
48,000					

Speed Tap \ Static Pressure	Furnace Airflow (CFM) vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	1007	1004	985	963	915	845	749
ML	1196	1184	1149	1111	1066	1023	938
MH	1410	1345	1299	1246	1184	1127	1171
High	1669	1599	1541	1475	1409	1329	1231
	Blower Motor Current Draw (Amps) vs. External Static Pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	5.04	4.91	4.71	4.51	4.23	3.98	3.64
ML	5.93	5.74	5.49	5.22	4.91	4.7	4.39
MH	6.88	6.46	6.15	5.84	5.48	5.24	4.96
High	8.46	8.14	7.9	7.64	7.42	7.17	6.88

SEE NEXT PAGE FOR MORE DATA –

VLR*
3 Ton

Speed Tap\ Static Pressure	High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	105	105	107	110	115	125	141
ML	88	89	92	95	99	103	113
MH	75	78	81	85	89	94	90
High	63	66	68	72	75	79	86

Speed Tap\ Static Pressure	Med-High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	90	90	92	94	99	107	121
ML	76	77	79	82	85	89	97
MH	64	67	70	73	77	81	77
High	54	57	59	62	64	68	74

Speed Tap\ Static Pressure	Med-Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	80	80	82	84	88	95	108
ML	67	68	70	73	76	79	86
MH	57	60	62	65	68	71	69
High	48	50	52	55	57	61	65

Speed Tap\ Static Pressure	Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	64	65	66	67	71	77	87
ML	54	55	56	58	61	63	69
MH	46	48	50	52	55	58	55
High	39	41	42	44	46	49	53



Recommended Operation Range

SEE NEXT PAGE FOR MORE DATA –

VLR*
4 TON Models

ALTERATIONS REQ'D FOR A/C @ DESIGN EXTERNAL STATIC PRESSURE					
COOLING UNIT	Heating Speed by Input				Recommended CLG Speed
	Low Fire	ML Fire	MH Fire	High Fire	
	84,000	105,000	119,000	140,000	
24,000	Low	ML	MH	High	Low
30,000	Low	ML	MH	High	Low
36,000	Low	ML	MH	High	ML
42,000	Low	ML	MH	High	MH
48,000	Low	ML	MH	High	High

Speed Tap\ Static Pressure	Furnace Airflow (CFM) vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	1110	1107	1091	1068	1031	973	887
ML	1366	1330	1303	1247	1187	1124	1046
MH	1622	1545	1484	1419	1356	1274	1172
High	1844	1771	1694	1612	1538	1451	1355
	Blower Motor Current Draw (Amps) vs. External Static Pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	5.34	5.2	4.95	4.76	4.5	4.19	3.86
ML	6.33	6.15	5.86	5.48	5.18	4.83	4.57
MH	7.61	7.11	6.72	6.34	6.08	5.74	5.36
High	11	10.8	10.6	10.4	10.2	10	9.9

SEE NEXT PAGE FOR MORE DATA –

VLR*
4 Ton

Speed Tap\ Static Pressure	High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	95	95	97	99	102	108	119
ML	77	79	81	85	89	94	101
MH	65	68	71	74	78	83	90
High	57	60	62	65	69	73	78

Speed Tap\ Static Pressure	Med-High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	82	82	83	85	88	93	102
ML	66	68	70	73	76	81	87
MH	56	59	61	64	67	71	77
High	49	51	54	56	59	63	67

Speed Tap\ Static Pressure	Med-Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	73	73	74	75	78	83	91
ML	59	61	62	65	68	72	77
MH	50	52	54	57	59	63	69
High	44	45	48	50	52	56	59

Speed Tap\ Static Pressure	Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	58	59	59	61	63	67	73
ML	47	49	50	52	55	58	62
MH	40	42	44	46	48	51	55
High	35	37	38	40	42	45	48



Recommended Operation Range

SEE NEXT PAGE FOR MORE DATA –

VC*
3 TON

ALTERATIONS REQ'D FOR A/C @ DESIGN EXTERNAL STATIC PRESSURE					
COOLING UNIT	Heating Speed by Input				Recommended CLG Speed
	Low Fire	ML Fire	MH Fire	High Fire	
	80,000	105,000	119,000	140,000	
24,000	Low	ML	MH	High	Low
30,000	Low	ML	MH	High	Low
36,000	Low	ML	MH	High	MH
42,000					
48,000					

Speed Tap\ Static Pressure	Furnace Airflow (CFM) vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	1166	1139	1107	1064	1017	955	871
ML	1320	1274	1228	1176	1111	1043	950
MH	1447	1397	1343	1284	1209	1127	1043
High	1616	1550	1482	1406	1347	1231	1144
	Blower Motor Current Draw (Amps) vs. External Static Pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	4.66	4.43	4.24	4.00	3.78	3.56	3.29
ML	5.19	4.87	4.63	4.39	4.14	3.91	3.65
MH	5.70	5.41	5.17	4.88	4.64	4.40	4.17
High	7.15	6.92	6.72	6.52	6.36	6.09	5.93

SEE NEXT PAGE FOR MORE DATA –

VC*
3 Ton

Speed Tap\ Static Pressure	High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	91	93	95	99	104	111	121
ML	80	83	86	90	95	101	111
MH	73	76	79	82	87	94	101
High	65	68	71	75	78	86	92

Speed Tap\ Static Pressure	Med-High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	78	80	82	85	89	95	104
ML	69	71	74	77	82	87	96
MH	63	65	68	71	75	81	87
High	56	59	61	65	67	74	79

Speed Tap\ Static Pressure	Med-Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	69	71	73	76	79	84	92
ML	61	63	66	68	73	77	85
MH	56	58	60	63	67	71	77
High	50	52	54	57	60	65	70

Speed Tap\ Static Pressure	Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	56	57	59	61	64	68	74
ML	49	51	53	55	58	62	68
MH	45	46	48	50	54	58	62
High	40	42	44	46	48	53	57

Recommended Operation Range

SEE NEXT PAGE FOR MORE DATA –

VC*
4 TON

ALTERATIONS REQ'D FOR A/C @ DESIGN EXTERNAL STATIC PRESSURE					
COOLING UNIT	Heating Speed by Input				Recommended CLG Speed
	Low Fire	ML Fire	MH Fire	High Fire	
	84,000	105,000	119,000	140,000	
24,000	Low	ML	MH	High	Low
30,000	Low	ML	MH	High	Low
36,000	Low	ML	MH	High	ML
42,000	Low	ML	MH	High	MH
48,000	Low	ML	MH	High	High

Speed Tap\ Static Pressure	Furnace Airflow (CFM) vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	1116	1105	1084	1058	1038	1001	955
ML	1355	1342	1311	1273	1230	1183	1133
MH	1615	1572	1521	1468	1412	1355	1308
High	1901	1837	1790	1714	1648	1584	1496
	Blower Motor Current Draw (Amps) vs. External Static Pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	5.21	5.05	4.91	4.73	4.62	4.40	4.18
ML	6.29	6.07	5.88	5.69	5.48	5.21	5.01
MH	7.47	7.18	6.93	6.63	6.33	6.15	5.92
High	11.1	11.0	10.8	10.6	10.5	10.4	10.1

SEE NEXT PAGE FOR MORE DATA –

VC*
4 Ton

Speed Tap\ Static Pressure	High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	95	96	97	100	102	105	111
ML	78	79	81	83	86	89	93
MH	65	67	69	72	75	78	81
High	56	57	59	62	64	67	71

Speed Tap\ Static Pressure	Med-High Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	81	82	84	86	87	91	95
ML	67	68	69	71	74	77	80
MH	56	58	60	62	64	67	69
High	48	49	51	53	55	57	61

Speed Tap\ Static Pressure	Med-Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	72	73	74	76	78	80	84
ML	59	60	61	63	65	68	71
MH	50	51	53	55	57	59	62
High	42	44	45	47	49	51	54

Speed Tap\ Static Pressure	Low Fire Temperature Rise vs. External Static pressure (in. WC.)						
	0.1	0.2	0.3	0.4	0.5	0.6	0.7
Low	58	59	60	61	62	65	68
ML	48	48	49	51	53	55	57
MH	40	41	43	44	46	48	50
High	34	35	36	38	39	41	43



Recommended Operation Range