




Product Data

38AYC (60 Hz) 11 SEER Heat Pump

Sizes 018 thru 060

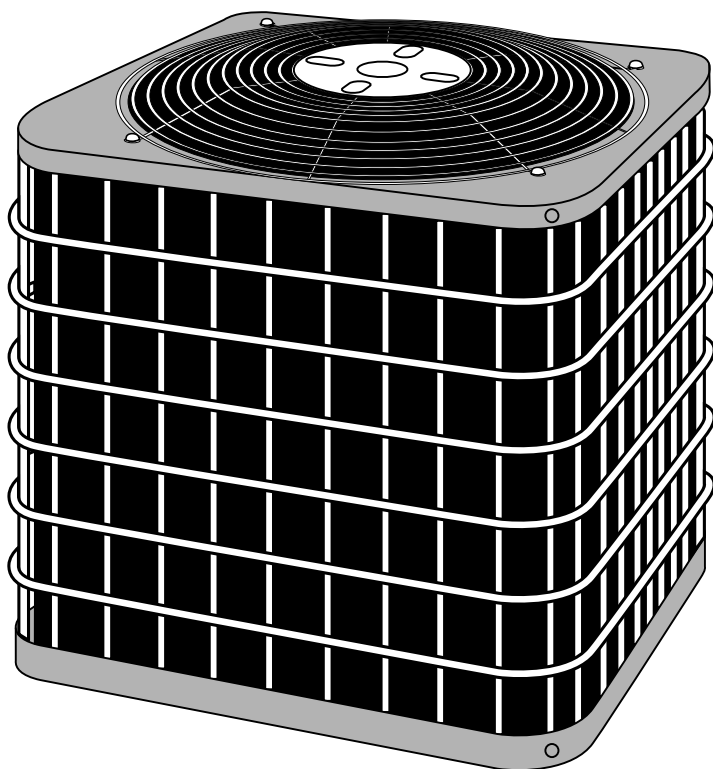

The 38AYC Split-System Heat Pumps are designed for quiet, reliable heating and cooling. With SEER ratings from 11.0 to 12.5 and HSPF ratings from 7.0 to 8.3, these heat pump systems provide efficient operation. These units provide heat during the winter months by transferring heat from the outdoors. They then reverse this process during the summer months to reliably provide cooling and dehumidification. All models are listed with UL, (U.S. and Canada), CEC and ARI.

AVAILABLE OPTIONS

Electrical Range — All units are offered in single phase 208–230v.

Size Range — 38AYC is available in 7 nominal sizes from 018 through 060 to meet the needs of residential and light commercial applications.

Compressor — This unit features a scroll compressor which is significantly more efficient than conventional compressors. Its simple design offers improved reliability. Each compressor is mounted on rubber isolators for additional sound reduction. For improved serviceability, all models are equipped with a compressor terminal plug. Continuous operation is approved down to -30°F (-34.4°C) in the heating mode and down to 55°F (12.8°C) in the cooling mode. (See heating and cooling performance tables.)

Built-in-Reliable Components — Includes a suction-tube accumulator that reduces the amount of liquid refrigerant that reaches the compressor, a loss of charge switch, and an internal pressure relief valve (except 018–024 sizes) for high-pressure protection.

Defrost Control Board — Incorporates a defrost relay, defrost timer, and low-voltage terminations. The defrost control is a time/temperature initiation/termination control which includes 3 field-selectable time periods of 30, 50, and 90 minutes.

Discharge Muffler — Incorporated to minimize low frequency sound and pressure pulsation generated by compressor discharge gas.

Cabinet Protection — Steel is protected with a galvanized coating and treated with a layer of zinc phosphate. A coat of modified polyester powder coating is then applied and baked on, providing each

unit with a hard, smooth finish that will last for many years.

All screws on cabinet exterior are coated for a long-lasting, rust-resistant, quality appearance.


Unit Design — All units are equipped with totally enclosed fan motors for greater reliability under rain and snow conditions. The large, wraparound coil uses copper tube and enhanced aluminum fin and is designed for optimum heat transfer during heating and cooling. The vertical air discharge carries the sound and air up and away from adjacent patio areas and foliage. The condenser coil can be cleaned with a common garden hose.

Stabilizer Top — Outlet grille incorporates stabilizing technology that provides smooth, sturdy operation.

External Service Valves — Both service valves are brass, front seating type. The 38AYC has sweat field connections. Valves are externally located so refrigerant tube connections can be made quickly and easily. Each valve has a service port for ease of checking operating refrigerant pressures.

Limited Warranty — Standard 5-year limited warranty on parts, and a 5-year limited warranty on the compressor.

Model number nomenclature

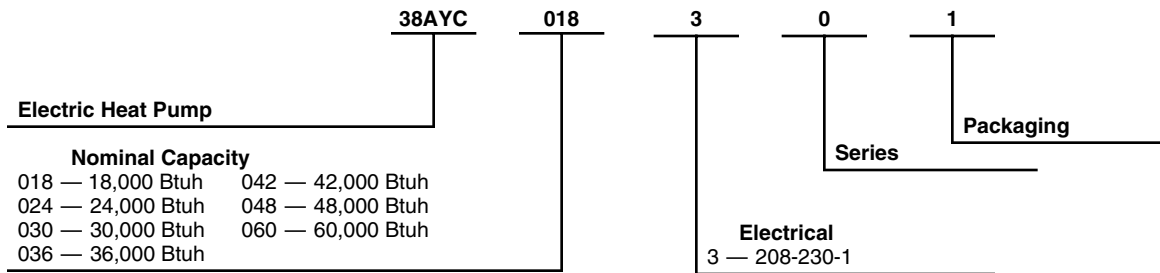



APPROVALS
 ISO 9001
 EN 29001
 BS 5750 PART 1
 ANSI/ASQC Q91

CERTIFICATION APPLIES ONLY
 WHEN THE COMPLETE SYSTEM
 IS LISTED WITH ARI.

REGISTERED QUALITY SYSTEM

Physical data

UNIT SIZE	018	024	030	036	042	048	060
OPERATING WT (Lb)	115	166	188	208	209	250	278
COMPRESSOR Type	Scroll						
REFRIGERANT Control Charge (Lb) @ 15 Ft	5.5	5.63	7.88	R-22 Piston 9.88	10.63	11.13	14.0
CONDENSER FAN Air Discharge Air Qty (CFM) Motor HP Motor RPM (60 Hz)	Propeller Type, Direct Drive Vertical						
	1700 1/12 1100			3000 1/8 825			3300 1/4 1125
CONDENSER COIL Face Area (Sq Ft) Fins per In. Rows Circuits	12.4 20 1 2	14.93 20 1 3	22.40	16.18 20 2 4	18.67 20 2 5	22.40 20 2 6	
VALVE CONNECTION (In. ID) Vapor Liquid	5/8		3/4	Sweat 3/8		7/8	
REFRIGERANT TUBES* (In. OD) Vapor Liquid	5/8		3/4	3/8	7/8		1-1/8

* Tube sizes are for runs up to 50 ft. For tube set over 50 ft horizontal or 20 ft vertical differential, consult Residential Split Systems Long-Line Application Guideline.

NOTE: See unit Installation Instructions for proper installation.

METERING DEVICE

UNIT SIZE	SERIES	OUTDOOR PISTON	INDOOR PISTON
018	33, 34	42	52
024	33, 34	49	59
030	33, 34	55	63
036	33, 34	63	78
042	33, 34	65	78
048	33, 34	73	90
060	33, 34	78	101

Accessories

ORDERING NUMBER	DESCRIPTION
KAATD0101TDR	Time-Delay Relay — All Sizes
KSALA0401AAA‡	MotorMaster®—Low-Ambient Controller — All Sizes
HC34GE232	Ball Bearing Fan Motor — Size 018
HC38GE231	Ball Bearing Fan Motor — Sizes 024–048
HC40GE232	Ball Bearing Fan Motor — Size 060
KSALA0201R22	Low-Ambient Pressure Switch — All Sizes
KAFT0101AAA†	Evaporator Freeze Thermostat — All Sizes
KHAIR0101AAA†	Isolation Relay — All Sizes
KSAHS1501AAA	Compressor Start Assist-Capacitor/Relay — Sizes 018–036
KSAHS1701AAA	Compressor Start Assist-Capacitor/Relay — Sizes 042, 048
KSAHS1601AAA	Compressor Start Assist-Capacitor/Relay — Size 060
KAACS0201PTC	Compressor Start Assist-PTC — All Sizes
KAACH1401AAA	Crankcase Heater — Sizes 018–024
KAACH1201AAA	Crankcase Heater — Sizes 030–048
Standard	Crankcase Heater — Size 060
KSASH1801COP	Sound Hood — Sizes 018–030
KSASH0601COP	Sound Hood — Sizes 036, 042
KSASH2101COP	Sound Hood — Sizes 048, 060
KHAOT0301FST	Outdoor Thermostat — All Sizes
KHAOT0201SEC	Secondary Outdoor Thermostat — All Sizes
KSATX0601HSO	Thermostatic Expansion Valve (Hard Shutoff) — Sizes 018–042
KSATX0701HSO	Thermostatic Expansion Valve (Hard Shutoff) — Size 048
KSATX1001HSO	Thermostatic Expansion Valve (Hard Shutoff) — Size 060
KHATX0201RPB	Thermostatic Expansion Valve (RPB) — Size 018
KHATX0301RPB	Thermostatic Expansion Valve (RPB) — Size 024
KHATX0401RPB	Thermostatic Expansion Valve (RPB) — Size 030
KHATX0501RPB	Thermostatic Expansion Valve (RPB) — Sizes 036, 042
KHATX0601RPB	Thermostatic Expansion Valve (RPB) — Size 048
KHATX0701RPB	Thermostatic Expansion Valve (RPB) — Size 060
Standard	Low-Pressure Switch — All Sizes
KSAHI0101HPS	High-Pressure Switch — All Sizes
P504-8083S (RCD)	Filter Drier (Bi-flow) — Sizes 018–036
P504-8163S (RCD)	Filter Drier (Bi-flow) — Sizes 042–060
KHALS0401LLS	Liquid Solenoid Valve (LSV) — All Sizes
KAACF1001MED	Coastal Filter Kit — Size 018
KAACF1101LRG	Coastal Filter Kit — Sizes 024–060

* Isolation relay required.

† Use with MotorMaster®—Low-Ambient Controller.

‡ Fan motor with ball bearings required.

THERMOSTAT PKG	DESCRIPTION
TSTATCCPRH01-B	Thermidistat™ Control — Programmable Thermostat with Humidity Control
TSTATCCPDF01-B	Thermostat — Auto Changeover, 7-Day Programmable, °F/°C, Dual Fuel Must be used with Outdoor Sensor (TSTATXXSEN01-B). High-pressure switch must be added if not supplied with the system.
TSTATCCPHP01-B	Thermostat — Auto Changeover, 7-Day Programmable, °F/°C, 2-Stage Heat, 1-Stage Cool
TSTATCCNHP01-B	Thermostat — Auto Changeover, Non-Programmable, °F/°C, 2-Stage Heat, 1-Stage Cool
TSTATCCBHP01-B	Builder's Thermostat — Manual Changeover, Non-Programmable, °F, 2-Stage Heat, 1-Stage Cool
TSTATXXSEN01-B	Outdoor Air Temperature Sensor
TSTATXXNBP01	Backplate for Non-Programmable Thermostat
TSTATXXBP01	Backplate for Programmable Thermostat
TSTATXXCNV10	Thermostat Conversion Kit (4 to 5 Wire) — 10 Pack
TSTATXXBBP01	Backplate for Builder's Thermostat

Accessory usage guideline

ACCESSORY	REQUIRED FOR LOW-AMBIENT APPLICATIONS (Below 55°F)	REQUIRED FOR LONG-LINE APPLICATIONS* (Over 50 Ft)	REQUIRED FOR SEA COAST APPLICATIONS* (Within 2 Miles)
Crankcase Heater	Yes	Yes	No
Evaporator Freeze Thermostat	Yes	No	No
Accumulator	No	No	No
Compressor Start Assist Capacitor and Relay	Yes	Yes	No
MotorMaster®—Low-Ambient Controller or Low-Ambient Pressure Switch	Yes	No	No
Wind Baffle	See Low-Ambient Instructions	No	No
Coastal Filter	No	No	Yes
Support Feet	Recommended	No	Recommended
Liquid-Line Solenoid Valve or Hard Shutoff TXV	No	See Long-Line Application Guideline	No
Ball Bearing Fan Motor	Yes	No	No

* For tubing line sets between 50 and 175 ft horizontal or 20 ft vertical differential, refer to Residential Split Systems Long-Line Application Guideline.

Accessory description and usage (Listed alphabetically)

1. Ball-Bearing Fan Motor

A fan motor with ball bearings which permits speed reduction while maintaining bearing lubrication.

Usage Guideline:

Required on all units when MotorMaster®—Low-Ambient Controller is installed.

2. Coastal Filter

A mesh screen inserted under the top cover and inside the base pan to protect the condenser coil from salt damage without restricting airflow.

3. Compressor Start Assist – Capacitor and Relay

Start capacitor and relay gives a "hard" boost to compressor motor at each start up.

Usage Guideline:

Required for single-phase reciprocating compressors in the following applications:

- Long line
- Low ambient cooling
- Hard shut off expansion valve on indoor coil
- Liquid line solenoid on indoor coil

Required for single-phase scroll compressors in the following applications:

- Long line
- Low ambient cooling

Suggested for all compressors in areas with a history of low voltage problems

4. Compressor Start Assist – PTC Type

Solid-state electrical device which gives a "soft" boost to the compressor motor at each start up.

Usage Guideline:

Suggested when compressor power supply is marginal.

Suggested in reciprocating compressor applications with rapid pressure balance (RPB) expansion valve on indoor coil.

5. Crankcase Heater

An electric resistance heater which mounts to the base of the compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Note: Some heat pumps are factory supplied with a crankcase heater. See accessory list for units that come standard with a crankcase heater. For units that do not, use the guideline below.

Usage Guideline:

- Required in low ambient cooling applications.
- Required in long line applications.
- Suggested in all commercial applications.

6. Evaporator Freeze Thermostat

An SPST temperature-actuated switch that stops unit operation when evaporator reaches freeze-up conditions.

Usage Guideline:

Required when low-ambient kit has been added.

7. Filter Drier

A device for removing contaminants from refrigerant circulating in a heat pump system: two-direction flow.

Usage Guideline:

Suggested in all field-connected split-system heat pumps.

8. High-Pressure Switch

Auto reset SPST switch activated by refrigerant pressure on high side of refrigerant circuit. Cycles compressor off if refrigerant pressure rises to 426 ± 10 psig and resets at 320 ± 20 psig. Provides protection against compressor damage due to loss of outdoor airflow.

Usage Guideline:

- Suggested in installations exposed to "very dirty" outdoor air.
- Suggested in installations where condenser inlet air temperature exceeds 125°F (51.7°C).

9. Isolation Relay

An SPDT relay which switches the low-ambient controller out of the outdoor fan motor circuit when the heat pump switches to heating mode.

Usage Guideline:

Required in all heat pumps where low-ambient kit has been added.

Accessory description and usage (Listed alphabetically)

10. Liquid-Line Solenoid Valve (LLS)

An electrically operated shutoff valve which stops and starts refrigerant liquid flow in response to compressor operation. It maintains a column of refrigerant liquid ready for action at next compressor operation cycle. It also provides system protection against off-cycle refrigerant migration.

Note: When LLS is used with reciprocating compressors, Compressor Start Assist — Capacitor and Relay is required.

Usage Guideline:

Required in all heat pump long line applications to control refrigerant off cycle migration in the heating mode. A second LLS or hard shut off TXV is required in heat pump long line applications for refrigerant off cycle migration in the cooling mode. See Long Line Application Guide-line.

11. Low-Ambient Pressure Switch

A long life pressure switch which is mounted to outdoor unit service valve. It is designed to cycle the outdoor fan motor in order to maintain head pressure within normal operating limits (approximately 100 psig to 225 psig). The control will maintain working head pressure at low-ambient temperatures down to 0°F (-17.8°C) when properly installed.

Usage Guideline:

A Low-Ambient Pressure Switch or MotorMaster®—Low-Ambient Controller must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

12. MotorMaster®—Low-Ambient Controller

A fan speed control device activated by a temperature sensor. Designed to control condenser fan motor speed in response to the saturated, condensing temperature during operation in cooling mode only. For outdoor temperatures down to -20°F (-28.9°C), it maintains condensing temperature at 100°F ± 10°F (37.8°C ± 12°C).

Usage Guideline:

A MotorMaster®—Low-Ambient Controller or Low-Ambient Pressure Switch must be used when cooling operation is used at outdoor temperatures below 55°F (12.8°C).

Suggested for all commercial applications.

13. Outdoor Air Temperature Sensor

Designed for use with Carrier Thermostats listed in this publication. This device enables the thermostat to display the outdoor temperature. This device also is required to enable special thermostat features such as auxiliary heat lock out.

Usage Guideline:

Suggested for all Carrier thermostats listed in this publication.

14. Outdoor Thermostat

An SPDT temperature-actuated switch which turns on supplemental electric heaters when outdoor air temperature drops below a user-selected set point.

Usage Guideline:

Electric supplemental heat applications in non-variable speed indoor units when electric heat staging is desired.

15. Secondary Outdoor Thermostat

An SPDT temperature-actuated switch which turns on third-stage of supplemental electric heaters when outdoor air temperature drops below the second-stage set point.

Usage Guideline:

Outdoor Thermostat applications where electric heater is capable of 3-stage operation.

16. Sound Hood

Wraparound sound reducing cover for the compressor. Reduces the sound level by about 2 dBA.

Usage Guideline:

Suggested when unit is installed closer than 15 ft to quiet areas—bedrooms, etc.

Suggested when unit is installed between two houses less than 10 ft apart.

17. Thermostatic Expansion Valve (TXV) Bi-Flow

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator. Kit includes valve, adapter tubes, and external equalizer tube. Both hard shutoff and RPB valves are available.

Note: When using a hard shut off TXV with single phase reciprocating compressors, a Compressor Start Assist — Capacitor and Relay is required

Usage Guideline:

Required to achieve ARI ratings in certain equipment combinations. Refer to combination ratings.

Required for use on all zoning systems.

See long line guideline.

18. Time-Delay Relay

An SPST delay relay which briefly continues operation of indoor blower motor to provide additional cooling after the compressor cycles off.

Note: Most indoor unit controls include this feature. For those that do not, use the guideline below.

Usage Guideline:

For improved efficiency ratings for certain combinations of indoor and outdoor units. Refer to ARI Unitary Directory.

Electrical data

UNIT SIZE	VOLTS/PH 60 HZ	OPER VOLTS*		COMPRESSOR		FAN FLA	MCA	MIN WIRE SIZE 60°C/75°C**	MAX LENGTH (FT) 60°C/75°C‡	MAX FUSE† OR CKT BKR AMPS
		Max	Min	LRA	RLA					
018	208-230/1	253	197	45.0	10.6	0.5	13.8	14/14	71/67	20
024				54.0	12.0	1.1	16.1	14/14	60/57	25
030				73.0	16.6	1.1	21.9	12/12	71/67	30
036				93.0	18.5	1.1	24.2	12/12	64/61	35
042				103.0	21.6	1.1	28.1	10/10	88/83	40
048				137.0	23.9	1.1	31.0	8/10	124/76	45
060				148.0	32.1	1.4	41.5	6/8	156/88	60

* Permissible limits of the voltage range at which unit will operate satisfactorily. Operation outside these limits may result in unit failure.

† Time-delay fuse.

‡ Length shown is as measured 1 way along the wire path between the unit and the service panel for voltage drop not to exceed 2%.

** If wire is applied at ambient greater than 30°C (86°F), consult Table 310-16 of the NEC (ANSI/NFPA 70). The ampacity of nonmetallic-sheathed cable (NM), trade name ROMEX, shall be that of 60°C (140°F) conductors, per the NEC (ANSI/NFPA 70) Article 336-26. If other than uncoated (non-plated), 60° or 75°C (140° or 167°F) insulation, copper wire (solid wire for 10 AWG and smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the NEC (ANSI/NFPA 70).

FLA — Full Load Amps

LRA — Locked Rotor Amps

MCA — Minimum Circuit Amps

RLA — Rated Load Amps



NOTE: Control circuit is 24v on all units and requires external power source. Copper wire must be used from service disconnect to unit. All motors/compressors contain internal overload protection.

A-weighted sound power (dBA)

UNIT SIZE-SERIES	STANDARD RATING	TYPICAL OCTAVE BAND SPECTRUM (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
018-33, 34	78	64.4	67.7	71.8	73.8	69.4	66.8	63.5
024-33, 34	78	57.5	63.6	69.4	74.2	66.9	63.6	61.3
030-33, 34	78	56.7	59.3	67.8	74.4	67.4	65.6	64.5
036-33, 34	78	55.5	60.0	66.5	73.5	73.0	67.5	59.0
042-33, 34	79	53.5	59.5	67.5	75.5	71.5	65.5	61.0
048-33, 34	78	62.9	61.4	68.3	73.3	71.2	66.8	61.5
060-33, 34	80	64.9	63.4	70.3	75.3	73.2	68.8	63.5

NOTE: Tested in accordance with ARI Standard 270-95. (Not listed with ARI.)

Dimensions

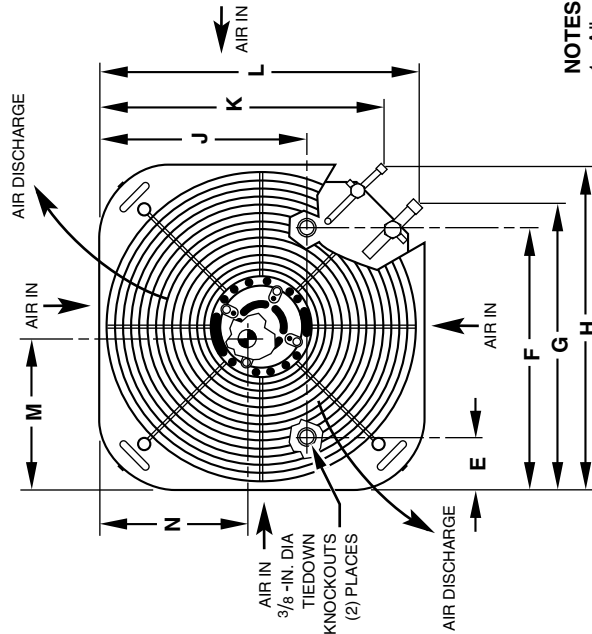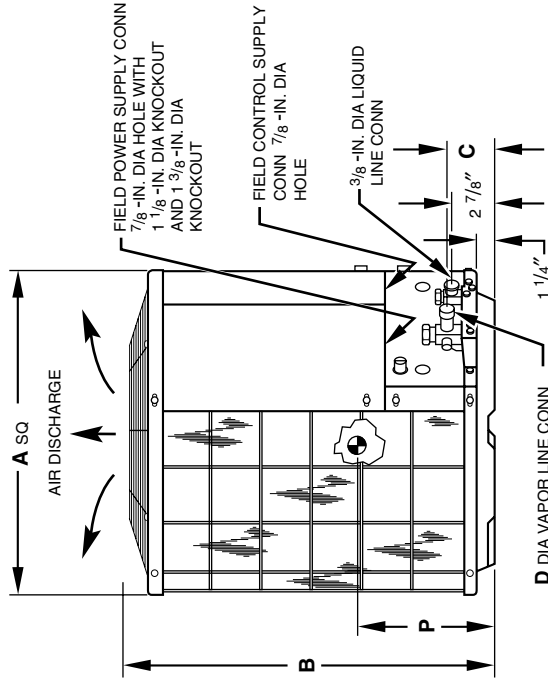

NOTES:

1. Allow 30 in. clearance to service side of unit, 48 in. above unit, 6 in. on one side, 12 in. on remaining side, and 24 in. between units for proper airflow.
2. Minimum outdoor operating ambient in cooling mode is 55°F (unless low ambient control is used) max. 125°F.
3. Maximum outdoor operating ambient in heating mode is 66°F.
4. Series designation is the 13th position of the unit model number.
5. Center of gravity \ominus .


A97045

DIMENSIONS (IN.)

UNIT SIZE	SERIES	A	B	C	D	E	F	G	H	J	K	L	M	N	P	MINIMUM MOUNTING PAD DIMENSIONS
018	33, 34	22-1/2	33-15/16	3-3/16	5/8	3-11/16	18-1/8	19-3/4	21-5/8	14-3/8	18-7/8	22-1/16	10-3/4	11	14-1/4	22-1/2 x 22-1/2
024	33, 34	30	27-15/16	3-3/16	3/4	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	15	11-3/4	30 x 30
030	33, 34	30	39-15/16	3-3/16	3/4	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-3/4	14-3/4	16-3/4	30 x 30
036	33, 34	30	29-15/16	3-3/16	3/4	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	14-1/4	15	14	30 x 30
042	33, 34	30	29-15/16	3-1/4	7/8	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	14-3/4	14-1/4	30 x 30
048	33, 34	30	33-15/16	3-1/4	7/8	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	15-1/2	14-1/4	14-1/2	30 x 30
060	33, 34	30	39-15/16	3-1/4	7/8	6-1/2	23-1/2	27-1/4	29-1/8	20	26-3/8	29-9/16	14-3/4	13-1/2	15-1/2	30 x 30

38AYC BALANCE POINT WORKSHEET

BUILDING HEAT LOSS, 1000 BTU/HR
UNIT INTEGRATED HEATING CAPACITY, 1000 BTU/HR

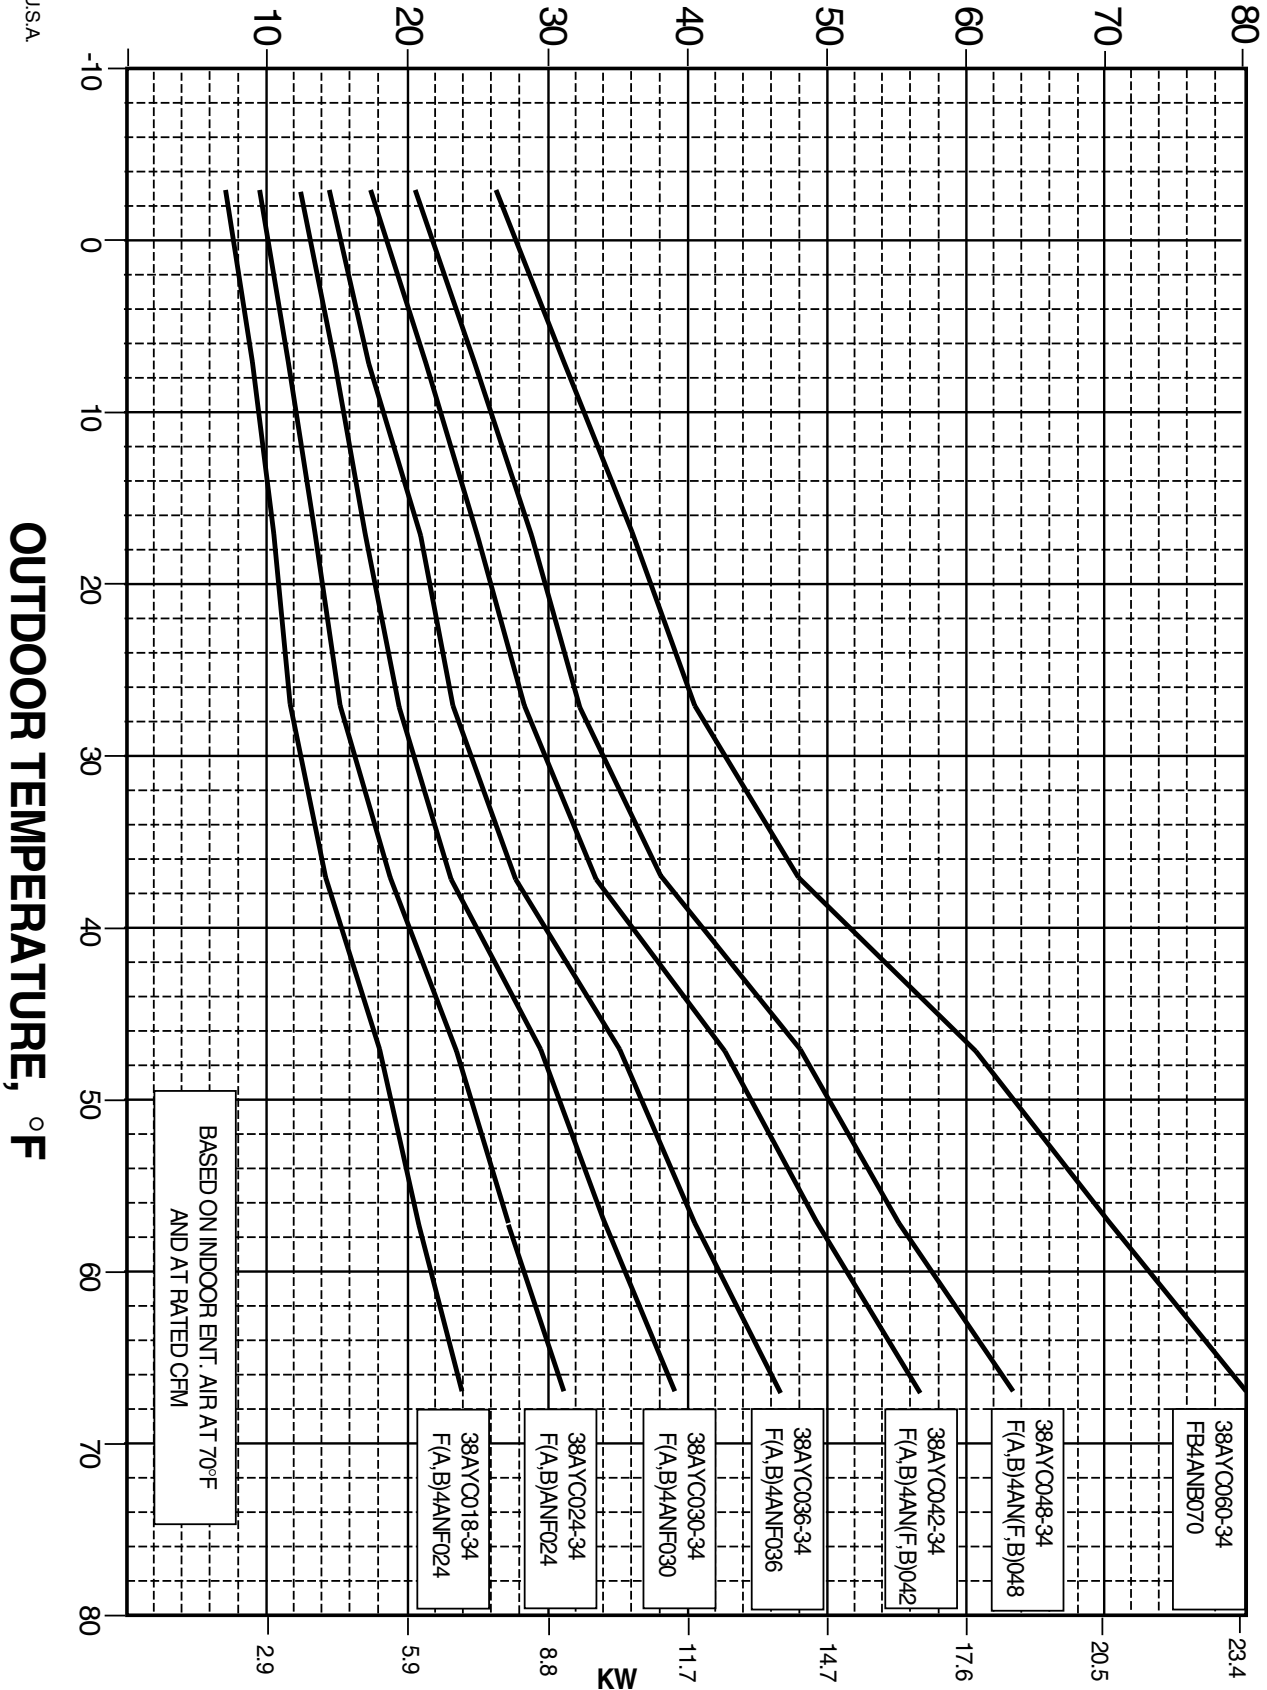

Combination ratings*

UNIT SIZE-SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER				EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF	
			Factory-Supplied Enhancement	Standard Rating	Carrier Furnace or Accessory TDR‡	Accessory TXV**		CAP	COP	CAP	COP		
018-33, 34	*F(A,B)4BN(F,C)024	18,000	TDR	11.00	—	11.00	10.70	17,500	3.28	11,300	2.30	7.4	
	CC5A/CD5AA018	18,000	NONE	—	10.50	10.50	10.30	17,200	2.96	11,200	2.16	7.0	
	CC5A/CD5AA024	18,000	NONE	—	11.00	11.00	10.50	17,400	3.12	11,300	2.24	7.2	
	CC5A/CD5AW024	18,000	NONE	—	11.00	11.00	10.50	17,400	3.12	11,300	2.24	7.2	
	CE3AA024	18,000	NONE	—	11.00	11.00	10.60	17,400	3.18	11,300	2.26	7.2	
	CF5AA024	18,000	NONE	—	11.00	11.00	10.55	17,500	3.18	11,300	2.26	7.2	
	CK3BA024	18,000	NONE	—	11.00	11.00	10.65	17,600	3.30	11,300	2.32	7.2	
	CK5A/CK5BA018	18,000	NONE	—	10.50	10.50	10.45	17,400	3.16	11,300	2.26	7.0	
	CK5A/CK5BA024	18,000	NONE	—	11.00	11.00	10.65	17,600	3.30	11,300	2.32	7.2	
	CK5A/CK5BW024	18,000	NONE	—	11.00	11.00	10.65	17,600	3.30	11,300	2.32	7.2	
	F(A,B)4BN(F,C)018	17,300	TDR	10.50	—	10.50	10.35	17,200	3.06	11,100	2.22	7.0	
	FC4CNF024	18,000	TDR&TXV	11.00	—	—	10.95	17,500	3.28	11,300	2.30	7.2	
	FF1DNA018	17,400	TDR	10.50	—	10.50	10.70	17,100	3.14	11,000	2.26	7.0	
	FF1DNA024	18,000	TDR	11.00	—	11.00	10.65	17,500	3.28	11,300	2.30	7.4	
	FG3AAA024	18,000	NONE	10.00	11.00	11.00	10.45	17,400	3.10	11,300	2.24	7.2	
	FK4DNF001	18,000	TDR&TXV	12.10	—	—	12.30	16,900	3.44	10,700	2.44	7.9	
	FK4DNF002	18,000	TDR&TXV	12.20	—	—	12.40	17,000	3.54	10,700	2.48	8.0	
	COILS + 58CV(A,X)070-12 FURNACE												
		CC5A/CD5AA024	18,000	TDR	12.00	—	12.00	11.65	16,700	3.16	10,500	2.32	7.5
		CC5A/CD5AW024	18,000	TDR	12.00	—	12.00	11.65	16,700	3.16	10,500	2.32	7.5
		CE3AA024	18,000	TDR	12.00	—	12.00	11.65	16,800	3.20	10,600	2.36	7.5
		CK3BA024	18,000	TDR	12.00	—	12.00	11.85	16,900	3.44	10,700	2.42	7.5
		CK5A/CK5BA024	18,000	TDR	12.00	—	12.00	11.85	16,900	3.44	10,700	2.42	7.5
	CK5A/CK5BW024	18,000	TDR	12.00	—	12.00	11.85	16,900	3.44	10,700	2.42	7.5	
024-33, 34	*F(A,B)4BN(F,C)024	22,600	TDR	11.00	—	11.00	10.80	23,600	3.42	14,300	2.22	7.2	
	CC5A/CD5AA024	22,400	NONE	—	10.50	10.50	10.65	23,600	3.28	14,300	2.14	7.3	
	CC5A/CD5AA030	22,600	NONE	—	11.00	11.00	10.70	23,600	3.30	14,300	2.16	7.3	
	CC5A/CD5AW024	22,400	NONE	—	10.50	10.50	10.65	23,600	3.28	14,300	2.14	7.3	
	CC5A/CD5AW030	22,600	NONE	—	11.00	11.00	10.70	23,600	3.30	14,300	2.16	7.3	
	CE3AA024	22,600	NONE	—	10.50	10.50	10.70	23,600	3.34	14,300	2.18	7.3	
	CE3AA030	23,000	NONE	—	11.00	11.00	10.80	23,600	3.42	14,400	2.20	7.5	
	CF5AA024	22,600	NONE	—	11.00	11.00	10.70	23,600	3.32	14,300	2.16	7.3	
	CK3BA024	22,400	NONE	—	10.50	10.50	10.70	23,600	3.46	14,400	2.22	7.3	
	CK3BA030	22,600	NONE	—	11.00	11.00	10.80	23,600	3.40	14,400	2.22	7.3	
	CK5A/CK5BA024	22,400	NONE	—	10.50	10.50	10.70	23,600	3.46	14,400	2.22	7.3	
	CK5A/CK5BA030	22,600	NONE	—	11.00	11.00	10.80	23,600	3.40	14,400	2.22	7.3	
	CK5A/CK5BW024	22,400	NONE	—	10.50	10.50	10.70	23,600	3.46	14,400	2.22	7.3	
	CK5A/CK5BW030	22,600	NONE	—	11.00	11.00	10.80	23,600	3.40	14,400	2.22	7.3	
	F(A,B)4BN(F,C)030	23,000	TDR	11.00	—	11.00	10.95	23,600	3.44	14,300	2.22	7.5	
	FC4CNF024	22,600	TDR&TXV	11.00	—	—	10.90	23,600	3.42	14,300	2.22	7.5	
	FC4CNF030	22,800	TDR&TXV	11.50	—	—	11.05	23,600	3.44	14,300	2.22	7.5	
	FF1DNA024	22,600	TDR	10.50	—	10.50	10.60	23,600	3.40	14,400	2.20	7.5	
	FF1DNA030	23,200	TDR	11.00	—	11.00	10.80	23,600	3.44	14,500	2.22	7.5	
	FG3AAA024	22,200	NONE	—	10.50	10.50	10.55	23,600	3.26	14,300	2.14	7.4	
	FK4DNF001	22,800	TDR&TXV	12.50	—	—	12.20	23,200	3.60	13,800	2.36	7.7	
	FK4DNF002	23,000	TDR&TXV	12.50	—	—	12.30	23,200	3.70	13,800	2.40	7.8	
	FK4DNF003	23,400	TDR&TXV	12.50	—	—	12.55	23,200	3.70	13,700	2.42	8.0	
COILS + 58CV(A,X)070-12 FURNACE													
	CC5A/CD5AA030	22,600	TDR	12.00	—	12.00	11.85	23,400	3.34	13,500	2.26	7.4	
	CC5A/CD5AW030	22,600	TDR	12.00	—	12.00	11.85	23,400	3.34	13,500	2.26	7.4	
	CE3AA030	22,800	TDR	12.00	—	12.00	11.95	23,800	3.50	13,700	2.30	7.5	
	CK3BA030	22,600	TDR	12.00	—	12.00	11.85	23,600	3.46	13,700	2.32	7.4	
	CK5A/CK5BA030	22,600	TDR	12.00	—	12.00	11.90	23,600	3.46	13,700	2.32	7.4	
	CK5A/CK5BW030	22,600	TDR	12.00	—	12.00	11.85	23,600	3.46	13,700	2.32	7.4	
030-33, 34	*F(A,B)4BN(F,C)030	28,400	TDR	11.00	—	11.00	10.60	29,600	3.24	18,800	2.34	7.6	
	CC5A/CD5AA030	27,800	NONE	—	11.00	11.00	10.45	29,000	3.12	18,800	2.28	7.3	
	CC5A/CD5AA036	28,800	NONE	—	11.00	11.00	10.70	29,400	3.30	18,900	2.36	7.5	
	CC5A/CD5AW030	27,800	NONE	—	11.00	11.00	10.45	29,000	3.12	18,800	2.28	7.3	
	CC5A/CD5AW036	28,800	NONE	—	11.00	11.00	10.70	29,400	3.30	18,900	2.36	7.5	
	CE3AA030	28,000	NONE	—	11.00	11.00	10.55	29,400	3.24	18,900	2.32	7.5	
	CE3AA036	28,400	NONE	—	11.00	11.00	10.65	29,400	3.24	18,900	2.34	7.5	
	CF5AA036	28,400	NONE	—	11.00	11.00	10.70	29,400	3.26	18,900	2.34	7.5	
	CK3BA030	27,800	NONE	—	11.00	11.00	10.50	29,000	3.22	18,900	2.32	7.3	
	CK3BA036	28,800	NONE	—	11.00	11.00	10.75	29,400	3.36	19,000	2.38	7.5	
	CK5A/CK5BA030	27,800	NONE	—	11.00	11.00	10.50	29,000	3.22	18,900	2.32	7.3	
	CK5A/CK5BA036	28,800	NONE	—	11.00	11.00	10.75	29,400	3.36	19,000	2.38	7.5	
	CK5A/CK5BT036	26,800	NONE	—	11.00	11.00	10.75	29,400	3.36	19,000	2.38	7.5	
	CK5A/CK5BW030	27,800	NONE	—	11.00	11.00	10.50	29,000	3.22	18,900	2.32	7.3	
	CK5A/CK5BW036	28,800	NONE	—	11.00	11.00	10.75	29,400	3.36	19,000	2.38	7.5	
	F(A,B)4BN(F,C)036	28,400	TDR	11.00	—	11.00	10.45	29,600	3.26	19,100	2.32	7.6	
	FC4CNF030	28,000	TDR&TXV	11.00	—	—	10.60	29,600	3.24	18,800	2.34	7.6	
	FC4CNF036	28,400	TDR&TXV	11.00	—	—	10.50	29,600	3.26	19,100	2.32	7.6	
	FF1DNA030	28,200	TDR	11.00	—	11.00	10.55	29,400	3.28	19,000	2.34	7.5	
	FG3AAA036	28,400	NONE	—	11.00	11.00	10.55	29,400	3.24	18,900	2.32	7.5	
	FK4DNF001	28,400	TDR&TXV	12.00	—	—	11.55	28,800	3.38	18,200	2.44	7.9	

See notes on pg. 14.

Combination ratings* continued

UNIT SIZE-SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER				EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF	
			Factory-Supplied Enhancement	Standard Rating	Carrier Furnace or Accessory TDR‡	Accessory TXV**		CAP	COP	CAP	COP		
030-33, 34	FK4DNF002	28,400	TDR&TXV	12.00	—	—	11.60	28,800	3.48	18,300	2.48	8.0	
	FK4DNF003	28,800	TDR&TXV	12.00	—	—	11.95	28,800	3.48	18,100	2.50	8.0	
	COILS + 58CV(A,X)070-12 FURNACE												
	CC5A/CD5AA036	28,800	TDR	12.00	—	12.00	11.55	29,400	3.34	18,000	2.42	7.8	
	CE3AA036	28,800	TDR	12.00	—	12.00	11.40	29,400	3.26	18,100	2.38	7.8	
	CK3BA036	28,800	TDR	12.00	—	12.00	11.60	29,400	3.40	18,200	2.46	7.8	
	CK5A/CK5BA036	28,800	TDR	12.00	—	12.00	11.60	29,400	3.40	18,200	2.46	7.8	
	CK5A/CK5BT036	28,800	TDR	12.00	—	12.00	11.60	29,400	3.40	18,100	2.46	7.8	
	COILS + 58CV(A,X)090-16 FURNACE												
	CC5A/CD5AA036	28,800	TDR	12.20	—	12.20	11.70	29,400	3.36	18,000	2.44	7.8	
	CC5A/CD5AW036	28,800	TDR	12.20	—	12.20	11.70	29,400	3.36	17,900	2.44	7.8	
	CE3AA036	28,800	TDR	12.20	—	12.20	11.60	29,400	3.30	17,900	2.42	7.8	
	CK3BA036	28,800	TDR	12.20	—	12.20	11.75	29,400	3.44	18,100	2.48	7.8	
	CK5A/CK5BA036	28,800	TDR	12.20	—	12.20	11.75	29,400	3.44	18,000	2.48	7.8	
	CK5A/CK5BW036	28,800	TDR	12.20	—	12.20	11.75	29,400	3.44	18,000	2.48	7.8	
	036-33, 34	*F(A,B)4BN(F,C)036	33,200	TDR	11.00	—	11.00	10.15	35,200	3.30	22,000	2.30	7.6
		CC5A/CD5AA036	33,600	NONE	—	11.50	11.50	10.45	35,000	3.36	21,800	2.34	7.7
		CC5A/CD5AA042	33,600	NONE	—	11.50	11.50	10.45	35,000	3.36	21,800	2.34	7.7
		CC5A/CD5AW036	33,600	NONE	—	11.50	11.50	10.45	35,000	3.36	21,800	2.34	7.7
		CC5A/CD5AW042	33,400	NONE	—	11.50	11.50	10.40	35,000	3.32	21,800	2.32	7.6
		CE3AA036	33,200	NONE	—	11.50	11.50	10.40	35,000	3.32	21,800	2.32	7.6
		CE3AA042	33,800	NONE	—	11.50	11.50	10.55	35,200	3.42	21,800	2.36	7.7
		CF5AA036	33,400	NONE	—	11.50	11.50	10.45	35,000	3.34	21,800	2.32	7.7
		CK3BA036	33,600	NONE	—	11.50	11.50	10.50	35,200	3.42	21,800	2.36	7.7
		CK3BA042	33,600	NONE	—	11.50	11.50	10.50	35,200	3.42	21,800	2.36	7.7
CK5A/CK5BA036		33,600	NONE	—	11.50	11.50	10.50	35,200	3.42	21,800	2.36	7.6	
CK5A/CK5BA042		33,600	NONE	—	11.50	11.50	10.50	35,200	3.42	21,800	2.36	7.7	
CK5A/CK5BT036		33,600	NONE	—	11.50	11.50	10.50	35,200	3.42	21,800	2.36	7.5	
CK5A/CK5BT042		33,600	NONE	—	11.50	11.50	10.50	35,200	3.42	21,800	2.36	7.5	
CK5A/CK5BW036		33,600	NONE	—	11.50	11.50	10.50	35,200	3.42	21,800	2.36	7.7	
F(A,B)4BN(F,B,C)042		33,800	TDR	11.50	—	11.50	10.40	35,200	3.40	22,000	2.34	8.0	
FC4CN(F,B)042		33,800	TDR&TXV	11.50	—	—	10.40	35,200	3.40	22,000	2.34	8.0	
FC4CNF036		33,000	TDR&TXV	11.00	—	—	10.15	35,200	3.30	22,000	2.30	7.6	
FG3AAA036		33,000	NONE	—	11.00	11.00	10.30	34,800	3.30	21,800	2.30	7.7	
FK4DNF001		32,800	TDR&TXV	11.50	—	—	10.95	34,200	3.38	21,200	2.38	7.8	
FK4DNF002		32,800	TDR&TXV	12.00	—	—	10.95	34,600	3.48	21,200	2.42	8.0	
FK4DNF003		33,000	TDR&TXV	12.00	—	—	11.55	34,000	3.52	21,000	2.46	8.0	
COILS + 58CV(A,X)070-12 FURNACE													
CE3AA042		33,600	TDR	12.40	—	12.40	11.20	34,000	3.44	21,200	2.42	7.8	
CK5A/CK5BE042		33,600	TDR	12.40	—	12.40	11.25	34,000	3.52	21,200	2.44	7.8	
COILS + 58CV(A,X)090-16 FURNACE													
CC5A/CD5AA042		33,600	TDR	12.70	—	12.70	11.40	34,000	3.42	21,000	2.42	7.8	
CE3AA042		33,600	TDR	12.70	—	12.70	11.40	34,000	3.48	21,000	2.44	7.8	
CK3BA042		33,600	TDR	12.60	—	12.60	11.35	34,000	3.50	21,000	2.46	7.8	
CK5A/CK5BA042		33,600	TDR	12.60	—	12.60	11.35	34,000	3.50	21,000	2.46	7.8	
CK5A/CK5BE042		33,600	TDR	12.70	—	12.70	11.45	34,000	3.56	21,000	2.48	7.8	
CK5A/CK5BT042		33,600	TDR	12.60	—	12.60	11.35	34,000	3.50	21,000	2.46	7.8	
COILS + 58CV(A,X)110-22 FURNACE													
CC5A/CD5AA042	33,600	TDR	12.80	—	12.80	11.50	34,000	3.44	20,800	2.44	7.8		
CC5A/CD5AW042	33,600	TDR	12.70	—	12.70	11.45	34,000	3.40	20,800	2.42	7.8		
CE3AA042	33,600	TDR	12.70	—	12.70	11.50	34,000	3.50	21,000	2.46	7.8		
CK3BA042	33,600	TDR	12.70	—	12.70	11.55	34,000	3.52	21,000	2.48	7.8		
CK5A/CK5BA042	33,600	TDR	12.70	—	12.70	11.50	34,000	3.52	21,000	2.48	7.8		
CK5A/CK5BT042	33,600	TDR	12.70	—	12.70	11.45	34,000	3.52	21,000	2.48	7.8		
COILS + 58CV(A,X)135-22 FURNACE													
CC5A/CD5AA042	33,600	TDR	12.70	—	12.70	11.45	34,000	3.44	20,800	2.44	7.8		
CC5A/CD5AW042	33,600	TDR	12.70	—	12.70	11.40	34,000	3.40	20,800	2.42	7.8		
CE3AA042	33,600	TDR	12.70	—	12.70	11.45	34,000	3.48	21,000	2.46	7.8		
CK3BA042	33,600	TDR	12.70	—	12.70	11.40	34,000	3.52	21,000	2.46	7.8		
CK5A/CK5BA042	33,600	TDR	12.70	—	12.70	11.40	34,000	3.52	21,000	2.46	7.8		
CK5A/CK5BT042	33,600	TDR	12.70	—	12.70	11.40	34,000	3.52	21,000	2.46	7.8		
COILS + 58CV(A,X)155-22 FURNACE													
CC5A/CD5AA042	33,600	TDR	12.70	—	12.70	11.55	34,000	3.46	20,800	2.44	7.8		
CC5A/CD5AW042	33,600	TDR	12.70	—	12.70	11.50	33,800	3.42	20,800	2.42	7.8		
CE3AA042	33,600	TDR	12.70	—	12.70	11.55	34,000	3.50	20,800	2.46	7.8		
CK3BA042	33,600	TDR	12.70	—	12.70	11.60	34,000	3.54	21,000	2.48	7.8		
CK5A/CK5BT042	33,600	TDR	12.70	—	12.70	11.50	34,000	3.54	21,000	2.48	7.8		
042-33, 34	*F(A,B)4BN(F,B,C)042	39,500	TDR	11.00	—	11.00	10.45	42,500	3.42	27,800	2.50	7.6	
	CC5A/CD5AA042	39,000	NONE	—	11.00	11.00	10.60	42,000	3.42	27,600	2.50	7.5	
	CC5A/CD5AC048	39,000	NONE	—	11.00	11.00	10.50	42,000	3.32	27,600	2.46	7.5	
	CC5A/CD5AW042	39,000	NONE	—	11.00	11.00	10.55	43,500	3.38	27,600	2.48	7.5	
	CC5A/CD5AW048	40,000	NONE	—	11.00	11.00	10.60	42,500	3.46	27,600	2.52	7.6	
	CD5AA048	40,000	NONE	—	11.00	11.00	10.60	42,500	3.46	27,600	2.52	7.6	
	CE3AA042	39,500	NONE	—	11.00	11.00	10.65	42,500	3.48	27,600	2.52	7.6	
	CE3AA048	40,000	NONE	—	11.00	11.00	10.70	42,500	3.52	27,800	2.54	7.7	

See notes on pg. 14.

Combination ratings* continued

UNIT SIZE-SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER				EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF	
			Factory-Supplied Enhancement	Standard Rating	Carrier Furnace or Accessory TDR‡	Accessory TXV**		CAP	COP	CAP	COP		
042-33, 34	CF5AA048	40,000	NONE	—	11.00	11.00	10.65	42,000	3.44	27,600	2.52	7.6	
	CK3BA042	39,000	NONE	—	11.00	11.00	10.60	42,000	3.48	27,600	2.52	7.5	
	CK3BA048	40,000	NONE	—	11.00	11.00	10.65	42,500	3.52	27,800	2.54	7.6	
	CK5A/CK5BA042	39,000	NONE	—	11.00	11.00	10.60	42,000	3.48	27,600	2.52	7.5	
	CK5A/CK5BA048	40,000	NONE	—	11.00	11.00	10.65	42,500	3.52	27,800	2.54	7.6	
	CK5A/CK5BE042	39,000	NONE	—	11.00	11.00	10.65	41,000	3.52	27,800	2.54	7.4	
	CK5A/CK5BT042	39,000	NONE	—	11.00	11.00	10.60	41,000	3.48	27,600	2.52	7.3	
	CK5A/CK5BT048	39,000	NONE	—	11.00	11.00	10.65	41,000	3.52	27,800	2.54	7.4	
	CK5A/CK5BW048	40,000	NONE	—	11.00	11.00	10.65	42,500	3.52	27,800	2.54	7.6	
	F(A,B)4BN(F,B,C)048	40,000	TDR	11.00	—	11.00	10.60	43,000	3.56	28,000	2.56	8.0	
	FC4CN(F,B)042	39,500	TDR&TXV	11.00	—	—	10.50	42,500	3.42	27,800	2.50	7.6	
	FC4CN(F,B)048	40,000	TDR&TXV	11.45	—	—	10.70	43,000	3.56	28,000	2.56	8.0	
	FG3AAA048	39,500	NONE	—	11.00	11.00	10.60	42,500	3.50	27,800	2.54	7.7	
	FK4DNF003	39,000	TDR&TXV	11.50	—	—	11.50	41,500	3.54	26,800	2.60	8.0	
	COILS + 58CV(A,X)090-16 FURNACE												
		CC5A/CD5AC048	39,500	TDR	12.00	—	12.00	11.30	42,000	3.34	26,400	2.54	7.8
		CD5AA048	39,500	TDR	12.00	—	12.00	11.45	42,000	3.52	26,600	2.60	7.8
		CE3AA048	39,500	TDR	12.00	—	12.00	11.40	42,000	3.56	26,800	2.62	7.8
		CK3BA048	39,500	TDR	12.00	—	12.00	11.40	42,000	3.60	26,800	2.64	7.8
		CK5A/CK5BA048	39,500	TDR	12.00	—	12.00	11.40	42,000	3.60	26,800	2.64	7.8
		CK5A/CK5BT048	39,500	TDR	12.00	—	12.00	11.40	42,000	3.60	26,800	2.64	7.8
	COILS + 58CV(A,X)110-22 FURNACE												
		CC5A/CD5AC048	39,500	TDR	12.00	—	12.00	11.40	42,000	3.36	26,400	2.56	7.8
		CC5A/CD5AW048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.54	26,400	2.62	7.8
		CD5AA048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.54	26,400	2.62	7.8
		CE3AA048	39,500	TDR	12.00	—	12.00	11.50	42,000	3.58	26,600	2.64	7.8
		CK3BA048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.62	26,600	2.66	7.8
		CK5A/CK5BA048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.62	26,600	2.66	7.8
		CK5A/CK5BT048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.62	26,600	2.66	7.8
	CK5A/CK5BW048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.62	26,600	2.66	7.8	
COILS + 58CV(A,X)135-22 FURNACE													
	CC5A/CD5AC048	39,500	TDR	12.00	—	12.00	11.45	42,000	3.36	26,200	2.56	7.8	
	CC5A/CD5AW048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.54	26,400	2.62	7.8	
	CD5AA048	39,500	TDR	12.00	—	12.00	11.60	42,000	3.54	26,400	2.62	7.8	
	CE3AA048	39,500	TDR	12.00	—	12.00	11.50	42,000	3.58	26,600	2.64	7.8	
	CK3BA048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.64	26,600	2.66	7.8	
	CK5A/CK5BA048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.64	26,600	2.66	7.8	
	CK5A/CK5BT048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.64	26,600	2.66	7.8	
	CK5A/CK5BW048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.64	26,600	2.66	7.8	
COILS + 58CV(A,X)155-22 FURNACE													
	CC5A/CD5AC048	39,500	TDR	12.00	—	12.00	11.45	42,000	3.36	26,200	2.58	7.8	
	CC5A/CD5AW048	39,500	TDR	12.00	—	12.00	11.60	42,000	3.54	26,400	2.62	7.8	
	CD5AA048	39,500	TDR	12.00	—	12.00	11.60	42,000	3.56	26,400	2.62	7.8	
	CE3AA048	39,500	TDR	12.00	—	12.00	11.55	42,000	3.58	26,600	2.64	7.8	
	CK3BA048	39,500	TDR	12.00	—	12.00	11.60	42,000	3.64	26,600	2.66	7.8	
	CK5A/CK5BA048	39,500	TDR	12.00	—	12.00	11.60	42,000	3.64	26,600	2.66	7.8	
	CK5A/CK5BT048	39,500	TDR	12.00	—	12.00	11.60	42,000	3.64	26,600	2.66	7.8	
	CK5A/CK5BW048	39,500	TDR	12.00	—	12.00	11.60	42,000	3.64	26,600	2.66	7.8	
048-33, 34	*F(A,B)4BN(F,B,C)048	46,000	TDR	11.00	—	11.00	10.25	48,000	3.44	31,800	2.48	7.6	
	CC5A/CD5AA060	46,000	NONE	—	11.00	11.00	10.30	48,000	3.26	31,400	2.44	7.4	
	CC5A/CD5AC048	44,500	NONE	—	11.00	11.00	10.15	48,000	3.10	31,000	2.38	7.0	
	CC5A/CD5AW048	45,500	NONE	—	11.00	11.00	10.25	48,000	3.30	31,400	2.44	7.4	
	CC5A/CD5AW060	47,000	NONE	—	11.50	11.50	10.55	48,000	3.44	31,600	2.50	7.7	
	CD5AA048	45,000	NONE	—	11.00	11.00	10.25	48,000	3.32	31,400	2.46	7.4	
	CE3AA048	46,000	NONE	—	11.00	11.00	10.35	48,000	3.38	31,400	2.48	7.5	
	CE3AA060	47,500	NONE	—	11.50	11.50	10.65	48,000	3.48	31,600	2.52	7.7	
	CF5AA048	45,000	NONE	—	11.00	11.00	10.35	48,000	3.24	31,200	2.42	7.3	
	CK3BA048	45,500	NONE	—	11.00	11.00	10.25	48,000	3.40	31,400	2.48	7.4	
	CK3BA060	46,000	NONE	—	11.00	11.00	10.55	48,000	3.56	31,600	2.56	7.4	
	CK5A/CK5BA048	45,500	NONE	—	11.00	11.00	10.25	48,000	3.40	31,400	2.48	7.4	
	CK5A/CK5BA060	46,000	NONE	—	11.00	11.00	10.55	48,000	3.56	31,600	2.56	7.4	
	CK5A/CK5BT048	45,500	NONE	—	11.00	11.00	10.25	48,000	3.40	31,400	2.48	7.4	
	CK5A/CK5BT060	46,000	NONE	—	11.00	11.00	10.55	48,000	3.56	31,600	2.56	7.4	
	CK5A/CK5BW048	45,500	NONE	—	11.00	11.00	10.25	48,000	3.40	31,400	2.48	7.4	
	CK5A/CK5BX060	47,000	NONE	—	11.50	11.50	10.75	48,000	3.60	31,600	2.58	7.7	
	F(A,B)4BN(F,B,C)060	47,500	TDR	11.50	—	11.50	10.35	48,000	3.52	32,200	2.52	7.7	
	FB4BNB070	48,000	TDR	11.50	—	11.50	10.70	48,000	3.68	32,000	2.58	8.0	
	FC4CN(F,B)048	46,000	TDR&TXV	11.00	—	—	10.25	48,000	3.44	31,800	2.48	7.6	
	FC4CN(F,B)060	48,000	TDR&TXV	11.50	—	—	10.35	48,000	3.52	32,200	2.52	8.0	
	FC4CNB054	48,000	TDR&TXV	11.50	—	—	10.80	48,000	3.68	31,800	2.60	8.0	
	FC4CNB070	47,500	TDR&TXV	11.50	—	—	10.75	48,000	3.68	32,000	2.58	7.7	
	FG3AAA048	45,000	NONE	—	11.00	11.00	10.25	48,000	3.36	31,400	2.48	7.5	
	FG3AAA060	46,000	NONE	—	11.00	11.00	10.45	48,000	3.42	31,400	2.50	7.7	
	FK4DNB006	47,500	TDR&TXV	12.00	—	—	11.70	48,000	3.78	30,600	2.70	8.0	
	FK4DNF005	48,000	TDR&TXV	12.50	—	—	11.30	48,000	3.62	30,800	2.62	7.8	

See notes on pg. 14.

Combination ratings* continued

UNIT SIZE-SERIES	INDOOR UNIT	ARI STANDARD RATINGS*											
		Cooling						Heating					
		TC	Seasonal Efficiency SEER			EER	High-Temp		Low-Temp		Seasonal Efficiency HSPF		
			Factory-Supplied Enhancement	Standard Rating	Carrier Furnace or Accessory TDR‡		Accessory TXV**	CAP	COP	CAP		COP	
COILS + 58CV(A,X)090-16 FURNACE													
	CE3AA060	46,000	TDR	12.00	—	12.00	11.00	48,000	3.42	30,800	2.54	7.8	
COILS + 58CV(A,X)110-22 FURNACE													
	CC5A/CD5AA060	46,000	TDR	12.00	—	12.00	10.90	48,000	3.24	30,200	2.48	7.8	
	CE3AA060	46,000	TDR	12.00	—	12.00	11.25	48,000	3.46	30,600	2.58	7.8	
	CK3BA060	46,000	TDR	12.00	—	12.00	11.15	48,000	3.60	30,600	2.62	7.8	
	CK5A/CK5BA060	46,000	TDR	12.00	—	12.00	11.15	48,000	3.60	30,600	2.62	7.8	
	CK5A/CK5BT060	46,000	TDR	12.00	—	12.00	11.15	48,000	3.60	30,600	2.62	7.8	
	CK5A/CK5BX060	46,000	TDR	12.00	—	12.00	11.45	48,000	3.62	30,600	2.64	7.8	
COILS + 58CV(A,X)135-22 FURNACE													
048-33, 34	CC5A/CD5AA060	46,000	TDR	12.00	—	12.00	10.90	48,000	3.24	30,400	2.48	7.8	
	CC5A/CD5AW060	46,000	TDR	12.00	—	12.00	11.20	48,000	3.44	30,400	2.54	7.8	
	CE3AA060	46,000	TDR	12.00	—	12.00	11.20	48,000	3.44	30,600	2.58	7.8	
	CK3BA060	46,000	TDR	12.00	—	12.00	11.10	48,000	3.58	30,600	2.62	7.8	
	CK5A/CK5BA060	46,000	TDR	12.00	—	12.00	11.10	48,000	3.58	30,600	2.62	7.8	
	CK5A/CK5BT060	46,000	TDR	12.00	—	12.00	11.10	48,000	3.58	30,600	2.62	7.8	
	CK5A/CK5BX060	46,000	TDR	12.00	—	12.00	11.40	48,000	3.60	30,600	2.64	7.8	
	COILS + 58CV(A,X)155-22 FURNACE												
		CC5A/CD5AA060	46,000	TDR	12.00	—	12.00	11.00	48,000	3.26	30,200	2.48	7.8
	CC5A/CD5AW060	46,000	TDR	12.00	—	12.00	11.25	48,000	3.46	30,400	2.58	7.8	
	CE3AA060	46,000	TDR	12.00	—	12.00	11.30	48,000	3.46	30,400	2.58	7.8	
	CK3BA060	46,000	TDR	12.00	—	12.00	11.20	48,000	3.60	30,600	2.62	7.8	
	CK5A/CK5BA060	46,000	TDR	12.00	—	12.00	11.20	48,000	3.60	30,600	2.62	7.8	
	CK5A/CK5BT060	46,000	TDR	12.00	—	12.00	11.20	48,000	3.60	30,600	2.62	7.8	
	CK5A/CK5BX060	46,000	TDR	12.00	—	12.00	11.45	48,000	3.62	30,400	2.64	7.8	
060-33, 34	*FB4BNB070	58,000	TDR	11.00	—	11.00	10.10	60,000	3.36	39,000	2.44	7.5	
	CC5A/CD5AA060	55,000	NONE	—	11.00	11.00	9.70	60,000	2.98	38,500	2.28	7.2	
	CC5A/CD5AW060	57,000	NONE	—	11.00	11.00	9.90	60,000	3.22	39,000	2.38	7.5	
	CE3AA060	57,000	NONE	—	11.00	11.00	9.95	60,000	3.24	39,000	2.40	7.5	
	CK3BA060	55,000	NONE	—	11.00	11.00	9.85	60,000	3.12	38,500	2.34	7.2	
	CK5A/CK5BA060	55,000	NONE	—	11.00	11.00	9.85	60,000	3.12	38,500	2.34	7.2	
	CK5A/CK5BT060	55,000	NONE	—	11.00	11.00	9.85	60,000	3.12	38,500	2.34	7.2	
	CK5A/CK5BX060	57,000	NONE	—	11.00	11.00	10.05	60,000	3.24	38,500	2.40	7.5	
	F(A,B)4BN(F,B,C)060	56,500	TDR	11.00	—	11.00	9.75	60,000	3.22	39,500	2.36	7.5	
	FC4CN(F,B)060	56,500	TDR&TXV	11.00	—	—	9.65	60,000	3.22	39,500	2.36	7.4	
	FC4CNB070	57,500	TDR&TXV	11.00	—	—	9.95	60,000	3.34	39,000	2.44	7.5	
	FG3AAA060	55,500	NONE	—	11.00	11.00	9.80	60,000	3.18	39,000	2.36	7.4	
	FK4DNB006	58,000	TDR&TXV	11.50	—	—	10.45	60,000	3.46	38,500	2.52	7.8	
	COILS + 58CV(A,X)110-22 FURNACE												
		CC5A/CD5AA060	54,500	TDR	11.20	—	11.20	10.20	60,000	2.96	37,400	2.30	7.2
		CE3AA060	56,500	TDR	11.50	—	11.50	10.55	60,000	3.16	37,800	2.40	7.5
		CK3BA060	56,500	TDR	11.50	—	11.50	10.35	60,000	3.26	37,800	2.44	7.5
		CK5A/CK5BA060	56,500	TDR	11.50	—	11.50	10.35	60,000	3.26	37,800	2.44	7.5
		CK5A/CK5BT060	56,500	TDR	11.50	—	11.50	10.35	60,000	3.26	37,800	2.44	7.5
		CK5A/CK5BX060	56,500	TDR	11.50	—	11.50	10.60	60,000	3.28	37,800	2.46	7.5
COILS + 58CV(A,X)135-22 FURNACE													
	CC5A/CD5AA060	54,500	TDR	11.20	—	11.20	10.20	60,000	2.96	37,600	2.30	7.2	
	CC5A/CD5AW060	56,500	TDR	11.50	—	11.50	10.45	60,000	3.14	37,600	2.38	7.5	
	CE3AA060	56,500	TDR	11.50	—	11.50	10.50	60,000	3.16	37,800	2.40	7.5	
	CK3BA060	56,500	TDR	11.50	—	11.50	10.30	60,000	3.26	38,000	2.44	7.5	
	CK5A/CK5BA060	56,500	TDR	11.50	—	11.50	10.35	60,000	3.26	38,000	2.44	7.5	
	CK5A/CK5BT060	56,500	TDR	11.50	—	11.50	10.35	60,000	3.26	38,000	2.44	7.5	
	CK5A/CK5BX060	56,500	TDR	11.50	—	11.50	10.60	60,000	3.28	37,800	2.46	7.5	
COILS + 58CV(A,X)155-22 FURNACE													
	CC5A/CD5AA060	54,500	TDR	11.20	—	11.20	10.25	60,000	2.96	37,400	2.32	7.2	
	CC5A/CD5AW060	56,500	TDR	11.50	—	11.50	10.50	60,000	3.16	37,600	2.40	7.5	
	CE3AA060	56,500	TDR	11.50	—	11.50	10.60	60,000	3.16	37,600	2.42	7.5	
	CK3BA060	56,500	TDR	11.50	—	11.50	10.40	60,000	3.28	37,800	2.44	7.5	
	CK5A/CK5BA060	56,500	TDR	11.50	—	11.50	10.40	60,000	3.28	37,800	2.44	7.5	
	CK5A/CK5BT060	56,500	TDR	11.50	—	11.50	10.40	60,000	3.28	37,800	2.44	7.5	
	CK5A/CK5BX060	56,500	TDR	11.50	—	11.50	10.65	60,000	3.30	37,800	2.48	7.5	

See notes on pg. 14.

- * Ratings are net values reflecting the effects of circulating fan heat. Supplemental electric heat is not included. Ratings are based on:
Cooling Standard: 80°F (27°C) db 67°F (19°C) wb indoor entering air temperature and 95°F (35°C) db air entering outdoor unit.
High-Temperature Heating Standard: 70°F (21°C) db indoor entering air temperature and 47°F (8°C) db 43°F (6°C) wb air entering outdoor unit.
Low-Temperature Heating Standard: 70°F (21°C) db indoor entering air temperature and 17°F (-8°C) db 15°F (11°C) wb air entering outdoor unit.
- † Outdoor section/indoor section combination tested in accordance with DOE test procedures for heat pumps. Ratings for other combinations are determined under DOE computer simulation procedures.
- ‡ In most cases, only 1 method should be used to achieve TDR function. Using more than 1 method in a system may cause degradation in performance. Use either the accessory Time-Delay Relay KAATD0101TDR or a furnace equipped with TDR.
- ** Requires field-installed TXV, except FC4 and FK4 which have TXV factory installed.
- COP — Coefficient of Performance
HSPF — Heating Seasonal Performance Factor
SEER — Seasonal Energy Efficiency Ratio
TC — Total Capacity (Btuh)
TDR — Time-Delay Relay
TXV — Thermostatic Expansion Valve

Detailed cooling capacities*

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
		Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**
CFM	EWB	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	
38AYC018-33, 34 Outdoor Section With F(A,B)4BN(F,C)024 Indoor Section																
550	72	20.2	10.1	1.49	19.5	9.87	1.66	18.5	9.53	1.85	17.5	9.17	2.05	16.5	8.82	2.27
	67	18.4	12.9	1.48	17.6	12.6	1.64	16.8	12.2	1.81	15.9	11.9	2.01	14.9	11.5	2.23
	63††	17.1	12.5	1.45	16.3	12.2	1.61	15.5	11.8	1.79	14.7	11.4	1.98	13.7	11.1	2.20
	62	16.8	15.6	1.45	16.1	15.2	1.61	15.3	14.8	1.78	14.5	14.4	1.98	13.7	13.7	2.20
	57	16.4	16.4	1.44	15.7	15.7	1.60	15.1	15.1	1.78	14.4	14.4	1.98	13.7	13.7	2.20
650	72	20.4	10.6	1.53	19.8	10.5	1.70	18.9	10.2	1.89	17.8	9.80	2.10	16.8	9.44	2.32
	67	18.9	14.0	1.51	18.0	13.6	1.68	17.1	13.3	1.86	16.2	12.9	2.06	15.2	12.5	2.27
	63††	17.5	13.5	1.50	16.7	13.2	1.65	15.8	12.8	1.83	14.9	12.4	2.03	14.0	12.0	2.24
	62	17.3	17.0	1.49	16.6	16.5	1.65	15.8	15.8	1.83	15.1	15.1	2.03	14.3	14.3	2.25
	57	17.2	17.2	1.49	16.5	16.5	1.65	15.8	15.8	1.83	15.1	15.1	2.03	14.3	14.3	2.25
750	72	20.7	11.1	1.57	20.0	11.0	1.74	19.2	10.8	1.94	18.1	10.4	2.14	17.0	10.0	2.36
	67	19.2	14.9	1.55	18.3	14.7	1.72	17.3	14.3	1.90	16.4	13.9	2.10	15.4	13.5	2.32
	63††	17.8	14.5	1.54	16.9	14.1	1.70	16.0	13.7	1.87	15.1	13.3	2.07	14.2	12.9	2.29
	62	17.8	17.8	1.54	17.1	17.1	1.70	16.4	16.4	1.88	15.6	15.6	2.08	14.8	14.8	2.30
	57	17.8	17.8	1.54	17.1	17.1	1.70	16.4	16.4	1.88	15.6	15.6	2.08	14.8	14.8	2.30

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Unit Size	Cooling		Indoor Section	Unit Size	Cooling	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	018	1.00	1.04	FF1DNA	018	0.97	0.97
	024	1.00	1.02		024	1.00	1.00
CC5A/CD5AW	024	1.00	1.02	FG3AAA	024	1.00	1.02
CE3AA	024	1.00	1.01	FK4DNF	001	1.00	0.87
CF5AA	024	1.00	1.01		002	1.00	0.86
CK3BA	024	1.00	1.00	COILS + 58CV(A,X)070-12 FURNACE			
CK5A/CK5BA	018	1.00	1.02	CC5A/CD5AA	024	1.00	0.92
	024	1.00	1.00	CC5A/CD5AW	024	1.00	0.92
CK5A/CK5BW	024	1.00	1.00	CE3AA	024	1.00	0.92
F(A,B)4BN(F,C)	018	0.96	0.99	CK3BA	024	1.00	0.90
	024	1.00	1.00	CK5A/CK5BA	024	1.00	0.90
FC4CNF	024	1.00	0.98	CK5A/CK5BW	024	1.00	0.90

See notes on pg. 21.

Detailed cooling capacities* continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
		Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
CFM	EWB	Total	Sens‡	Total System kW**	Total	Sens‡	Total System kW**	Total	Sens‡	Total System kW**	Total	Sens‡	Total System kW**	Total	Sens‡	Total System kW**
		38AYC024-33, 34 Outdoor Section With F(A,B)4BN(F,C)024 Indoor Section														
700	72	25.4	12.8	1.92	24.4	12.5	2.09	23.4	12.2	2.28	22.2	11.7	2.49	21.0	11.3	2.72
	67	23.2	16.5	1.88	22.2	16.1	2.05	21.2	15.7	2.23	20.1	15.2	2.44	19.0	14.8	2.66
	63††	21.6	16.0	1.85	20.6	15.5	2.01	19.6	15.1	2.20	18.6	14.7	2.40	17.5	14.2	2.62
	62	21.2	19.9	1.84	20.3	19.4	2.01	19.4	18.9	2.19	18.5	18.4	2.39	17.5	17.5	2.62
	57	20.7	20.7	1.83	20.0	20.0	2.00	19.2	19.2	2.19	18.4	18.4	2.39	17.5	17.5	2.62
800	72	25.5	13.2	1.95	24.7	13.0	2.13	23.8	12.8	2.32	22.5	12.3	2.54	21.3	11.9	2.76
	67	23.7	17.5	1.92	22.6	17.1	2.09	21.5	16.7	2.28	20.4	16.3	2.48	19.2	15.8	2.70
	63††	21.9	16.9	1.89	21.0	16.5	2.06	19.9	16.1	2.24	18.9	15.7	2.44	17.8	15.2	2.66
	62	21.7	21.2	1.89	20.8	20.7	2.05	19.9	19.9	2.24	19.1	19.1	2.44	18.2	18.2	2.67
	57	21.5	21.5	1.88	20.8	20.8	2.05	19.9	19.9	2.24	19.1	19.1	2.44	18.2	18.2	2.67
900	72	25.5	13.6	1.98	25.0	13.6	2.17	24.0	13.4	2.37	22.7	12.9	2.58	21.4	12.5	2.81
	67	23.9	18.5	1.96	22.9	18.1	2.14	21.8	17.7	2.32	20.6	17.3	2.52	19.5	16.8	2.74
	63††	22.2	17.9	1.93	21.2	17.5	2.10	20.2	17.1	2.28	19.1	16.6	2.48	17.9	16.1	2.70
	62	22.2	22.2	1.93	21.4	21.4	2.10	20.5	20.5	2.29	19.6	19.6	2.49	18.6	18.6	2.72
	57	22.2	22.2	1.93	21.4	21.4	2.10	20.5	20.5	2.29	19.6	19.6	2.49	18.7	18.7	2.72

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Unit Size	Cooling		Indoor Section	Unit Size	Cooling	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	024	0.99	1.01	FC4CNF	024	1.00	0.99
	030	1.00	1.01		030	1.01	0.99
CC5A/CD5AW	024	0.99	1.01	FF1DNA	024	1.00	1.02
	030	1.00	1.01		030	1.03	1.03
CE3AA	024	1.00	1.01	FG3AAA	024	0.98	1.01
	030	1.02	1.02		FK4DNF	001	1.01
CF5AA	024	1.00	1.01	002		1.02	0.89
	CK3BA	024	0.99	1.00		003	1.04
030		1.00	1.00	COILS + 58CV(A,X)070-12 FURNACE			
CK5A/CK5BA	024	0.99	1.00	CC5A/CD5AA	030	1.00	0.91
	030	1.00	1.00	CC5A/CD5AW	030	1.00	0.91
CK5A/CK5BW	024	0.99	1.00	CE3AA	030	1.01	0.91
	030	1.00	1.00	CK3BA	030	1.00	0.91
F(A,B)4BN(F,C)	024	1.00	1.00	CK5A/CK5BA	030	1.00	0.91
	030	1.02	1.00	CK5A/CK5BW	030	1.00	0.91

See notes on pg. 21.

Detailed cooling capacities*

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
		Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
CFM	EWB	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	
38AYC030-33, 34 Outdoor Section With F(A,B)4BN(F,C)030 Indoor Section																
875	72	31.8	15.9	2.47	30.7	15.5	2.70	29.4	15.1	2.94	28.0	14.6	3.19	26.6	14.1	3.46
	67	29.1	20.3	2.42	27.9	19.9	2.62	26.7	19.4	2.84	25.4	18.9	3.09	24.1	18.3	3.36
	63††	27.1	19.7	2.35	26.0	19.3	2.56	24.8	18.8	2.78	23.6	18.2	3.03	22.3	17.7	3.29
	62	26.6	24.5	2.34	25.6	24.0	2.54	24.5	23.4	2.77	23.3	22.8	3.02	22.1	22.0	3.29
	57	25.9	25.9	2.32	25.0	25.0	2.53	24.1	24.1	2.76	23.1	23.1	3.01	22.1	22.1	3.29
1000	72	32.2	16.5	2.52	31.3	16.3	2.76	29.8	15.8	3.00	28.4	15.3	3.25	26.9	14.8	3.53
	67	29.6	21.6	2.48	28.4	21.1	2.68	27.1	20.6	2.90	25.8	20.1	3.15	24.4	19.6	3.42
	63††	27.5	20.9	2.42	26.4	20.4	2.62	25.2	19.9	2.84	23.9	19.4	3.08	22.5	18.8	3.35
	62	27.2	26.1	2.41	26.1	25.6	2.61	25.0	24.9	2.83	23.9	23.9	3.09	22.8	22.8	3.36
	57	26.8	26.8	2.39	25.9	25.9	2.60	25.0	25.0	2.83	23.9	23.9	3.09	22.8	22.8	3.36
1125	72	32.4	17.1	2.57	31.6	17.0	2.81	30.1	16.5	3.06	28.7	16.0	3.31	27.1	15.5	3.58
	67	30.0	22.8	2.52	28.7	22.3	2.74	27.5	21.8	2.96	26.1	21.3	3.21	24.6	20.7	3.48
	63††	27.9	22.1	2.47	26.7	21.6	2.67	25.5	21.0	2.89	24.2	20.5	3.14	22.8	19.9	3.41
	62	27.7	27.5	2.47	26.7	26.7	2.67	25.6	25.6	2.90	24.6	24.6	3.15	23.4	23.4	3.43
	57	27.6	27.6	2.46	26.7	26.7	2.67	25.7	25.7	2.90	24.6	24.6	3.15	23.4	23.4	3.43

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Unit Size	Cooling		Indoor Section	Unit Size	Cooling	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	030	0.98	0.99	FF1DNA	030	0.99	1.00
	036	1.01	1.00	FG3AAA	036	1.00	1.00
CC5A/CD5AW	030	0.98	0.99	FK4DNF	001	1.00	0.92
	036	1.01	1.00		002	1.00	0.91
CE3AA	030	0.99	0.99		003	1.01	0.90
	036	1.00	1.00	COILS + 58CV(A,X)070-12 FURNACE			
CF5AA	036	1.00	0.99	CC5A/CD5AA	036	1.01	0.93
CK3BA	030	0.98	0.99	CE3AA	036	1.01	0.94
	036	1.01	1.00	CK3BA	036	1.01	0.93
CK5A/CK5BA	030	0.98	0.99	CK5A/CK5BA	036	1.01	0.93
	036	1.01	1.00	CK5A/CK5BT	036	1.01	0.93
CK5A/CK5BT	036	0.94	0.93	COILS + 58CV(A,X)090-16 FURNACE			
CK5A/CK5BW	030	0.98	0.99	CC5A/CD5AA	036	1.01	0.92
	036	1.01	1.00	CC5A/CD5AW	036	1.01	0.92
F(A,B)4BN(F,C)	030	1.00	1.00	CE3AA	036	1.01	0.93
	036	1.00	1.01	CK3BA	036	1.01	0.91
FC4CNF	030	0.99	0.99	CK5A/CK5BA	036	1.01	0.91
	036	1.00	1.01	CK5A/CK5BW	036	1.01	0.91

See notes on pg. 21.

Detailed cooling capacities*

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
		Capacity MBtu/h†	Total System kW**	Sens‡	Capacity MBtu/h†	Total System kW**	Sens‡	Capacity MBtu/h†	Total System kW**	Sens‡	Capacity MBtu/h†	Total System kW**	Sens‡	Capacity MBtu/h†	Total System kW**	Sens‡
CFM	EWB															
38AYC036-33, 34 Outdoor Section With F(A,B)4BN(F,C)036 Indoor Section																
1050	72	37.0	18.5	2.95	35.7	18.1	3.23	34.4	17.7	3.55	32.8	17.1	3.90	31.0	16.5	4.27
	67	34.0	23.9	2.92	32.6	23.4	3.20	31.2	22.8	3.50	29.7	22.2	3.83	28.1	21.6	4.20
	63††	31.6	23.2	2.88	30.3	22.6	3.15	29.0	22.0	3.45	27.5	21.4	3.78	25.9	20.7	4.14
	62	31.1	28.9	2.87	29.9	28.3	3.15	28.6	27.6	3.45	27.2	26.8	3.78	25.8	25.8	4.13
	57	30.3	30.3	2.86	29.3	29.3	3.13	28.2	28.2	3.44	27.1	27.1	3.77	25.8	25.8	4.14
1200	72	37.2	19.1	3.02	36.2	18.9	3.31	34.9	18.5	3.63	33.3	18.0	3.97	31.4	17.4	4.35
	67	34.6	25.5	2.99	33.2	24.9	3.27	31.7	24.3	3.57	30.1	23.7	3.91	28.5	23.0	4.27
	63††	32.2	24.6	2.95	30.8	24.0	3.23	29.4	23.4	3.53	27.9	22.8	3.86	26.3	22.1	4.21
	62	31.8	30.8	2.95	30.6	30.1	3.22	29.2	29.2	3.52	28.0	28.0	3.86	26.7	26.7	4.22
	57	31.4	31.4	2.94	30.4	30.4	3.22	29.2	29.2	3.52	28.0	28.0	3.86	26.7	26.7	4.22
1350	72	37.2	19.6	3.08	36.6	19.7	3.38	35.3	19.4	3.70	33.6	18.8	4.04	31.7	18.2	4.42
	67	35.1	26.9	3.06	33.6	26.4	3.34	32.1	25.8	3.64	30.5	25.1	3.98	28.8	24.5	4.34
	63††	32.6	26.0	3.02	31.2	25.4	3.30	29.7	24.8	3.60	28.2	24.1	3.93	26.5	23.4	4.28
	62	32.4	32.3	3.02	31.2	31.2	3.30	30.0	30.0	3.60	28.8	28.8	3.94	27.4	27.4	4.31
	57	32.4	32.4	3.02	31.2	31.2	3.30	30.0	30.0	3.60	28.8	28.8	3.94	27.4	27.4	4.31

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Unit Size	Cooling		Indoor Section	Unit Size	Cooling	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	036	1.01	0.98	CE3AA	042	1.01	0.90
	042	1.01	0.98	CK3BA	042	1.01	0.91
CC5A/CD5AW	036	1.01	0.98	CK5A/CK5BA	042	1.01	0.91
	042	1.01	0.98	CK5A/CK5BE	042	1.01	0.90
CE3AA	036	1.00	0.98	CK5A/CK5BT	042	1.01	0.91
	042	1.02	0.98	COILS + 58CV(A,X)110-22 FURNACE			
CF5AA	036	1.01	0.98	CC5A/CD5AA	042	1.01	0.89
CK3BA	036	1.01	0.98	CC5A/CD5AW	042	1.01	0.90
	042	1.01	0.98	CE3AA	042	1.01	0.89
CK5A/CK5BA	036	1.01	0.98	CK3BA	042	1.01	0.89
	042	1.01	0.98	CK5A/CK5BA	042	1.01	0.89
CK5A/CK5BT	036	1.01	0.98	CK5A/CK5BT	042	1.01	0.90
	042	1.01	0.98	COILS + 58CV(A,X)135-22 FURNACE			
CK5A/CK5BW	036	1.01	0.98	CC5A/CD5AA	042	1.01	0.90
F(A,B)4BN(F,B,C)	042	1.02	0.99	CC5A/CD5AW	042	1.01	0.90
F(A,B)4BN(F,C)	036	1.00	1.00	CE3AA	042	1.01	0.90
FC4CN(F,B)	042	1.02	0.99	CK3BA	042	1.01	0.90
FC4CNF	036	0.99	0.99	CK5A/CK5BA	042	1.01	0.90
FG3AAA	036	0.99	0.98	CK5A/CK5BT	042	1.01	0.90
FK4DNF	001	0.99	0.92	COILS + 58CV(A,X)155-22 FURNACE			
	002	0.99	0.92	CC5A/CD5AA	042	1.01	0.89
	003	0.99	0.87	CC5A/CD5AW	042	1.01	0.89
COILS + 58CV(A,X)070-12 FURNACE				CE3AA	042	1.01	0.89
CE3AA	042	1.01	0.92	CK3BA	042	1.01	0.89
CK5A/CK5BE	042	1.01	0.91	CK5A/CK5BT	042	1.01	0.89
COILS + 58CV(A,X)090-16 FURNACE					—	—	—
CC5A/CD5AA	042	1.01	0.90				

See notes on pg. 21.

Detailed cooling capacities*

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
		Capacity MBtu/h†	Total System kW**	Capacity MBtu/h†	Total System kW**	Capacity MBtu/h†	Total System kW**	Capacity MBtu/h†	Total System kW**	Capacity MBtu/h†	Total System kW**	Capacity MBtu/h†	Total System kW**	Capacity MBtu/h†	Total System kW**	
CFM	EWB															Total
38AYC042-33, 34 Outdoor Section With F(A,B)4BN(F,B,C)042 Indoor Section																
1225	72	44.0	22.0	3.42	42.9	21.7	3.77	40.9	21.0	4.13	39.0	20.3	4.52	37.0	19.6	4.94
	67	40.5	28.5	3.38	38.9	27.8	3.69	37.2	27.2	4.04	35.4	26.4	4.42	33.6	25.7	4.84
	63††	37.7	27.6	3.32	36.1	26.9	3.63	34.5	26.3	3.97	32.8	25.5	4.35	31.0	24.7	4.76
	62	37.1	34.4	3.31	35.6	33.7	3.62	34.0	32.9	3.96	32.5	32.0	4.34	30.9	30.8	4.76
	57	36.2	36.2	3.29	34.9	34.9	3.60	33.7	33.7	3.95	32.3	32.3	4.34	30.9	30.9	4.76
1400	72	44.3	22.8	3.50	43.4	22.7	3.86	41.5	22.1	4.22	39.6	21.4	4.61	37.5	20.7	5.03
	67	41.3	30.3	3.46	39.5	29.6	3.78	37.7	28.9	4.13	35.9	28.2	4.51	33.9	27.4	4.93
	63††	38.3	29.3	3.41	36.7	28.6	3.71	35.0	27.9	4.06	33.2	27.2	4.44	31.3	26.4	4.85
	62	37.9	36.7	3.40	36.4	35.8	3.71	34.9	34.8	4.06	33.4	33.4	4.44	31.9	31.9	4.87
	57	37.5	37.5	3.39	36.2	36.2	3.70	34.8	34.8	4.05	33.4	33.4	4.44	31.8	31.8	4.87
1575	72	44.4	23.4	3.57	43.8	23.6	3.94	42.0	23.1	4.31	39.9	22.4	4.70	37.8	21.7	5.12
	67	41.7	32.0	3.54	40.0	31.4	3.87	38.2	30.7	4.21	36.3	29.9	4.59	34.3	29.1	5.01
	63††	38.7	30.9	3.49	37.1	30.2	3.80	35.4	29.5	4.14	33.6	28.7	4.52	31.7	27.9	4.94
	62	38.6	38.5	3.49	37.2	37.2	3.80	35.8	35.8	4.15	34.3	34.3	4.54	32.7	32.7	4.97
	57	38.5	38.5	3.49	37.2	37.2	3.80	35.8	35.8	4.15	34.3	34.3	4.54	32.7	32.7	4.97

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Unit Size	Cooling		Indoor Section	Unit Size	Cooling	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	042	0.99	0.97	CK5A/CK5BT	048	1.00	0.92
CC5A/CD5AC	048	0.99	0.98	COILS + 58CV(A,X)110-22 FURNACE			
CC5A/CD5AW	042	0.99	0.98	CC5A/CD5AC	048	1.00	0.92
	048	1.01	1.00	CC5A/CD5AW	048	1.00	0.90
CD5AA	048	1.01	1.00	CD5AA	048	1.00	0.90
CE3AA	042	1.00	0.98	CE3AA	048	1.00	0.91
	048	1.01	0.99	CK3BA	048	1.00	0.90
CF5AA	048	1.01	0.99	CK5A/CK5BA	048	1.00	0.90
CK3BA	042	0.99	0.97	CK5A/CK5BT	048	1.00	0.90
	048	1.01	0.99	CK5A/CK5BW	048	1.00	0.90
CK5A/CK5BA	042	0.99	0.97	COILS + 58CV(A,X)135-22 FURNACE			
	048	1.01	0.99	CC5A/CD5AC	048	1.00	0.91
CK5A/CK5BE	042	0.99	0.97	CC5A/CD5AW	048	1.00	0.90
CK5A/CK5BT	042	0.99	0.97	CD5AA	048	1.00	0.90
	048	0.99	0.97	CE3AA	048	1.00	0.91
CK5A/CK5BW	048	1.01	0.99	CK3BA	048	1.00	0.90
F(A,B)4BN(F,B,C)	042	1.00	1.00	CK5A/CK5BA	048	1.00	0.90
	048	1.01	1.00	CK5A/CK5BT	048	1.00	0.90
FC4CN(F,B)	042	1.00	1.00	CK5A/CK5BW	048	1.00	0.90
	048	1.01	0.99	COILS + 58CV(A,X)155-22 FURNACE			
FG3AAA	048	1.00	0.99	CC5A/CD5AC	048	1.00	0.91
FK4DNF	003	0.99	0.90	CC5A/CD5AW	048	1.00	0.90
COILS + 58CV(A,X)090-16 FURNACE				CD5AA	048	1.00	0.90
CC5A/CD5AC	048	1.00	0.92	CE3AA	048	1.00	0.90
CD5AA	048	1.00	0.91	CK3BA	048	1.00	0.90
CE3AA	048	1.00	0.92	CK5A/CK5BA	048	1.00	0.90
CK3BA	048	1.00	0.92	CK5A/CK5BT	048	1.00	0.90
CK5A/CK5BA	048	1.00	0.92	CK5A/CK5BW	048	1.00	0.90

See notes on pg. 21.

Detailed cooling capacities*

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
		Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**	Capacity MBtu/h†		Total System kW**
CFM	EWB	Total	Sens‡	kW**	Total	Sens‡	kW**	Total	Sens‡	kW**	Total	Sens‡	kW**	Total	Sens‡	kW**
		38AYC048-33, 34 Outdoor Section With F(A,B)4BN(F,B,C)048 Indoor Section														
1400	72	51.0	25.3	3.97	49.1	24.7	4.43	47.0	24.0	4.94	44.7	23.2	5.49	42.3	22.4	6.08
	67	47.4	32.8	3.95	45.3	32.0	4.40	43.1	31.1	4.90	40.6	30.1	5.44	38.2	29.2	6.02
	63††	43.8	31.8	3.92	41.8	30.9	4.37	39.7	30.0	4.86	37.6	29.1	5.39	35.2	28.1	5.95
	62	43.1	39.5	3.91	41.1	38.5	4.36	39.2	37.5	4.85	37.1	36.5	5.38	34.9	34.9	5.94
	57	41.8	41.8	3.90	40.2	40.2	4.35	38.6	38.6	4.84	36.9	36.9	5.38	35.0	35.0	5.94
1600	72	51.6	26.3	4.05	49.7	25.7	4.51	47.6	25.1	5.02	45.3	24.3	5.58	42.8	23.5	6.17
	67	48.2	34.8	4.03	46.0	34.0	4.49	43.7	33.1	4.99	41.2	32.2	5.53	38.7	31.2	6.11
	63††	44.6	33.7	4.01	42.5	32.8	4.46	40.3	31.9	4.95	38.1	31.0	5.48	35.7	30.0	6.04
	62	44.0	42.2	4.00	42.0	41.1	4.45	40.1	39.9	4.94	38.2	38.2	5.48	36.3	36.3	6.05
	57	43.4	43.4	3.99	41.7	41.7	4.45	40.0	40.0	4.94	38.2	38.2	5.48	36.2	36.2	6.05
1800	72	52.1	27.3	4.13	50.2	26.7	4.60	48.1	26.1	5.11	45.7	25.4	5.66	43.2	24.7	6.25
	67	48.8	36.8	4.11	46.6	36.0	4.57	44.2	35.2	5.07	41.7	34.2	5.61	39.1	33.1	6.20
	63††	45.2	35.6	4.09	43.0	34.7	4.54	40.8	33.8	5.03	38.5	32.8	5.56	36.1	31.7	6.13
	62	44.9	44.5	4.08	43.0	43.0	4.54	41.2	41.2	5.04	39.3	39.3	5.58	37.2	37.2	6.16
	57	44.7	44.7	4.08	43.0	43.0	4.54	41.2	41.2	5.04	39.3	39.3	5.58	37.3	37.3	6.15

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Unit Size	Cooling		Indoor Section	Unit Size	Cooling	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	060	1.00	1.00	FK4DNF	005	1.04	0.95
CC5A/CD5AC	048	0.97	0.98	COILS + 58CV(A,X)090-16 FURNACE			
CC5A/CD5AW	048	0.99	0.99	CE3AA	060	1.00	0.93
	060	1.02	0.99	COILS + 58CV(A,X)110-22 FURNACE			
CD5AA	048	0.98	0.98	CC5A/CD5AA	060	1.00	0.94
CE3AA	048	1.00	0.99	CE3AA	060	1.00	0.91
	060	1.03	0.99	CK3BA	060	1.00	0.92
CF5AA	048	0.98	0.97	CK5A/CK5BA	060	1.00	0.92
CK3BA	048	0.99	0.99	CK5A/CK5BT	060	1.00	0.92
	060	1.00	0.97	CK5A/CK5BX	060	1.00	0.90
CK5A/CK5BA	048	0.99	0.99	COILS + 58CV(A,X)135-22 FURNACE			
	060	1.00	0.97	CC5A/CD5AA	060	1.00	0.94
CK5A/CK5BT	048	0.99	0.99	CC5A/CD5AW	060	1.00	0.92
	060	1.00	0.97	CE3AA	060	1.00	0.92
CK5A/CK5BW	048	0.99	0.99	CK3BA	060	1.00	0.92
CK5A/CK5BX	060	1.02	0.97	CK5A/CK5BA	060	1.00	0.92
F(A,B)4BN(F,B,C)	048	1.00	1.00	CK5A/CK5BT	060	1.00	0.92
	060	1.03	1.02	CK5A/CK5BX	060	1.00	0.90
FB4BNB	070	1.04	1.00	COILS + 58CV(A,X)155-22 FURNACE			
FC4CN(F,B)	048	1.00	1.00	CC5A/CD5AA	060	1.00	0.93
	060	1.04	1.03	CC5A/CD5AW	060	1.00	0.91
FC4CNB	054	1.04	0.99	CE3AA	060	1.00	0.91
	070	1.03	0.98	CK3BA	060	1.00	0.92
FG3AAA	048	0.98	0.98	CK5A/CK5BA	060	1.00	0.92
	060	1.00	0.98	CK5A/CK5BT	060	1.00	0.92
FK4DNB	006	1.03	0.90	CK5A/CK5BX	060	1.00	0.90

See notes on pg. 21.

Detailed cooling capacities* continued

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F														
		85			95			105			115			125		
		Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**	Capacity MBtuht†		Total System kW**
CFM	EWB	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	Total	Sens‡	
38AYC060-33, 34 Outdoor Section With FB4BNB070 Indoor Section																
1750	72	65.6	32.7	5.42	63.2	32.0	6.00	60.5	31.0	6.64	57.4	29.9	7.31	54.1	28.8	8.03
	67	60.6	42.3	5.35	58.0	41.3	5.92	55.2	40.2	6.54	52.1	39.0	7.22	49.0	37.7	7.93
	63††	56.3	41.1	5.31	53.7	40.0	5.87	51.1	38.9	6.47	48.3	37.6	7.12	45.0	36.2	7.81
	62	55.4	51.2	5.29	52.9	50.0	5.85	50.4	48.8	6.46	47.7	47.3	7.11	45.0	45.0	7.80
	57	53.9	53.9	5.27	52.0	52.0	5.83	49.8	49.8	6.44	47.6	47.6	7.10	44.9	44.9	7.80
2000	72	66.2	34.0	5.54	63.9	33.4	6.12	61.0	32.4	6.75	58.0	31.4	7.43	54.5	30.2	8.14
	67	61.6	44.9	5.47	58.9	44.0	6.05	56.1	42.9	6.67	52.8	41.7	7.34	49.6	40.4	8.06
	63††	57.4	43.8	5.43	54.6	42.6	5.99	51.8	41.4	6.60	49.0	40.2	7.25	45.7	38.8	7.94
	62	56.7	55.0	5.42	54.1	53.5	5.98	51.6	51.6	6.59	49.3	49.3	7.26	46.7	46.7	7.98
	57	56.0	56.0	5.42	53.9	53.9	5.98	51.6	51.6	6.59	49.3	49.3	7.26	46.7	46.7	7.97
2250	72	66.2	35.0	5.64	64.3	34.7	6.24	61.0	33.5	6.85	58.1	32.6	7.53	54.6	31.3	8.24
	67	62.2	47.4	5.59	59.5	46.5	6.16	56.7	45.5	6.79	53.4	44.3	7.47	50.2	43.1	8.18
	63††	58.2	46.3	5.55	55.2	45.0	6.12	52.4	43.8	6.72	49.5	42.6	7.38	46.3	41.2	8.08
	62	57.8	57.8	5.55	55.5	55.5	6.12	53.2	53.2	6.74	50.7	50.7	7.41	48.0	48.0	8.13
	57	57.7	57.7	5.56	55.4	55.4	6.12	53.1	53.1	6.74	50.6	50.6	7.41	48.1	48.1	8.13

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Cooling		Indoor Section	Size	Cooling	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	060	0.95	0.99	CK5A/CK5BT	060	0.97	0.95
CC5A/CD5AW	060	0.98	1.00	CK5A/CK5BX	060	0.97	0.93
CE3AA	060	0.98	1.00	COILS + 58CV(A,X)135-22 FURNACE			
CK3BA	060	0.95	0.97	CC5A/CD5AA	060	0.94	0.93
CK5A/CK5BA	060	0.95	0.97	CC5A/CD5AW	060	0.97	0.94
CK5A/CK5BT	060	0.95	0.97	CE3AA	060	0.97	0.94
CK5A/CK5BX	060	0.98	0.99	CK3BA	060	0.97	0.96
F(A,B)4BN(F,B,C)	060	0.97	1.01	CK5A/CK5BA	060	0.97	0.95
FB4BNB	070	1.00	1.00	CK5A/CK5BT	060	0.97	0.95
FC4CN(F,B)	060	0.97	1.02	CK5A/CK5BX	060	0.97	0.93
FC4CNB	070	0.99	1.01	COILS + 58CV(A,X)155-22 FURNACE			
FG3AAA	060	0.96	0.99	CC5A/CD5AA	060	0.94	0.93
FK4DNB	006	1.00	0.97	CC5A/CD5AW	060	0.97	0.94
COILS + 58CV(A,X)110-22 FURNACE				CE3AA	060	0.97	0.93
CC5A/CD5AA	060	0.94	0.93	CK3BA	060	0.97	0.95
CE3AA	060	0.97	0.93	CK5A/CK5BA	060	0.97	0.95
CK3BA	060	0.97	0.95	CK5A/CK5BT	060	0.97	0.95
CK5A/CK5BA	060	0.97	0.95	CK5A/CK5BX	060	0.97	0.92

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

* Detailed cooling capacities are based on indoor and outdoor unit at same elevation per ARI standard 210/240-94. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80°F (27°C) entering air at the indoor coil. For sensible capacities at other than 80°F (27°C), deduct 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80°F (27°C), or add 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air per degree above 80°F (27°C).

** System kW is total of indoor and outdoor unit kilowatts.

†† At TVA rating indoor condition (75°F edb/63°F ewb). All other indoor air temperatures are at 80°F edb.

EWB – Entering Wet Bulb

Heat pump heating performance

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																							
		-3		7		17		27		37		47		57		67									
		Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†								
EDB	CFM	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*								
38AYC018-33, 34 Outdoor Section With F(A,B)4BN(F,C)024 Indoor Section																									
65	550	7.91	7.28	1.18	9.50	8.73	1.22	11.3	10.3	1.27	13.2	11.7	1.33	15.4	14.1	1.40	18.0	18.0	1.50	20.7	20.7	1.62	23.9	23.9	1.80
	650	8.05	7.41	1.20	9.66	8.87	1.24	11.5	10.4	1.28	13.4	11.9	1.33	15.7	14.3	1.40	18.2	18.2	1.49	21.0	21.0	1.62	24.2	24.2	1.79
	750	8.19	7.53	1.22	9.80	9.01	1.25	11.6	10.6	1.29	13.6	12.0	1.34	15.8	14.4	1.41	18.4	18.4	1.50	21.2	21.2	1.63	24.4	24.4	1.80
70	550	7.81	7.19	1.24	9.40	8.64	1.29	11.2	10.2	1.34	13.1	11.6	1.40	15.3	13.9	1.48	17.8	17.8	1.58	20.5	20.5	1.70	23.6	23.6	1.88
	650	7.96	7.32	1.26	9.55	8.78	1.30	11.3	10.3	1.34	13.2	11.8	1.40	15.5	14.1	1.47	18.0	18.0	1.56	20.7	20.7	1.69	23.9	23.9	1.86
	750	8.10	7.45	1.28	9.69	8.91	1.31	11.5	10.5	1.36	13.4	11.9	1.41	15.7	14.3	1.48	18.2	18.2	1.57	20.9	20.9	1.69	24.1	24.1	1.87
75	550	7.69	7.08	1.30	9.30	8.54	1.35	11.0	10.1	1.41	12.9	11.5	1.48	15.1	13.7	1.56	17.6	17.6	1.66	20.3	20.3	1.79	23.3	23.3	1.96
	650	7.85	7.22	1.31	9.45	8.68	1.36	11.2	10.2	1.41	13.1	11.6	1.47	15.3	13.9	1.54	17.8	17.8	1.64	20.5	20.5	1.77	23.6	23.6	1.94
	750	7.99	7.35	1.34	9.59	8.81	1.38	11.4	10.4	1.42	13.3	11.8	1.48	15.5	14.1	1.55	18.0	18.0	1.64	20.7	20.7	1.77	23.8	23.8	1.94

Multippliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Heating		Indoor Section	Size	Heating	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	018	0.98	1.09	FF1DNA	018	0.98	1.02
	024	0.99	1.05		024	1.00	1.00
CC5A/CD5AW	024	0.99	1.05	FG3AAA	024	0.99	1.05
CE3AA	024	0.99	1.03	FK4DNF	001	0.97	0.92
CF5AA	024	1.00	1.03		002	0.97	0.90
CK3BA	024	1.01	1.00	COILS + 58CV(A,X)070-12 FURNACE			
CK5A/CK5BA	018	0.99	1.03	CC5A/CD5AA	024	0.95	0.99
	024	1.01	1.00	CC5A/CD5AW	024	0.95	0.99
CK5A/CK5BW	024	1.01	1.00	CE3AA	024	0.96	0.98
F(A,B)4BN(F,C)	018	0.98	1.05	CK3BA	024	0.97	0.92
	024	1.00	1.00	CK5A/CK5BA	024	0.97	0.92
FC4CNF	024	1.00	1.00	CK5A/CK5BW	024	0.97	0.92

38AYC024-33, 34 Outdoor Section With F(A,B)4BN(F,C)024 Indoor Section

65	700	10.4	9.54	1.50	12.5	11.5	1.57	14.8	13.5	1.64	17.4	15.4	1.73	20.3	18.5	1.83	23.6	23.6	1.95	27.2	27.2	2.11	31.2	31.2	2.29
	800	10.5	9.69	1.52	12.7	11.6	1.58	15.0	13.7	1.65	17.6	15.6	1.73	20.6	18.7	1.82	23.9	23.9	1.94	27.6	27.6	2.09	31.6	31.6	2.27
	900	10.7	9.82	1.54	12.8	11.8	1.60	15.2	13.8	1.67	17.8	15.8	1.74	20.8	18.9	1.83	24.1	24.1	1.94	27.8	27.8	2.09	31.8	31.8	2.26
70	700	10.2	9.34	1.56	12.3	11.3	1.64	14.6	13.3	1.71	17.2	15.3	1.80	20.1	18.3	1.91	23.3	23.3	2.04	26.9	26.9	2.19	30.9	30.9	2.39
	800	10.3	9.50	1.58	12.5	11.5	1.65	14.8	13.5	1.72	17.4	15.4	1.80	20.3	18.5	1.90	23.6	23.6	2.02	27.2	27.2	2.17	31.2	31.2	2.36
	900	10.5	9.65	1.60	12.7	11.6	1.67	15.0	13.7	1.73	17.6	15.6	1.81	20.5	18.7	1.91	23.8	23.8	2.02	27.5	27.5	2.17	31.5	31.5	2.35
75	700	9.90	9.11	1.61	12.2	11.2	1.70	14.5	13.2	1.79	17.0	15.1	1.88	19.8	18.1	1.99	23.0	23.0	2.12	26.6	26.6	2.29	30.5	30.5	2.48
	800	10.1	9.27	1.63	12.3	11.3	1.71	14.6	13.3	1.79	17.2	15.3	1.88	20.1	18.3	1.98	23.3	23.3	2.11	26.9	26.9	2.26	30.9	30.9	2.45
	900	10.3	9.43	1.66	12.5	11.5	1.73	14.8	13.5	1.81	17.4	15.4	1.89	20.3	18.5	1.98	23.6	23.6	2.10	27.2	27.2	2.25	31.1	31.1	2.44

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Heating		Indoor Section	Size	Heating	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	024	1.00	1.04	FC4CNF	024	1.00	1.00
	030	1.00	1.04		030	1.00	0.99
CC5A/CD5AW	024	1.00	1.04	FF1DNA	024	1.00	1.01
	030	1.00	1.04		030	1.00	0.99
CE3AA	024	1.00	1.02	FK4DNF	001	0.98	0.93
	030	1.00	1.00		002	0.98	0.91
CF5AA	024	1.00	1.03	003	0.98	0.91	
CK3BA	024	1.00	0.99	COILS + 58CV(A,X)070-12 FURNACE			
	030	1.00	1.01	CC5A/CD5AA	030	0.99	1.02
CK5A/CK5BA	024	1.00	0.99	CC5A/CD5AW	030	0.99	1.02
	030	1.00	1.01	CE3AA	030	1.01	0.99
CK5A/CK5BW	024	1.00	0.99	CK3BA	030	1.00	0.99
	030	1.00	1.01	CK5A/CK5BA	030	1.00	0.99
F(A,B)4BN(F,C)	024	1.00	1.00	CK5A/CK5BW	030	1.00	0.99
	030	1.00	0.99				

See notes on pg. 27.

Heat pump heating performance continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																									
		-3			7			17			27			37			47			57			67				
		Capacity MBtu/h†		Total Power	Capacity MBtu/h†		Total Power	Capacity MBtu/h†		Total Power	Capacity MBtu/h†		Total Power	Capacity MBtu/h†		Total Power	Capacity MBtu/h†		Total Power	Capacity MBtu/h†		Total Power	Capacity MBtu/h†		Total Power		
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†		
38AYC030-33, 34 Outdoor Section With F(A,B)4BN(F,C)030 Indoor Section																											
65	875	13.3	12.3	1.96	16.0	14.7	2.07	18.9	17.3	2.17	22.0	19.5	2.28	25.6	23.3	2.42	29.6	29.6	2.58	34.0	34.0	2.78	39.0	39.0	3.04		
	1000	13.5	12.5	1.99	16.2	14.9	2.08	19.2	17.5	2.18	22.2	19.8	2.28	25.9	23.6	2.41	30.0	30.0	2.57	34.5	34.5	2.76	39.5	39.5	3.01		
	1125	13.7	12.6	2.02	16.4	15.1	2.11	19.4	17.7	2.20	22.5	20.0	2.29	26.2	23.8	2.42	30.3	30.3	2.57	34.8	34.8	2.75	39.9	39.9	3.00		
70	875	13.0	12.0	2.04	15.8	14.5	2.15	18.7	17.1	2.26	21.7	19.3	2.38	25.3	23.0	2.53	29.2	29.2	2.70	33.6	33.6	2.90	38.4	38.4	3.16		
	1000	13.3	12.2	2.07	16.0	14.7	2.17	18.9	17.3	2.27	22.0	19.5	2.38	25.6	23.3	2.52	29.6	29.6	2.68	34.0	34.0	2.88	38.9	38.9	3.12		
	1125	13.5	12.4	2.10	16.2	14.9	2.20	19.2	17.5	2.29	22.2	19.7	2.39	25.9	23.5	2.52	29.9	29.9	2.67	34.4	34.4	2.87	39.3	39.3	3.11		
75	875	12.7	11.7	2.12	15.6	14.3	2.24	18.5	16.9	2.36	21.5	19.1	2.49	25.0	22.7	2.64	28.9	28.9	2.82	33.2	33.2	3.03	37.9	37.9	3.29		
	1000	12.9	11.9	2.14	15.8	14.5	2.26	18.7	17.1	2.37	21.7	19.3	2.48	25.3	23.0	2.63	29.2	29.2	2.79	33.6	33.6	2.99	38.4	38.4	3.24		
	1125	13.1	12.1	2.17	16.0	14.7	2.28	18.9	17.3	2.39	22.0	19.5	2.50	25.5	23.2	2.63	29.5	29.5	2.79	33.9	33.9	2.98	38.8	38.8	3.23		

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Heating		Indoor Section	Size	Heating	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	030	0.98	1.02	FF1DNA	030	0.99	0.98
	036	0.99	0.98	FG3AAA	036	0.99	0.99
CC5A/CD5AW	030	0.98	1.02	FK4DNF	001	0.97	0.93
	036	0.99	0.98		002	0.97	0.91
CE3AA	030	0.99	0.99		003	0.97	0.91
	036	0.99	0.99	COILS + 58CV(A,X)070-12 FURNACE			
CF5AA	036	0.99	0.99	CC5A/CD5AA	036	0.99	0.96
CK3BA	030	0.98	0.99	CE3AA	036	0.99	0.99
	036	0.99	0.96	CK3BA	036	0.99	0.95
CK5A/CK5BA	030	0.98	0.99	CK5A/CK5BA	036	0.99	0.95
	036	0.99	0.96	CK5A/CK5BT	036	0.99	0.95
CK5A/CK5BT	036	0.99	0.96	COILS + 58CV(A,X)090-16 FURNACE			
CK5A/CK5BW	030	0.98	0.99	CC5A/CD5AA	036	0.99	0.96
	036	0.99	0.96	CC5A/CD5AW	036	0.99	0.96
F(A,B)4BN(F,C)	030	1.00	1.00	CE3AA	036	0.99	0.98
	036	1.00	0.99	CK3BA	036	0.99	0.94
FC4CNF	030	1.00	1.00	CK5A/CK5BA	036	0.99	0.94
	036	1.00	0.99	CK5A/CK5BW	036	0.99	0.94

See notes on pg. 27.

Heat pump heating performance continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																							
		-3			7			17			27			37			47			57			67		
		Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†	Capacity MBtu/h†	Total Power kW†				
EDB	CFM	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*		
38AYC036-33, 34 Outdoor Section With F(A,B)4BN(F,C)036 Indoor Section																									
65	1050	15.7	14.5	2.30	19.2	17.6	2.42	22.6	20.6	2.54	26.3	23.4	2.67	30.5	27.8	2.83	35.1	35.1	3.01	40.4	40.4	3.23	46.4	46.4	3.51
	1200	16.0	14.7	2.34	19.4	17.9	2.45	22.9	20.9	2.56	26.6	23.6	2.68	30.9	28.1	2.83	35.6	35.6	2.99	41.0	41.0	3.20	47.0	47.0	3.47
	1350	16.3	15.0	2.38	19.7	18.1	2.48	23.2	21.1	2.59	26.9	23.9	2.70	31.2	28.4	2.84	35.9	35.9	3.00	41.4	41.4	3.20	47.5	47.5	3.46
70	1050	15.3	14.1	2.39	18.9	17.3	2.52	22.4	20.4	2.66	26.0	23.1	2.79	30.2	27.5	2.96	34.8	34.8	3.15	39.9	39.9	3.37	45.8	45.8	3.66
	1200	15.7	14.4	2.43	19.2	17.6	2.55	22.7	20.7	2.67	26.3	23.4	2.80	30.6	27.8	2.95	35.2	35.2	3.13	40.4	40.4	3.34	46.4	46.4	3.61
	1350	15.9	14.7	2.47	19.4	17.9	2.58	22.9	20.9	2.70	26.6	23.7	2.82	30.9	28.1	2.96	35.6	35.6	3.12	40.9	40.9	3.33	47.0	47.0	3.59
75	1050	14.9	13.7	2.48	18.5	17.0	2.62	22.1	20.2	2.77	25.7	22.9	2.92	29.9	27.2	3.09	34.4	34.4	3.29	39.5	39.5	3.52	45.2	45.2	3.82
	1200	15.2	14.0	2.52	18.8	17.3	2.64	22.4	20.4	2.79	26.1	23.1	2.92	30.2	27.5	3.08	34.8	34.8	3.26	40.0	40.0	3.48	45.9	45.9	3.77
	1350	15.5	14.3	2.56	19.1	17.6	2.68	22.7	20.7	2.81	26.4	23.4	2.94	30.6	27.8	3.09	35.2	35.2	3.26	40.4	40.4	3.47	46.4	46.4	3.74

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Heating		Indoor Section	Size	Heating	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	036	0.99	0.98	CE3AA	042	0.97	0.92
	042	0.99	0.98	CK3BA	042	0.97	0.91
CC5A/CD5AW	036	0.99	0.98	CK5A/CK5BA	042	0.97	0.91
	042	0.99	0.99	CK5A/CK5BE	042	0.97	0.90
CE3AA	036	0.99	0.99	CK5A/CK5BT	042	0.97	0.91
	042	1.00	0.96	COILS + 58CV(A,X)110-22 FURNACE			
CF5AA	036	0.99	0.98	CC5A/CD5AA	042	0.97	0.93
CK3BA	036	1.00	0.96	CC5A/CD5AW	042	0.97	0.94
	042	1.00	0.96	CE3AA	042	0.97	0.91
CK5A/CK5BA	036	1.00	0.96	CK3BA	042	0.97	0.91
	042	1.00	0.96	CK5A/CK5BA	042	0.97	0.91
CK5A/CK5BT	036	1.00	0.96	CK5A/CK5BT	042	0.97	0.91
	042	1.00	0.96	COILS + 58CV(A,X)135-22 FURNACE			
CK5A/CK5BW	036	1.00	0.96	CC5A/CD5AA	042	0.97	0.93
F(A,B)4BN(F,B,C)	042	1.00	0.97	CC5A/CD5AW	042	0.97	0.94
F(A,B)4BN(F,C)	036	1.00	1.00	CE3AA	042	0.97	0.92
FC4CN(F,B)	042	1.00	0.97	CK3BA	042	0.97	0.91
FC4CNF	036	1.00	1.00	CK5A/CK5BA	042	0.97	0.91
FG3AAA	036	0.99	0.99	CK5A/CK5BT	042	0.97	0.91
FK4DNF	001	0.97	0.95	COILS + 58CV(A,X)155-22 FURNACE			
	002	0.98	0.93	CC5A/CD5AA	042	0.97	0.92
	003	0.97	0.91	CC5A/CD5AW	042	0.96	0.93
COILS + 58CV(A,X)070-12 FURNACE				CE3AA	042	0.97	0.91
CE3AA	042	0.97	0.93	CK3BA	042	0.97	0.90
CK5A/CK5BE	042	0.97	0.91	CK5A/CK5BT	042	0.97	0.90
COILS + 58CV(A,X)090-16 FURNACE					—	—	—
CC5A/CD5AA	042	0.97	0.93				

See notes on pg. 27.

Heat pump heating performance continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																															
		-3				7				17				27				37				47				57				67			
		Capacity MBtu/h†		Total Power		Capacity MBtu/h†		Total Power		Capacity MBtu/h†		Total Power		Capacity MBtu/h†		Total Power		Capacity MBtu/h†		Total Power		Capacity MBtu/h†		Total Power		Capacity MBtu/h†		Total Power					
EDB	CFM	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†	Total	Integ*	kW†					
38AYC042-33, 34 Outdoor Section With F(A,B)4BN(F,B,C)042 Indoor Section																																	
65	1225	19.3	17.7	2.65	23.2	21.3	2.80	27.3	24.9	2.94	31.7	28.1	3.09	36.8	33.4	3.28	42.5	42.5	3.50	49.1	49.1	3.79	56.5	56.5	4.16								
	1400	19.6	18.0	2.70	23.5	21.6	2.83	27.7	25.2	2.97	32.1	28.5	3.11	37.2	33.9	3.28	43.0	43.0	3.49	49.7	49.7	3.77	57.2	57.2	4.12								
	1575	19.9	18.3	2.75	23.8	21.9	2.88	28.0	25.5	3.00	32.4	28.8	3.13	37.6	34.2	3.30	43.5	43.5	3.50	50.2	50.2	3.77	57.8	57.8	4.12								
70	1225	18.8	17.3	2.75	22.9	21.0	2.91	27.0	24.6	3.07	31.4	27.8	3.23	36.3	33.1	3.42	42.0	42.0	3.66	48.5	48.5	3.95	55.8	55.8	4.33								
	1400	19.2	17.7	2.80	23.2	21.3	2.95	27.4	24.9	3.09	31.7	28.2	3.24	36.8	33.5	3.42	42.5	42.5	3.64	49.1	49.1	3.92	56.5	56.5	4.29								
	1575	19.5	18.0	2.85	23.5	21.6	2.99	27.7	25.3	3.13	32.1	28.5	3.27	37.2	33.9	3.44	43.0	43.0	3.65	49.6	49.6	3.92	57.1	57.1	4.28								
75	1225	18.4	16.9	2.85	22.6	20.8	3.03	26.7	24.4	3.20	31.0	27.6	3.37	36.0	32.7	3.58	41.5	41.5	3.82	47.9	47.9	4.12	55.1	55.1	4.51								
	1400	18.7	17.2	2.90	23.8	21.9	3.07	27.1	24.7	3.22	31.4	27.9	3.38	36.4	33.1	3.57	42.0	42.0	3.80	48.5	48.5	4.09	55.8	55.8	4.46								
	1575	19.1	17.6	2.95	23.2	21.4	3.11	27.4	25.0	3.25	31.8	28.2	3.41	36.8	33.5	3.58	42.5	42.5	3.80	49.0	49.0	4.08	56.4	56.4	4.44								

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Heating		Indoor Section	Size	Heating	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	042	0.99	0.99	CK5A/CK5BT	048	0.99	0.94
CC5A/CD5AC	048	0.99	1.02	COILS + 58CV(A,X)110-22 FURNACE			
CC5A/CD5AW	042	1.02	1.04	CC5A/CD5AC	048	0.99	1.01
	048	1.00	0.99	CC5A/CD5AW	048	0.99	0.95
CD5AA	048	1.00	0.99	CD5AA	048	0.99	0.95
CE3AA	042	1.00	0.98	CE3AA	048	0.99	0.94
	048	1.00	0.97	CK3BA	048	0.99	0.93
CF5AA	048	0.99	0.98	CK5A/CK5BA	048	0.99	0.93
CK3BA	042	0.99	0.97	CK5A/CK5BT	048	0.99	0.93
	048	1.00	0.97	CK5A/CK5BW	048	0.99	0.93
CK5A/CK5BA	042	0.99	0.97	COILS + 58CV(A,X)135-22 FURNACE			
	048	1.00	0.97	CC5A/CD5AC	048	0.99	1.01
CK5A/CK5BE	042	0.96	0.94	CC5A/CD5AW	048	0.99	0.95
CK5A/CK5BT	042	0.96	0.95	CD5AA	048	0.99	0.95
	048	0.96	0.94	CE3AA	048	0.99	0.94
CK5A/CK5BW	048	1.00	0.97	CK3BA	048	0.99	0.93
F(A,B)4BN(F,B,C)	042	1.00	1.00	CK5A/CK5BA	048	0.99	0.93
	048	1.01	0.97	CK5A/CK5BT	048	0.99	0.93
FC4CN(F,B)	042	1.00	1.00	CK5A/CK5BW	048	0.99	0.93
	048	1.01	0.97	COILS + 58CV(A,X)155-22 FURNACE			
FG3AAA	048	1.00	0.98	CC5A/CD5AC	048	0.99	1.01
FK4DNF	003	0.98	0.94	CC5A/CD5AW	048	0.99	0.95
COILS + 58CV(A,X)090-16 FURNACE				CD5AA	048	0.99	0.95
CC5A/CD5AC	048	0.99	1.01	CE3AA	048	0.99	0.94
CD5AA	048	0.99	0.96	CK3BA	048	0.99	0.93
CE3AA	048	0.99	0.95	CK5A/CK5BA	048	0.99	0.93
CK3BA	048	0.99	0.94	CK5A/CK5BT	048	0.99	0.93
CK5A/CK5BA	048	0.99	0.94	CK5A/CK5BW	048	0.99	0.93

See notes on pg. 27.

Heat pump heating performance continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																							
		-3			7			17			27			37			47			57			67		
		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†	
EDB	CFM	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*	Total	Integ*
38AYC048-33, 34 Outdoor Section With F(A,B)4BN(F,B,C)048 Indoor Section																									
65	1400	22.2	20.4	3.14	26.7	24.6	3.29	31.3	28.5	3.43	36.1	32.0	3.57	41.7	37.9	3.74	48.0	48.0	3.94	55.2	55.2	4.20	63.5	63.5	4.54
	1600	22.6	20.8	3.18	27.1	24.9	3.31	32.9	30.0	3.44	36.5	32.4	3.55	42.2	38.4	3.71	48.5	48.5	3.89	55.9	55.9	4.13	64.3	64.3	4.45
	1800	22.9	21.1	3.22	27.4	25.2	3.34	32.0	29.2	3.45	36.8	32.7	3.56	42.6	38.7	3.70	49.0	49.0	3.87	56.5	56.5	4.10	65.0	65.0	4.40
70	1400	21.7	19.9	3.28	26.4	24.2	3.44	31.0	28.3	3.60	35.7	31.7	3.75	41.2	37.5	3.93	47.4	47.4	4.14	54.6	54.6	4.42	62.7	62.7	4.77
	1600	22.1	20.3	3.31	26.8	24.6	3.46	31.4	28.6	3.60	36.1	32.1	3.73	41.7	38.0	3.90	48.0	48.0	4.09	55.3	55.3	4.34	63.5	63.5	4.67
	1800	22.4	20.6	3.35	27.1	24.9	3.49	31.7	28.9	3.62	36.5	32.4	3.74	42.1	38.3	3.89	48.5	48.5	4.07	55.8	55.8	4.30	64.2	64.2	4.61
75	1400	21.1	19.4	3.41	25.9	23.8	3.59	30.7	28.0	3.77	35.4	31.4	3.94	40.8	37.1	4.13	46.9	46.9	4.36	53.9	53.9	4.64	61.8	61.8	5.00
	1600	21.5	19.8	3.44	26.3	24.2	3.61	31.1	28.3	3.77	35.7	31.7	3.92	41.3	37.6	4.09	47.5	47.5	4.30	54.6	54.6	4.56	62.7	62.7	4.90
	1800	21.9	20.1	3.49	26.7	24.5	3.64	31.4	28.6	3.79	36.1	32.1	3.92	41.7	37.9	4.08	47.9	47.9	4.27	55.2	55.2	4.52	63.4	63.4	4.84

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Heating		Indoor Section	Size	Heating	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	060	1.00	1.06	FK4DNF	005	1.00	0.95
CC5A/CD5AC	048	1.00	1.11	COILS + 58CV(A,X)090-16 FURNACE			
CC5A/CD5AW	048	1.00	1.04	CE3AA	060	1.00	1.01
	060	1.00	1.00	COILS + 58CV(A,X)110-22 FURNACE			
CD5AA	048	1.00	1.04	CC5A/CD5AA	060	1.00	1.06
CE3AA	048	1.00	1.02	CE3AA	060	1.00	0.99
	060	1.00	0.99	CK3BA	060	1.00	0.96
CF5AA	048	1.00	1.06	CK5A/CK5BA	060	1.00	0.96
CK3BA	048	1.00	1.01	CK5A/CK5BT	060	1.00	0.96
	060	1.00	0.97	CK5A/CK5BX	060	1.00	0.95
CK5A/CK5BA	048	1.00	1.01	COILS + 58CV(A,X)135-22 FURNACE			
	060	1.00	0.97	CC5A/CD5AA	060	1.00	1.06
CK5A/CK5BT	048	1.00	1.01	CC5A/CD5AW	060	1.00	1.00
	060	1.00	0.97	CE3AA	060	1.00	1.00
CK5A/CK5BW	048	1.00	1.01	CK3BA	060	1.00	0.96
CK5A/CK5BX	060	1.00	0.96	CK5A/CK5BA	060	1.00	0.96
F(A,B)4BN(F,B,C)	048	1.00	1.00	CK5A/CK5BT	060	1.00	0.96
	060	1.00	0.98	CK5A/CK5BX	060	1.00	0.96
FB4BNB	070	1.00	0.93	COILS + 58CV(A,X)155-22 FURNACE			
FC4CN(F,B)	048	1.00	1.00	CC5A/CD5AA	060	1.00	1.06
	060	1.00	0.98	CC5A/CD5AW	060	1.00	0.99
FC4CNB	054	1.00	0.93	CE3AA	060	1.00	0.99
	070	1.00	0.93	CK3BA	060	1.00	0.96
FG3AAA	048	1.00	1.02	CK5A/CK5BA	060	1.00	0.96
	060	1.00	1.01	CK5A/CK5BT	060	1.00	0.96
FK4DNB	006	1.00	0.91	CK5A/CK5BX	060	1.00	0.95

See notes on pg. 27.

Heat pump heating performance continued

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F																									
		-3			7			17			27			37			47			57			67				
		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†		Capacity MBtu/h†	Total Power kW†			
EDB	CFM	Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*		Total	Integ*			
38AYC060-33, 34 Outdoor Section With FB4BNB070 Indoor Section																											
65	1750	28.6	26.3	4.31	33.8	31.0	4.48	39.4	35.9	4.65	45.5	40.4	4.85	52.6	47.9	5.09	60.7	60.7	5.38	70.0	70.0	5.76	80.7	80.7	6.25		
	2000	29.1	26.7	4.37	34.2	31.4	4.52	39.9	36.3	4.68	46.0	40.8	4.85	53.2	48.4	5.07	61.4	61.4	5.34	71.5	71.5	5.71	81.4	81.4	6.12		
	2250	29.5	27.1	4.44	34.6	31.8	4.57	40.3	36.7	4.72	46.5	41.3	4.88	53.7	48.9	5.08	62.0	62.0	5.35	71.6	71.6	5.71	81.1	81.1	6.02		
70	1750	28.2	25.9	4.48	33.5	30.8	4.68	39.0	35.6	4.87	45.0	40.0	5.08	52.0	47.4	5.33	60.0	60.0	5.63	69.2	69.2	6.03	79.7	79.7	6.53		
	2000	28.6	26.3	4.54	33.9	31.2	4.72	39.5	36.0	4.89	45.6	40.5	5.08	52.7	47.9	5.31	60.7	60.7	5.59	70.1	70.1	5.96	80.7	80.7	6.46		
	2250	29.1	26.7	4.61	34.3	31.5	4.78	39.9	36.4	4.94	46.0	40.9	5.11	53.2	48.4	5.32	61.3	61.3	5.59	70.7	70.7	5.95	81.0	81.0	6.33		
75	1750	27.6	25.4	4.67	33.2	30.5	4.89	38.7	35.3	5.10	44.6	39.6	5.32	51.5	46.9	5.59	59.3	59.3	5.90	68.4	68.4	6.30	78.7	78.7	6.82		
	2000	28.1	25.8	4.72	33.6	30.9	4.93	39.2	35.7	5.12	45.1	40.1	5.32	52.2	47.5	5.56	60.1	60.1	5.85	69.3	69.3	6.23	79.8	79.8	6.74		
	2250	28.5	26.3	4.79	34.0	31.3	4.99	39.6	36.1	5.16	45.6	40.5	5.34	52.7	47.9	5.57	60.6	60.6	5.84	70.0	70.0	6.21	80.5	80.5	6.70		

Multipliers for Determining the Performance With Other Indoor Sections

Indoor Section	Size	Heating		Indoor Section	Size	Heating	
		Capacity	Power			Capacity	Power
CC5A/CD5AA	060	1.00	1.13	CK5A/CK5BT	060	1.00	1.03
CC5A/CD5AW	060	1.00	1.04	CK5A/CK5BX	060	1.00	1.02
CE3AA	060	1.00	1.04	COILS + 58CV(A,X)135-22 FURNACE			
CK3BA	060	1.00	1.08	CC5A/CD5AA	060	1.00	1.14
CK5A/CK5BA	060	1.00	1.08	CC5A/CD5AW	060	1.00	1.07
CK5A/CK5BT	060	1.00	1.08	CE3AA	060	1.00	1.06
CK5A/CK5BX	060	1.00	1.04	CK3BA	060	1.00	1.03
F(A,B)4BN(F,B,C)	060	1.00	1.04	CK5A/CK5BA	060	1.00	1.03
FB4BNB	070	1.00	1.00	CK5A/CK5BT	060	1.00	1.03
FC4CN(F,B)	060	1.00	1.04	CK5A/CK5BX	060	1.00	1.02
FC4CNB	070	1.00	1.01	COILS + 58CV(A,X)155-22 FURNACE			
FG3AAA	060	1.00	1.06	CC5A/CD5AA	060	1.00	1.14
FK4DNB	006	1.00	0.97	CC5A/CD5AW	060	1.00	1.06
COILS + 58CV(A,X)110-22 FURNACE				CE3AA	060	1.00	1.06
CC5A/CD5AA	060	1.00	1.14	CK3BA	060	1.00	1.02
CE3AA	060	1.00	1.06	CK5A/CK5BA	060	1.00	1.02
CK3BA	060	1.00	1.03	CK5A/CK5BT	060	1.00	1.02
CK5A/CK5BA	060	1.00	1.03	CK5A/CK5BX	060	1.00	1.02

NOTE: When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

* The Btu/h heating capacity values shown are net integrated values from which the defrost effect has been subtracted. The Btu/h heating from supplement heaters should be added to those values to obtain total system capacity.

† The kW values include the compressor, outdoor fan motor, and indoor blower motor. The kW from supplement heaters should be added to these values to obtain total system kilowatts.

EDB – Entering Dry-Bulb

System Design

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. Minimum outdoor operating air temperature for cooling mode without low-ambient operation accessory is 55°F (12.8°C).
3. Maximum outdoor operating air temperature for cooling mode is 125°F (51.7°C).
4. Minimum outdoor operating air temperature for heating mode is -30°F (-34.4°C).
5. Maximum outdoor operating air temperature for heating mode is 66°F (18.9°C).
6. For reliable operation, unit should be level in all horizontal planes.
7. Maximum elevation of indoor coil above or below base of outdoor unit is: indoor coil above = 50 ft, indoor coil below = 150 ft.
8. For interconnecting refrigerant tube lengths greater than 50 ft horizontal or 20 ft vertical differential, consult Residential Split-System Long-Line Application Guideline available from equipment distributor.
9. For more than 36 in. of refrigerant tubing buried in the ground, consult your local distributor.
10. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.
11. Mismatches of indoor coil capacity more than 1 size larger than outdoor unit capacity may result in inadequate indoor comfort.

Guide specifications

**Air-Cooled, Split-System
Heat Pump
38AYC
1-1/2 to 5 Tons Nominal**

GENERAL

System Description

Outdoor-mounted, air-cooled, split-system heat pump unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

Unit will be rated in accordance with the latest edition of ARI Standard 240.

Unit will be certified for capacity and efficiency, and listed in the latest ARI directory.

Unit construction will comply with latest edition of ANSI/ASHRAE and with NEC.

Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have C-UL approval.

Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.

Air-cooled condenser coils will be leak tested at 217 psig and pressure tested at 450 psig.

Delivery, Storage, and Handling

Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

Warranty (for inclusion by specifying engineer)

U.S. and Canada only.

PRODUCTS

Equipment

Factory-assembled, single-piece, air-cooled heat pump unit. Contained within the unit enclosure will be all factory wiring, piping, controls, compressor, refrigerant charge (Puron®), and special features required prior to field start-up.

Unit Cabinet

Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

Fans

Condenser fan will be direct-drive propeller type, discharging air upward.

Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated bearings.

Shafts will be corrosion resistant.

Fan blades will be statically and dynamically balanced.

Condenser fan openings will be equipped with steel wire safety guards.

Compressor

Compressor will be hermetically sealed.

Compressor will be mounted on rubber vibration isolators.

Condenser Coil

Condenser coil will be air cooled.

Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

Refrigeration Components

Refrigeration circuit components will include liquid tube shutoff valve with sweat connections, suction tube shutoff valves with sweat connections, system charge of Puron® refrigerant, POE compressor oil, accumulator, and reversing valve.

Operating Characteristics

The capacity of the unit will meet or exceed ____ Btuh at a suction temperature of ____ °F. The power consumption at full load will not exceed ____ kW.

Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of ____ Btuh or greater at conditions of ____ CFM entering air temperature at the evaporator at ____ °F wet bulb and ____ °F dry bulb, and air entering the unit at ____ °F.

The system will have a SEER of ____ Btuh/watt or greater at DOE conditions.

Electrical Requirements

Nominal unit electrical characteristics will be ____ v, ____ phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of ____ v to ____ v.

Unit electrical power will be single point connection.

Control circuit will be 24v.

Special Features

Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.

