

**24VNA9 Infinity® 19VS
Variable Speed Air Conditioner
with Puron® Refrigerant
2 – 5 Ton**



Product Data



INFINITY® 19VS

The Infinity 19VS air conditioner offers high-efficiency variable speed performance in a remarkably small cabinet and provides up to 19 SEER cooling efficiency. The variable speed inverter capacity control delivers up to 5 stages of operation for exceptional load matching, dehumidification and zoning performance.

This product has been designed and manufactured to provide flexible system matching and work with a wide variety of indoor units and controls.

NOTE: Ratings contained in this document are subject to change at any time. Always refer to the AHRI directory (www.ahridirectory.org) for the most up-to-date ratings information.

INDUSTRY LEADING FEATURES / BENEFITS

Energy Efficiency

- Up to 19 SEER / up to 12.5 EER
- Microtube Technology™ refrigeration system

Sound

- Sound level as low as 56 dBA in low speed (Silencer System II).
- Soft start and smooth ramp to operating speeds

Comfort

- Variable speed compressor operates at 5 stages with capacity range from as wide as 25-100%
- Air cooled Inverter variable speed drive
 - System requires Infinity Touch Control with version 11 software or newer for 5 stage operation
 - Ratings provided with 2-stage thermostats and suitable non-communicating indoor products for 2-stage operation.

Reliability

- Puron® refrigerant - environmentally sound, won't deplete the ozone layer and low lifetime service cost.
- Front-seating service valves
- Inverter control drives compressor and fan motor
- No control module attached to fan motor
- Infinity intelligence monitors critical system parameters
- Pressure equalizer valve for easy compressor starting
- High pressure switch
- Suction pressure transducer
- Compressor discharge temperature sensor
- Suction temperature sensor
- Filter drier (field installed)
- Internal crankcase heater standard

Flexibility and installation:

- 2 control wires to outdoor unit in complete Infinity system and Touch Control
- Smaller and lighter than 2-stage units
- Minimum and Maximum adjustments with Infinity Touch Control
- Compatible with non-communicating thermostats

Durability

WeatherArmor Ultra™ protection package:

- Solid, Durable sheet metal construction
- Steel louver coil guard
- Baked-on, complete outer coverage, powder paint

Applications

- Line sets up to 100 ft (30.5 m) equivalent length
- No long-line accessories required.

MODEL NUMBER NOMENCLATURE

1 N	2 N	3 A	4 A	5 A/N	6 N	7 N	8 N	9 A/N	10 A/N	11 A/N	12 N	13 N
2	4	V	N	A	9	3	6	A	0	0	3	0
Product Series	Product Family	Tier	Major Series	SEER	Cooling Capacity	Variations	Open	Open	Voltage	Minor Series		
24 = AC	V = VS HP	N = Infinity Series	A = Puron	9 = 19 SEER	1,000 Btuh (nominal)	A = Standard B = Design Variation	0 = Not Defined	0 = Not Defined	3 = 208/230-1	0, 1, 2...		



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.



STANDARD FEATURES

FEATURES	Unit Size – Voltage, Series				
	24A–30 24B–30	25–30	36–30	48–30	60–30
Puron Refrigerant	X	X	X	X	X
Variable Speed Rotary Compressor	X	X	X	X	X
Air–Cooled Integrated Inverter Drive	X	X	X	X	X
Louvered Coil Guard	X	X	X	X	X
Field Installed Filter Drier	X	X	X	X	X
Front Seating Service Valves	X	X	X	X	X
Internal Pressure and Temperature Protection	X	X	X	X	X
Suction Pressure Transducer	X	X	X	X	X
High Pressure Switch	X	X	X	X	X
Internal Crankcase Heater	X	X	X	X	X
Enhanced Diagnostics with Infinity Touch™ Control (version 11 software or newer)	X	X	X	X	X
Deluxe Sound Blanket	X	X	X	X	X
Outdoor Air Temperature Sensor	X	X	X	X	X

X = Standard

REFRIGERANT PIPING LENGTH LIMITATIONS

Maximum Line Lengths:

The maximum allowable total equivalent length for air conditioners can vary depending on the vertical separation. See the tables below for allowable lengths depending on whether the outdoor unit is on the same level, above or below the outdoor unit.

Maximum Line Lengths for Air Conditioner Applications

	MAXIMUM ACTUAL LENGTH ft (m)	MAXIMUM EQUIVALENT LENGTH† ft (m)	MAXIMUM VERTICAL SEPARATION ft (m)
Units on equal level	100 (30.5)	100 (30.5)	N/A
Outdoor unit ABOVE indoor unit	100 (30.5)	100 (30.5)	100 (30.5)
Outdoor unit BELOW indoor unit	See Table 'Maximum Total Equivalent Length: Outdoor Unit BELOW Indoor Unit'		

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

Maximum Total Equivalent Length† - Outdoor Unit BELOW Indoor Unit

Size	Liquid Line Diameter w/ TXV	AC with Puron® Refrigerant – Maximum Total Equivalent Length†						
		Vertical Separation ft (m) Outdoor unit BELOW indoor unit;						
		0–20 (0 – 6.1)	21–30 (6.4 – 9.1)	31–40 (9.4 – 12.2)	41–50 (12.5 – 15.2)	51–60 (15.5 – 18.3)	61–70 (18.6 – 21.3)	71–80 (21.6 – 24.4)
2–Ton	3/8	100*	100*	100*	100*	100*	100*	100*
3–Ton	3/8	100*	100*	100*	100*	100*	100*	100*
4–Ton	3/8	100*	100*	100*	100*	100	100	--
5–Ton	3/8	100*	100*	100*	100*	100	100	--

* Maximum actual length not to exceed 100 ft (30.5 m)

† Total equivalent length accounts for losses due to elbows or fitting.

-- = outside acceptable range

LONG LINE APPLICATIONS

Unit is approved for up to 100 ft (30.5 m) equivalent length and vertical separations shown above with no additional accessories. Longer line set applications are not permitted.

COOLING CAPACITY LOSS TABLE

Nominal Size (Btuh)	Line OD (in.)	24VNA9 Cooling Capacity Loss (%)				
		Total Equivalent Line Length (ft)				
		25	50	75	80	100
24B–30	5/8	0.5	1.2	1.8	1.9	2.4
	3/4	0.1	0.4	0.6	0.7	0.8
24A–30 25–30	5/8	0.5	1.2	1.8	1.9	2.4
	3/4	0.1	0.4	0.6	0.7	0.8
	7/8	0.0	0.1	0.3	0.3	0.4
36–30	5/8	1.1	2.4	3.7	4.0	5.0
	3/4	0.3	0.8	1.3	1.4	1.8
	7/8	0.0	0.3	0.5	0.6	0.8
48–30	3/4	0.7	1.6	2.4	2.6	3.2
	7/8	0.3	0.7	1.1	1.2	1.6
	1 1/8	0.0	0.1	0.2	0.3	0.4
60–30	3/4	1.0	2.3	3.5	3.8	4.8
	7/8	0.4	1.0	1.7	1.8	2.3
	1 1/8	0.0	0.1	0.3	0.4	0.5

Rating Line Size in **BOLD**

MIN/MAX AIRFLOW TABLES

The indoor airflow delivered by this system varies significantly based on outdoor temperature, indoor unit combination, and system demand. The airflows on these tables are for duct design considerations. Duct systems capable of these ranges will ensure

the system will deliver full capacity at all outdoor temperatures. Minimum and maximum airflows can be adjusted from these numbers in the Infinity Control Setup screen.

Cooling – Comfort Mode			Minimum Cooling (Dehum or Zoning)
Size	Max Capacity Airflow	Highest Min Capacity Airflow	
2–Ton	739	263	222
3–Ton	990	289	236
4–Ton	1389	542	457
5–Ton	1600	700	600

Cooling – Efficiency Mode		
Size	Max Capacity Airflow	Highest Min Capacity Airflow
2–Ton	825	585
3–Ton	1050	600
4–Ton	1400	875
5–Ton	1800	975

LEGEND::

Max Capacity Airflow – Stage 5 airflow varies depending on conditions. This is the highest airflow the system will attempt to deliver in this particular mode. Ductwork for non-zoned systems should be sized for this airflow to ensure the system can deliver full capacity when needed. Improper duct design may result in excessive airflow noise and/or cutback occurrences at max airflow conditions.

Highest Min. Capacity Airflow – Stage 1 airflow also varies depending on conditions. In zoned systems, each zone must be capable of delivering this airflow for the system to deliver full capacity into the zone. Otherwise, airflow may be diverted to other zones or cutback may occur.

Min Cooling (Dehum or Zoning) – Lowest airflow the system will deliver. May operate down to this airflow in dehumidification mode or in zoning applications where ductwork restrictions have caused the blower to cut-back.

PHYSICAL DATA

UNIT SIZE SERIES	24A–30	24B–30	25–30	36–30	48–30	60–30
Operating Weight lb (kg)	160 (72.6)	135 (61.2)	160 (72.6)	160 (72.6)	216 (98.0)	241 (109.3)
Shipping Weight lb (kg)	186 (84.4)	158 (71.7)	186 (84.4)	186 (84.4)	255 (115.7)	282 (127.9)
Compressor Type	Variable Speed Rotary					
REFRIGERANT	Puron® (R-410A)					
Control	TXV (Puron® Hard Shutoff)					
Charge lb (kg)	5.5 (2.50)	4.80 (2.18)	5.5 (2.50)	6.0 (2.72)	7.5 (3.40)	8.30 (3.76)
COND FAN	Forward Swept Propeller Type, Direct Drive					
Air Discharge	Vertical					
Air Qty (CFM)	2500	2500	2500	2500	4500	4500
Motor HP	1/3	1/5	1/3	1/3	1/3	1/3
Motor RPM	1050	825	1050	1050	850	900
COND COIL						
Face Area (Sq ft)	13.90	11.12	13.90	13.90	21.50	23.65
Fins per In.	20	20	20	20	20	20
Rows	1	1	1	1	1	1
Circuits	6	6	6	6	8	8
VALVE CONNECT. (In. ID)						
Vapor	3/4	5/8	3/4	3/4	7/8	7/8
Liquid	3/8					
REFRIGERANT TUBES (In. OD)						
Rated Vapor*	7/8	3/4	7/8	7/8	1–1/8	1–1/8
Max Liquid Line	3/8					

* Units are rated with 25 ft (7.6 m) of lineset length. See Vapor Line Sizing and Cooling Capacity Loss table when using other sizes and lengths of lineset.

Note: See unit Installation Instruction for proper installation.

ELECTRICAL DATA

UNIT SIZE – VOLTAGE, SERIES	V/PH	OPER VOLTS*		COMPR		FAN	MCA	MAX FUSE ** or CKT BRK AMPS
		MAX	MIN	LRA	RLA	FLA		
24A-30	208-230-1	253	197	N/A	17.7	1.20	23.6	40
24B-30				N/A	10.32	0.58	13.5	20
25-30				N/A	17.7	1.20	23.6	40
36-30				N/A	18.3	1.20	24.4	40
48-30				N/A	23.9	1.20	31.4	50
60-30				N/A	31.3	1.40	40.8	60

* Permissible limits of the voltage range at which the unit will operate satisfactorily

** Time-Delay fuse.

FLA – Full Load Amps

LRA – Locked Rotor Amps

MCA – Minimum Circuit Amps

RLA – Rated Load Amps

NOTE: Control circuit is 24-V on all units and requires external power source. Copper wire must be used from service disconnect to unit.

All motors/compressors contain internal overload protection.

Complies with 2010 requirements of ASHRAE Standards 90.1

CHARGING SUBCOOLING (TXV-TYPE EXPANSION DEVICE)

UNIT SIZE – VOLTAGE, SERIES	If a Touch Control is installed, subcooling recommendation displayed in Charging Mode must be followed. If not, subcooling chart shown on the charging label must be followed
24A-30, 24B-30	
25-30	
36-30	
48-30	
60-30	

RPM-CAPACITY-SOUND (dBA)*

STAGE #	COMP RPM	CAPACITY %	SOUND (dBA)
24VNA924A			
1	1200	36%	56
2	1900	58%	61
3	2400	73%	64
4	2600	79%	68
5	3300	100%	71
24VNA924B			
1	1500	35%	55
2	2566	56%	60
3	3150	69%	65
4	3950	87%	66
5	4700	100%	68
24VNA925			
1	1200	36%	56
2	1900	58%	61
3	2400	73%	63
4	2600	79%	67
5	3300	100%	69
24VNA936			
1	1200	25%	56
2	2400	50%	61
3	3300	69%	65
4	4200	88%	69
5	4800	100%	71
24VNA948			
1	1500	35%	62
2	2460	57%	65
3	2800	65%	67
4	3650	84%	70
5	4320	100%	72
24VNA960			
1	1200	32%	57
2	2180	55%	61
3	2850	70%	64
4	3700	90%	70
5	4140	100%	72

*Estimated sound for stages 2, 3, and 4

For 2-stage operation: Low = Stage 2, High = Stage 5

SOUND POWER LEVEL (dBA)

Unit Size – Voltage, Series	Typical Octave Band Spectrum (without tone adjustment)	Min Speed Cooling	Max Speed Cooling
024A – 30	Freq (Hz)	1200 RPM	3300 RPM
	125	40.4	43.9
	250	44.4	53.9
	500	46.3	61.8
	1000	45.0	59.0
	2000	37.2	56.7
	4000	31.0	60.0
	8000	28.4	45.4
	Sound Rating (dBA)	56	71
024B – 30	Freq (Hz)	1500 RPM	4700 RPM
	125	40.5	44.0
	250	45.5	49.5
	500	41.5	53.0
	1000	44.0	52.5
	2000	39.0	50.5
	4000	34.5	53.0
	8000	31.0	45.0
	Sound Rating (dBA)	55	67
025 – 30	Freq (Hz)	1200 RPM	3300 RPM
	125	40.4	45.4
	250	44.4	57.9
	500	46.3	61.3
	1000	45.0	58.0
	2000	37.2	54.7
	4000	31.0	52.0
	8000	28.4	41.9
	Sound Rating (dBA)	56	69
036 – 30	Freq (Hz)	1200 RPM	4800 RPM
	125	40.4	43.9
	250	44.4	53.9
	500	46.3	61.8
	1000	45.0	59.0
	2000	37.2	56.7
	4000	31.0	60.0
	8000	28.4	45.4
	Sound Rating (dBA)	56	71
048 – 30	Freq (Hz)	1500 RPM	4320 RPM
	125	40.9	42.4
	250	46.4	54.4
	500	47.3	60.3
	1000	56.5	63.5
	2000	39.2	56.7
	4000	35.0	56.0
	8000	31.9	44.9
	Sound Rating (dBA)	62	72
060 – 30	Freq (Hz)	1200 RPM	4140 RPM
	125	39.0	49.5
	250	48.0	59.5
	500	46.5	62.0
	1000	45.5	60.0
	2000	39.5	58.5
	4000	36.5	55.0
	8000	35.5	48.0
	Sound Rating (dBA)	57	72

NOTE: Tested in compliance with AHRI 270–2008 but not listed with AHRI.

ACCESSORIES

KIT NUMBER	KIT NAME	24A-30 24B-30 25-30	36-30	48-30	60
KSASF0101AAA	SPRT FEET KIT			X	X
KSASF0201AAA	SPRT FEET KIT	X	X		
KSATX0201PUR	TXV KIT	X			
KSATX0301PUR	TXV KIT		X		
KSATX0401PUR	TXV KIT			X	
KSATX0501PUR	TXV KIT				X
KSBTX0201PUR	TXV KIT	X			
KSBTX0301PUR	TXV KIT		X		
KSBTX0401PUR	TXV KIT			X	

x = Accessory S = Standard

Accessory Description and Usage

Support Feet

Raises unit above base pad. 2 and 3 ton kit contains 5 feet for stable installation with small base. 4 and 5 ton kit contains 4 feet.

Usage Guideline:

Recommended for rooftop applications

Thermostatic Expansion Valve (TXV)

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator.

Usage Guideline:

Required if indoor unit does not already contain Puron® refrigerant TXV

CONTROLS

SYSTXCCITN01-A	Infinity Touch Control (non-Wi-Fi) version 11 or newer
SYSTXCCITC01-A	Infinity Touch Control (Wi-Fi)
SYSTXCCITW01-A	Infinity Touch Control with Wi-Fi & Wireless Access Point
SYSTXCC4ZC01	Infinity 4-Zone Damper Control Module
SYSTXCCSMS01	Infinity Smart Sensor (Optional wall control used to monitor temperature and/or fan control in an individual zone.)
SYSTXCCNIM01	Infinity Network Interface Module (Connects Heat Recovery and Energy Recovery Ventilators on non-zoning applications.)
SYSTXCCSMS01	Infinity Smart Sensor

THERMOSTATS


PART NUMBER	PROGRAM	GAS	ELECTRIC	HEAT	COOL
TP-PAC01	7-Day	√	√	1	1
TP-NRH01-A	NP	√	√	3	2
TP-NAC01	NP	√	√	1	1

DIMENSIONS - ENGLISH

UNIT	SERIES	ELECTRICAL CHARACTERISTICS	A	B	C	D	E	F	G	K	L	M	N	P	OPERATING WEIGHT (lbs)	SHIPPING WEIGHT (lbs)	SHIPPING DIMENSIONS (L x W x H)
24VNA924A	0	X 0 0 0	23 1/8"	38 7/16"	3 3/4"	3/4"	4 7/16"	18 1/16"	7 13/16"	2 13/16"	1/2"	10 3/4"	10 3/4"	18 1/4"	160	186	25 1/4" X 25 1/4" X 43 3/8"
24VNA924B	0	X 0 0 0	23 1/8"	31 5/8"	3 3/4"	3/4"	4 7/16"	18 1/16"	7 13/16"	2 13/16"	1/2"	11 1/4"	11 1/4"	14 1/2"	135	158	25 1/4" X 25 1/4" X 35 5/8"
24VNA925A	0	X 0 0 0	23 1/8"	38 7/16"	3 3/4"	3/4"	4 7/16"	18 1/16"	7 13/16"	2 13/16"	1/2"	10 3/4"	10 3/4"	18 1/4"	160	186	25 1/4" X 25 1/4" X 43 3/8"
24VNA936A	0	X 0 0 0	23 1/8"	38 7/16"	3 3/4"	3/4"	4 7/16"	18 1/16"	7 13/16"	2 13/16"	1/2"	10 3/4"	10 3/4"	18 1/4"	160	186	25 1/4" X 25 1/4" X 43 3/8"
24VNA948A	0	X 0 0 0	31 3/16"	39 3/4"	3 7/8"	7/8"	6 9/16"	24 11/16"	9 1/8"	2 15/16"	5/8"	14 1/2"	14 5/8"	18 3/4"	216	255	33 3/8" X 33 3/8" X 46 1/8"
24VNA960A	0	X 0 0 0	31 3/16"	43 3/16"	3 7/8"	7/8"	6 9/16"	24 11/16"	9 1/8"	2 15/16"	5/8"	16 1/2"	15"	20"	241	282	33 3/8" X 33 3/8" X 49 9/16"

X = YES
0 = NO

208-230-160	230-160	208/230-3-60	460-3-60
-------------	---------	--------------	----------

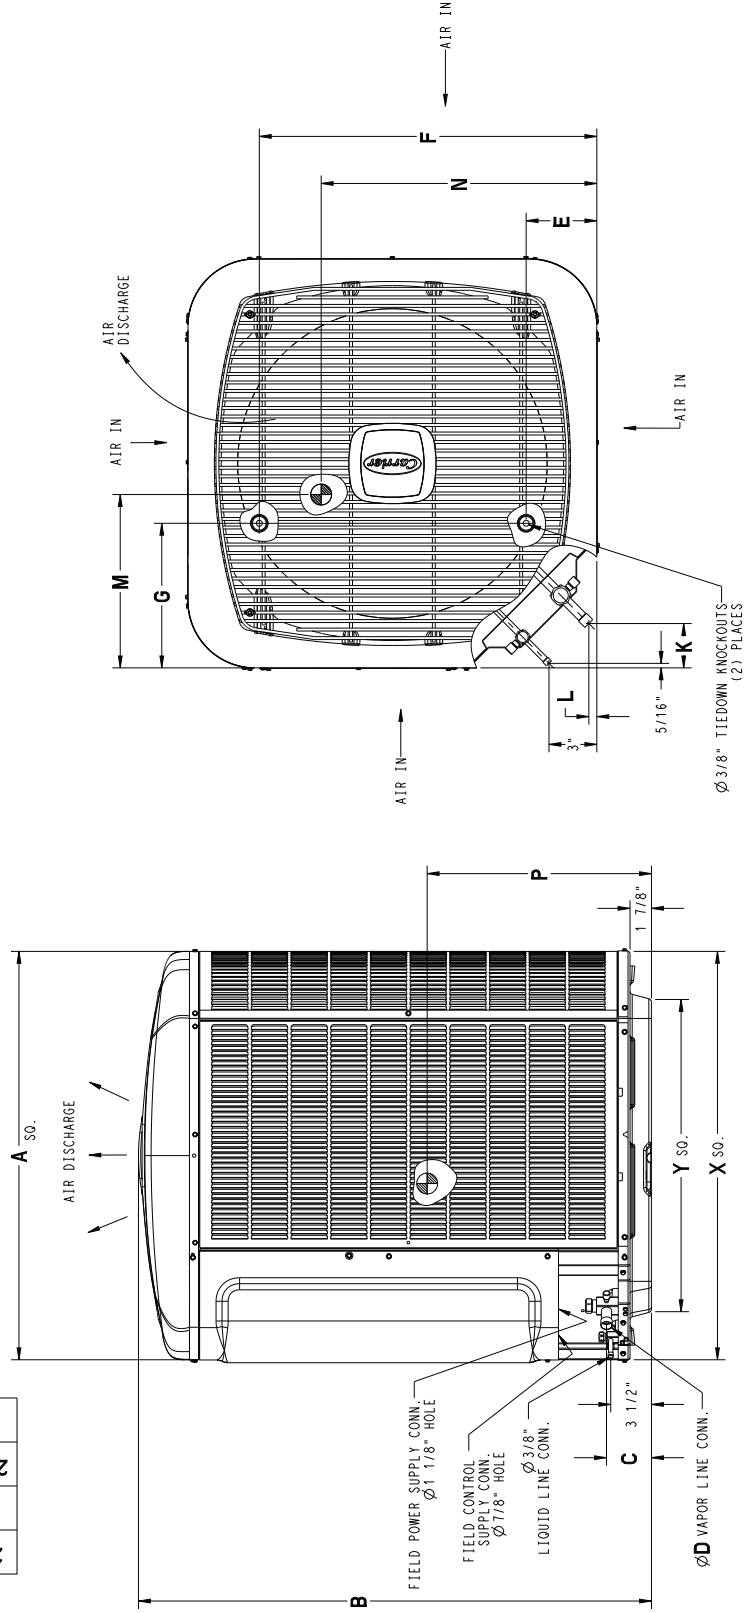

UNIT SIZE	X" MIN GROUND MOUNTING PAD APPLICATION DIMENSIONS	Y" MIN ROOF-TOP MOUNTING PAD APPLICATION DIMENSIONS
24, 25, 36	23 1/8"	17 3/4"
-	25 3/4"	20 7/16"
48, 60	31 3/16"	23"
-	35"	26 3/4"

When installing, allow sufficient space for airflow clearance, wiring, refrigerant piping, and service. Allow 24 in. (609.6 mm) clearance to service end of unit and 48 in. (1219.2 mm) above unit. For proper airflow, a 6-in. (152.4 mm) clearance on 1 side of unit and 12-in. (304.8 mm) on all remaining sides must be maintained. Maintain a distance of 24 in. (609.6 mm) between units or 18 in. (457.2 mm) if no overhang within 12 ft. (3.66 m). Position so water, snow, or ice from roof or eaves cannot fall directly on unit.

NOTE: 18" (457.2 mm) clearance option described above is approved for outdoor units with wire grille coil guard only. Units with louver panels require 24" (609.6 mm) between units.


On rooftop applications, locate unit at least 6 in. (152.4 mm) above roof surface.

DIMENSIONS - SI

UNIT	SERIES	ELECTRICAL CHARACTERISTICS	A	B	C	D	E	F	G	K	L	M	N	P	OPERATING WEIGHT (KGS)	SHIPPING WEIGHT (KGS)	SHIPPING DIMENSIONS (L x W x H)
24VWA924A	0	X 0 0 0	587.3	975.9	96.1	19.1	112.7	458.8	198.4	71.4	12.7	273.1	273.1	463.6	72.6	84.4	641.5 X 641.5 X 1102.2
24VWA924B	0	X 0 0 0	587.3	803.1	96.1	19.1	112.7	458.8	198.4	71.4	12.7	285.8	285.8	368.3	61.2	71.7	641.5 X 641.5 X 905.2
24VWA925A	0	X 0 0 0	587.3	975.9	96.1	19.1	112.7	458.8	198.4	71.4	12.7	273.1	273.1	463.6	72.6	84.4	641.5 X 641.5 X 1102.2
24VWA936A	0	X 0 0 0	587.3	975.9	96.1	19.1	112.7	458.8	198.4	71.4	12.7	273.1	273.1	463.6	72.6	84.4	641.5 X 641.5 X 1102.2
24VWA948A	0	X 0 0 0	792.2	1010.3	98.4	22.2	166.7	627.1	231.8	74.6	15.9	368.3	371.5	476.3	98.0	115.7	846.6 X 846.6 X 1172.2
24VWA960A	0	X 0 0 0	792.2	1096.7	98.4	22.2	166.7	627.1	231.8	74.6	15.9	419.1	381.0	508.0	109.3	127.9	846.6 X 846.6 X 1258.6

X = YES
O = NO

460-3-60
208/230-3-60
230-1-60
208-230-1-60

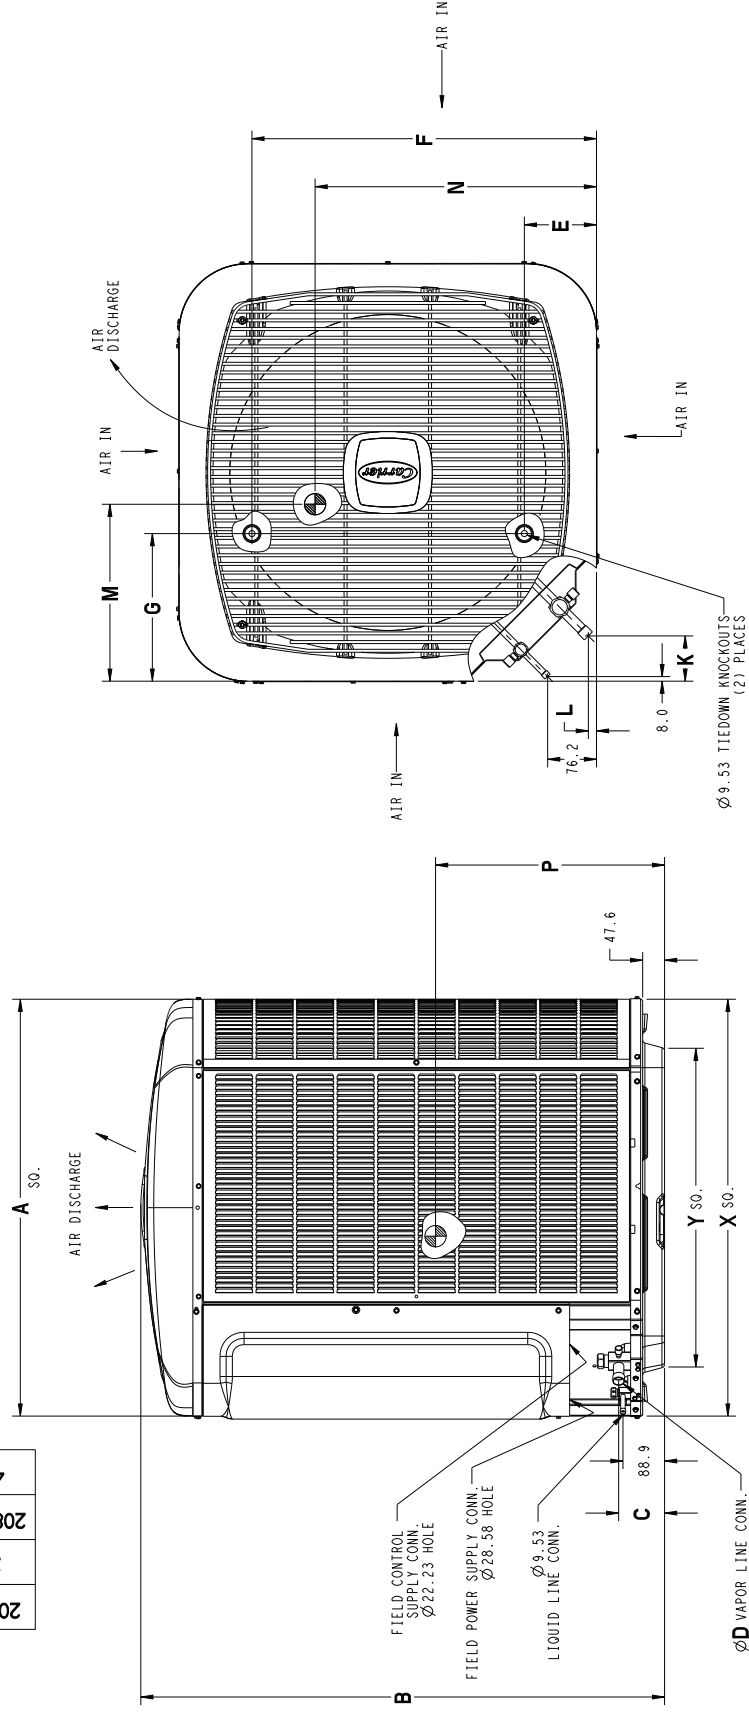

UNIT SIZE	"X" MIN GROUND MOUNTING PAD APPLICATION DIMENSIONS	"Y" MIN ROOF-TOP MOUNTING PAD APPLICATION DIMENSIONS
24, 25, 36	587.4	451.3
48, 60	654.0	518.5
	792.2	583.2
	889.0	679.7

When installing, allow sufficient space for airflow clearance, wiring, refrigerant piping, and service. Allow 24 in. (609.6 mm) clearance to service end of unit and 48 in. (1219.2 mm) (above unit) for proper airflow. For proper airflow, a 6-in. (152.4 mm) clearance on 1 side of unit and 12-in. (304.8 mm) on all remaining sides must be maintained. Maintain a distance of 24 in. (609.6 mm) between units or 18 in. (457.2 mm) if no overhang within 12 ft. (3.66 m) Position so water, snow, or ice from roof or eaves cannot fall directly on unit.

NOTE: 18" (457.2 mm) clearance option described above is approved for outdoor units with wire grille coil guard only. Units with louver panels require 24" (609.6 mm) between units.

On rooftop applications, locate unit at least 6 in. (152.4 mm) above roof surface.

TESTED AHRI COMBINATION RATINGS*

NOTE: Ratings contained in this document are subject to change at any time.

For AHRI ratings certificates, please refer to the AHRI directory www.ahridirectory.org

Additional ratings and system combinations can be accessed via the Carrier database at: www.MyCarrierRatings.com

For performance data at specific application &/or design conditions with various indoor unit combinations, the equipment performance calculator can be accessed at : <http://rpmob.wrightisoft.com/>

Model Number	Coil Model Number	Furnace Model Number	Cooling Capacity High	SEER	EER	ID CFM
24VNA924A**30	FE4AN(B,F)005L+UI		23000	18.0	11.0	825
24VNA924A**30	FV4CN(B,F)003L		22600	16.0	11.0	700
24VNA924B**30	FE4ANF002L+UI		24000	18.0	11.0	825
24VNA924B**30	FV4CNF002L		23800	16.0	11.0	700
24VNA925A**30	FE4AN(B,F)005L+UI		24000	19.0	12.5	825
24VNA925A**30	FV4CN(B,F)003L		22600	19.0	12.2	700
24VNA936A**30	FE4AN(B,F)005L+UI		35000	18.0	10.5	1050
24VNA936A**30	FV4CN(B,F)005L		35000	16.0	10.5	1050
24VNA948A**30	FE4ANB006L+UI		46500	19.0	11.0	1400
24VNA948A**30	FV4CNB006L		46000	15.5	11.0	1400
24VNA960A**30	FE4ANB006L+UI		57000	17.0	10.0	1600
24VNA960A**30	FV4CNB006L		57500	15.0	10.0	1750

* Ratings are net values reflecting the effects of circulating fan heat. Supplemental electric heat is not included. Ratings are based on:

Cooling Standard: 80°F (27°C) db 67°F (19°C) wb indoor entering air temperature and 95°F (35°C) db air entering outdoor unit.

EER — Energy Efficiency Ratio

SEER — Seasonal Energy Efficiency Ratio

UI — User Interface

NOTE: Ratings contained in this document are subject to change at any time.

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE

EDB °F (°C)	EVAP. AIR	24VNA924A / FE44NF005 Efficiency Mode Condenser Entering Air Temperature F (°C)																				
		115 (46.1)			105 (40.5)			95 (35)			85 (29.4)			75 (23.9)			65 (18.3)					
		ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	
75 (23.9)	72 (22.2)		22.60	9.53	3.21	24.02	10.05	2.61	25.33	10.54	2.07	26.67	11.04	1.60	27.98	11.54	1.20	29.26	12.02	0.84		
	67 (19.4)		20.56	13.19	3.20	21.88	13.76	2.63	23.10	14.31	2.09	24.34	14.86	1.64	25.55	15.41	1.24	26.73	15.95	0.89		
	63 (17.2)	825	19.06	16.04	3.19	20.29	16.66	2.63	21.44	17.25	2.10	22.61	17.85	1.66	23.74	18.44	1.26	24.85	19.01	0.93	825	
	57 (13.9)		18.10	18.10	3.18	19.09	19.09	2.63	20.04	20.04	2.11	20.97	20.97	1.67	21.89	21.89	1.29	22.78	22.78	0.96		
	72 (22.2)		22.44	13.14	3.20	23.85	13.70	2.61	25.15	14.23	2.06	26.49	14.77	1.60	27.80	15.31	1.19	29.07	15.84	0.84		
80 (26.7)	67 (19.4)		20.48	16.76	3.20	21.79	17.38	2.62	23.00	17.96	2.09	24.24	18.56	1.63	25.45	19.15	1.23	26.62	19.73	0.89		
	63 (17.2)	825	19.26	19.26	3.19	20.37	20.18	2.63	21.49	20.85	2.10	22.63	21.51	1.65	23.75	22.15	1.26	24.85	22.77	0.92	825	
	57 (13.9)		19.23	19.23	3.19	20.28	20.28	2.63	21.25	21.25	2.10	22.23	22.23	1.66	23.18	23.18	1.27	24.10	24.10	0.94		
	72 (22.2)		15.08	6.47	1.54	16.06	6.82	1.33	16.82	7.10	1.10	17.75	7.44	0.91	18.67	7.78	0.72	19.58	8.12	0.54		
	67 (19.4)	650	13.68	9.15	1.54	14.59	9.54	1.35	15.33	9.87	1.12	16.19	10.25	0.94	17.03	10.62	0.76	17.86	10.99	0.59	650	
80 (26.7)	63 (17.2)		12.70	11.25	1.54	13.54	11.67	1.36	14.27	12.04	1.13	15.07	12.45	0.96	15.86	12.85	0.79	16.62	13.24	0.62		
	57 (13.9)		12.27	12.27	1.54	12.97	12.97	1.37	13.58	13.58	1.14	14.24	14.24	0.97	14.89	14.89	0.81	15.52	15.52	0.65		
	72 (22.2)		14.96	9.12	1.53	15.93	9.51	1.33	16.68	9.81	1.10	17.61	10.18	0.91	18.52	10.55	0.72	19.47	10.93	0.54		
	67 (19.4)	650	13.64	11.78	1.54	14.54	12.20	1.35	15.27	12.55	1.12	16.13	12.96	0.94	16.96	13.36	0.76	17.78	13.76	0.59	650	
	63 (17.2)		13.08	13.08	1.54	13.82	13.82	1.36	14.43	14.43	1.13	15.14	15.09	0.96	15.89	15.56	0.79	16.65	15.99	0.62		
57 (13.9)		13.06	13.06	1.54	13.79	13.79	1.36	14.41	14.41	1.13	15.10	15.10	0.96	15.77	15.77	0.79	16.42	16.42	0.63			
75 (23.9)	72 (22.2)		11.92	5.31	0.85	12.72	5.59	0.82	10.55	4.66	0.46	11.18	4.89	0.44	11.84	5.13	0.39	12.52	5.37	0.28		
	67 (19.4)		10.80	7.83	0.86	11.55	8.14	0.83	9.58	6.85	0.47	10.16	7.10	0.47	10.74	7.35	0.43	11.36	7.61	0.34		
	63 (17.2)	650	10.05	9.78	0.86	10.74	10.13	0.84	8.93	8.56	0.49	9.46	8.83	0.49	10.00	9.10	0.46	10.55	9.37	0.38	585	
	57 (13.9)		9.97	9.97	0.86	10.57	10.57	0.85	8.82	8.82	0.49	9.29	9.29	0.50	9.75	9.75	0.47	10.21	10.21	0.40		
	72 (22.2)		11.80	7.81	0.85	12.59	8.12	0.82	10.41	6.81	0.46	11.06	7.06	0.44	11.73	7.32	0.38	12.41	7.59	0.28		
80 (26.7)	67 (19.4)		10.80	10.29	0.86	11.52	10.64	0.83	9.55	8.98	0.47	10.13	9.25	0.47	10.71	9.53	0.43	11.32	9.81	0.34		
	63 (17.2)	650	10.66	10.66	0.86	11.28	11.28	0.84	9.40	9.40	0.48	9.89	9.89	0.48	10.37	10.37	0.44	10.87	10.87	0.36	585	
	57 (13.9)		10.64	10.64	0.86	11.26	11.26	0.84	9.39	9.39	0.48	9.87	9.87	0.48	10.35	10.35	0.44	10.85	10.85	0.36		

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage

Stage 1 — Compressor speed limited to stage two at 105 and 115 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

24VNA924A

COOLING INDOOR MODEL	CAPACITY	POWER	FURNACE MODEL
*FE4AN(B,F)005L	1.00	1.00	
FE4AN(B,F)003L	0.96	1.00	
FE4AN(B)006L	0.98	1.08	
FE4AN(F)002L	0.96	1.00	
CAP**36141AL*	0.98	1.03	58CV(A,X)070-12
CNPV*3617AL*	0.98	1.08	58CV(A,X)070-12
CNPV*3617AL*	0.97	1.01	58CV(A,X)070-12
CNPV*3717AL*	0.97	1.02	58CV(A,X)070-12
CNPV*4217AL*	0.96	1.00	58CV(A,X)090-16
CSPH*3617AL*	1.00	1.05	58CV(A,X)090-12
CSPH*4212AL*	1.00	1.05	58CV(A,X)070-12
CAP**3617AL*	0.98	1.03	58CV(A,X)090-16
CAP**4221AL*	0.99	1.04	58CV(A,X)090-16
CNPV*3617AL*	0.98	1.03	58CV(A,X)090-16
CNPV*4221AL*	0.99	1.04	58CV(A,X)090-16
CNPV*3617AL*	0.97	1.01	58CV(A,X)090-16
CNPV*3621AL*	0.97	1.01	58CV(A,X)090-16
CNPV*3717AL*	0.97	0.97	58CV(A,X)090-16
CNPV*4217AL*	0.96	1.00	58CV(A,X)090-16
CNPV*4221AL*	0.96	1.00	58CV(A,X)090-16
CSPH*3612AL*	1.00	1.00	58CV(A,X)090-16
CAP**4212AL*	1.01	1.03	58CV(A,X)090-16
CAP**3617AL*	0.98	1.03	59*N*A060V17**14
CAP**3621AL*	0.98	1.03	59*N*A060V17**14
CAP**4221AL*	0.98	1.03	59*N*A060V17**14
CNPV*3617AL*	0.97	1.07	59*N*A060V17**14
CNPV*4221AL*	0.98	1.08	59*N*A060V17**14
CNPV*3617AL*	0.94	1.03	59*N*A060V17**14
CNPV*3621AL*	0.94	1.03	59*N*A060V17**14
CNPV*3717AL*	0.97	1.02	59*N*A060V17**14
CNPV*4221AL*	0.95	1.04	59*N*A060V17**14
CSPH*4212AL*	1.00	1.05	59*N*A060V17**14
CAP**3617AL*	0.98	1.03	59*N*A060V17**14
CAP**4221AL*	0.99	1.04	59*N*A060V17**14
CNPV*3617AL*	0.98	1.08	59*N*A080V17**14
CNPV*4221AL*	0.95	1.04	59*N*A080V17**14
CNPV*3621AL*	0.95	0.99	59*N*A080V17**14
CNPV*3717AL*	0.97	1.02	59*N*A080V17**14
CNPV*4212AL*	1.00	1.05	59*N*A080V17**14
CSPH*4212AL*	1.00	1.05	59*N*A080V17**14
CAP**3617AL*	0.98	1.03	59*N*A080V17**14
CAP**4221AL*	0.99	1.04	59*N*A080V21**20
CNPV*4221AL*	0.98	1.03	59MN7A060V21**20
CAP**4221AL*	0.99	1.04	59MN7A060V21**20

2-STAGE (HI-Stage 5, Lo-Stage 2)		High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model
FV4CN(B,F)003L	0.94	0.94	0.94	0.99	0.94	
FV4CN(F)002L	0.94	0.94	0.94	1.00	0.97	
CAP**2414AL*	0.94	0.99	1.08	1.12	0.94	58PH*045-08
CAP**2417AL*	0.94	0.99	1.09	1.12	0.94	58PH*045-08
CAP**3014AL*	0.95	0.95	1.08	1.11	0.94	58PH*045-08
CAP**3017AL*	0.95	0.95	1.09	1.11	0.94	58PH*045-08
CNPV*2417AL*	0.93	0.98	1.08	1.12	0.94	58PH*045-08
CNPV*2417AL*	0.93	0.98	1.08	1.12	0.94	58PH*045-08
CNPV*3014AL*	0.95	1.00	1.09	1.11	0.94	58PH*045-08
CNPV*3017AL*	0.95	1.00	1.09	1.11	0.94	58PH*045-08
CNPV*3117AL*	0.95	0.95	1.12	1.11	0.94	58PH*045-08
CAP**2414AL*	0.93	0.93	1.08	1.08	0.94	58CTW045-12
CAP**2417AL*	0.94	0.94	1.08	1.07	0.94	58CTW045-12
CAP**3014AL*	0.93	0.93	1.10	1.09	0.94	58CTW045-12
CAP**3017AL*	0.93	0.93	1.11	1.09	0.94	58CTW045-12
CNPV*2414AL*	0.93	0.98	1.08	1.07	0.94	58CTW045-12
CNPV*2417AL*	0.93	0.98	1.08	1.07	0.94	58CTW045-12
CNPV*3014AL*	0.93	0.97	1.10	1.09	0.94	58CTW045-12
CNPV*3017AL*	0.93	0.93	1.11	1.09	0.94	58CTW045-12
CNPV*3117AL*	0.94	0.94	1.12	1.06	0.94	58CTW045-12
CSPH*3012AL*	0.93	0.93	1.11	1.08	0.94	58CTW045-12
CAP**2417AL*	0.93	0.93	1.11	1.09	0.94	58CTW070-16
CNPV*2417AL*	0.96	1.05	1.09	1.07	0.94	58CTW070-16
CNPV*3017AL*	0.93	0.98	1.11	1.08	0.94	58CTW070-16
CNPV*3117AL*	0.95	0.95	1.12	1.05	0.94	58CTW070-16
CNPV*2417AL*	0.93	0.98	1.08	1.07	0.94	58CTW070-16
CNPV*3017AL*	0.93	0.93	1.11	1.08	0.94	58CTW070-16
CNPV*3117AL*	0.95	0.95	1.12	1.05	0.94	58CTW070-16
CSPH*2412AL*	0.94	0.94	1.13	1.15	0.94	58CTW090-16
CSPH*3012AL*	0.95	0.95	1.14	1.12	0.94	58CTW090-16
CAP**2414AL*	0.95	1.00	1.08	1.08	0.94	59*P2A040E14**10
CAP**2417AL*	0.93	0.98	1.08	1.13	0.94	59*P2A040E14**10
CAP**3014AL*	0.94	0.99	1.07	1.12	0.94	59*P2A040E14**10
CNPV*2414AL*	0.93	0.97	1.07	1.13	0.94	59*P2A040E14**10
CNPV*2417AL*	0.93	0.97	1.07	1.13	0.94	59*P2A040E14**10
CNPV*3014AL*	0.94	0.99	1.07	1.12	0.94	59*P2A040E14**10
CNPV*3017AL*	0.95	1.00	1.08	1.12	0.94	59*P2A040E14**10
CNPV*3117AL*	0.94	0.94	1.11	1.11	0.94	59*P2A040E14**10
CSPH*3117AL*	0.96	1.00	1.10	1.23	0.94	59*P2A040E14**10
CSPH*3012AL*	0.97	1.01	1.09	1.11	0.94	59*P2A040E14**10
CAP**2417AL*	0.93	0.98	1.07	1.12	0.94	59*P2A040E17**12
CAP**3017AL*	0.95	1.00	1.08	1.13	0.94	59*P2A040E17**12
CNPV*2417AL*	0.95	1.05	1.08	1.13	0.94	59*P2A040E17**12
CNPV*3017AL*	0.97	1.05	1.08	1.12	0.94	59*P2A040E17**12
CNPV*3117AL*	0.95	1.01	1.09	1.10	0.94	59*P2A040E17**12
CNPV*2417AL*	0.93	0.97	1.07	1.13	0.94	59*P2A040E17**12
CNPV*3017AL*	0.95	1.00	1.08	1.12	0.94	59*P2A040E17**12
CNPV*3117AL*	0.97	1.01	1.09	1.10	0.94	59*P2A040E17**12
CAP**2414AL*	0.94	0.94	1.09	1.10	0.94	59*P2A060E14**12
CAP**2417AL*	0.95	0.95	1.10	1.10	0.94	59*P2A060E14**12
CAP**3014AL*	0.93	0.93	1.11	1.11	0.94	59*P2A060E14**12

2-STAGE (HI-Stage 5, Lo-Stage 2)		High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model
CAP**3017AL*	0.94	0.94	1.12	1.11	0.94	59*P2A060E14**12
CNPV*2414AL*	0.94	0.99	1.09	1.09	0.94	59*P2A060E14**12
CNPV*2417AL*	0.94	0.99	1.09	1.09	0.94	59*P2A060E14**12
CNPV*3014AL*	0.93	0.98	1.11	1.11	0.94	59*P2A060E14**12
CNPV*3017AL*	0.94	0.94	1.12	1.11	0.94	59*P2A060E14**12
CSPH*2412AL*	0.96	0.96	1.13	1.09	0.94	59*P2A060E14**12
CSPH*3012AL*	0.94	0.94	1.12	1.10	0.94	59*P2A060E14**12
CNPV*2417AL*	0.96	1.00	1.11	1.13	0.94	59*P2A060E17**14
CSPH*2412AL*	0.96	0.95	1.13	1.15	0.94	59*P2A060E17**14
CSPH*2417AL*	0.96	1.00	1.10	1.10	0.94	59*P2A060E17**16
CSPH*2412AL*	0.94	0.94	1.12	1.12	0.94	59*P2A060E17**16
CAP**2414AL*	0.93	1.03	1.07	1.17	0.94	59*P5A040E14**10
CAP**2417AL*	0.94	1.04	1.07	1.17	0.94	59*P5A040E14**10
CAP**3014AL*	0.95	1.05	1.07	1.16	0.94	59*P5A040E14**10
CAP**3017AL*	0.95	1.05	1.07	1.15	0.94	59*P5A040E14**10
CNPV*2414AL*	0.93	1.03	1.07	1.17	0.94	59*P5A040E14**10
CNPV*2417AL*	0.93	1.03	1.07	1.17	0.94	59*P5A040E14**10
CNPV*3014AL*	0.95	1.05	1.07	1.16	0.94	59*P5A040E14**10
CNPV*3017AL*	0.95	1.05	1.07	1.15	0.94	59*P5A040E14**10
CNPV*3117AL*	0.96	1.05	1.08	1.13	0.94	59*P5A040E14**10
CSPH*2412AL*	0.95	1.05	1.07	1.17	0.94	59*P5A040E14**10
CSPH*3012AL*	0.95	1.05	1.08	1.15	0.94	59*P5A040E14**10
CAP**2417AL*	0.93	0.97	1.07	1.14	0.94	59*P5A040E17**12
CAP**3017AL*	0.94	1.04	1.08	1.15	0.94	59*P5A040E17**12
CNPV*3017AL*	0.93	1.03	1.07	1.13	0.94	59*P5A040E17**12
CNPV*3117AL*	0.96	1.00	1.09	1.12	0.94	59*P5A040E17**12
CNPV*2417AL*	0.92	1.01	1.07	1.14	0.94	59*P5A040E17**12
CNPV*3017AL*	0.93	0.98	1.07	1.13	0.94	59*P5A040E17**12
CNPV*3117AL*	0.94	0.99	1.09	1.12	0.94	59*P5A040E17**12
CSPH*2412AL*	0.96	1.05	1.10	1.23	0.94	59*P5A040E17**12
CSPH*3012AL*	0.93	0.98	1.08	1.13	0.94	59*P5A040E17**12
CNPV*2417AL*	0.96	1.05	1.10	1.17	0.94	59*P5A060E17**14
CSPH*2412AL*	0.97	1.01	1.10	1.16	0.94	59*P5A060E17**14

See notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

EDB °F (°C)	EVAP. AIR EWB °F (°C)	24VNA924B / FE4ANF02L Efficiency Mode Condenser Entering Air Temperature F (°C)																			
		115 (46.1)			105 (40.5)			95 (35)			85 (29.4)			75 (23.9)			65 (18.3)				
		ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**
STAGE 5																					
75 (23.9)	72 (22.2)	23.43	9.90	2.85	25.03	10.49	2.52	28.46	11.02	2.20	28.00	11.80	1.91	29.51	12.16	1.63	31.01	12.73	1.37		
	67 (19.4)	21.30	13.70	2.81	22.76	14.32	2.49	24.07	14.89	2.18	25.46	15.50	1.90	26.82	16.10	1.63	28.19	16.70	1.38		
	63 (17.2)	19.74	16.69	2.78	21.07	17.34	2.47	22.29	17.94	2.17	23.56	18.57	1.89	24.85	19.20	1.63	26.11	19.82	1.39		
	57 (13.9)	18.74	18.74	2.76	19.81	19.81	2.45	20.78	20.78	2.15	21.79	21.79	1.88	22.78	22.78	1.63	23.74	23.74	1.39		
	67 (19.4)	23.36	13.70	2.85	24.96	14.32	2.52	26.39	14.88	2.20	27.93	15.49	1.91	29.44	16.09	1.63	30.94	16.89	1.37		
80 (26.7)	72 (22.2)	21.24	17.45	2.81	22.89	18.11	2.49	24.00	18.72	2.18	25.39	19.36	1.90	26.76	19.99	1.63	28.12	20.63	1.38		
	67 (19.4)	19.96	19.96	2.78	21.18	20.93	2.47	22.35	21.63	2.17	23.61	22.94	1.89	24.86	23.02	1.63	26.10	23.70	1.38		
	63 (17.2)	19.93	19.93	2.78	21.05	21.05	2.47	22.07	22.07	2.16	23.12	23.12	1.89	24.16	24.16	1.63	25.17	25.17	1.39		
	57 (13.9)	16.60	7.18	1.72	17.75	7.59	1.53	18.75	7.96	1.31	19.88	8.37	1.12	20.99	8.78	0.94	22.08	9.18	0.77		
	67 (19.4)	15.01	10.22	1.72	16.06	10.66	1.53	16.99	11.06	1.32	18.00	11.49	1.14	18.99	11.92	0.97	19.97	12.94	0.81		
75 (23.9)	72 (22.2)	13.88	12.59	1.71	14.82	13.06	1.54	15.70	13.48	1.32	16.62	13.94	1.15	17.52	14.38	0.99	18.40	14.82	0.84		
	67 (19.4)	13.48	13.48	1.71	14.25	14.25	1.54	14.97	14.97	1.32	15.70	15.70	1.16	16.40	16.40	1.01	17.10	17.10	0.86		
	63 (17.2)	16.54	10.24	1.72	17.89	10.68	1.53	18.68	11.07	1.31	19.81	11.51	1.12	20.92	11.94	0.94	22.01	12.37	0.77		
	57 (13.9)	14.98	13.23	1.72	16.01	13.70	1.53	16.94	14.13	1.32	17.95	14.59	1.14	18.93	15.05	0.97	19.91	15.50	0.81		
	67 (19.4)	14.42	14.42	1.72	15.24	15.24	1.53	15.99	15.99	1.32	16.77	16.77	1.15	17.61	17.39	0.99	18.46	17.89	0.83		
80 (26.7)	72 (22.2)	14.40	14.40	1.72	15.22	15.22	1.53	15.96	15.96	1.32	16.74	16.74	1.15	17.50	17.50	0.99	18.23	18.23	0.84		
	67 (19.4)	14.01	6.30	1.38	15.00	6.65	1.24	9.25	4.60	0.54	9.85	4.81	0.46	10.45	5.01	0.37	11.04	5.22	0.29		
	63 (17.2)	12.64	9.35	1.39	13.52	9.73	1.25	8.32	7.38	0.55	8.85	7.61	0.48	9.37	7.84	0.40	9.89	8.07	0.33		
	57 (13.9)	11.71	11.62	1.39	12.49	12.06	1.26	8.11	8.11	0.55	8.56	8.56	0.46	9.00	9.00	0.41	9.43	9.43	0.34		
	67 (19.4)	13.95	9.39	1.38	14.94	9.76	1.24	9.20	7.43	0.54	9.80	7.66	0.45	10.39	7.90	0.37	10.98	8.13	0.29		
75 (23.9)	72 (22.2)	12.66	12.32	1.39	13.52	12.75	1.25	8.77	8.77	0.54	9.26	9.26	0.47	9.73	9.73	0.39	10.19	10.19	0.31		
	67 (19.4)	12.55	12.55	1.39	13.28	13.28	1.26	8.77	8.77	0.54	9.25	9.25	0.47	9.72	9.72	0.39	10.18	10.18	0.31		
	63 (17.2)	12.53	12.53	1.39	13.26	13.26	1.26	8.76	8.76	0.54	9.24	9.24	0.47	9.71	9.71	0.39	10.17	10.17	0.31		
	57 (13.9)																				
	67 (19.4)																				

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage

Stage 1 — Compressor speed limited to stage two at 105 and 115 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

EVB AIR		24VNA325/FE4AHF005 Efficiency Mode Condenser Entering Air Temperature F (C)																						
		115 (46.1)			105 (40.5)			95 (35)			85 (29.4)			75 (23.9)			65 (18.3)							
EDB F (C)	EWB F (C)	Capacity MBtuh		ID SCFM	Total Sys. KW**	Capacity MBtuh		ID SCFM	Total Sys. KW**	Capacity MBtuh		ID SCFM	Total Sys. KW**	Capacity MBtuh		ID SCFM	Total Sys. KW**	Capacity MBtuh		ID SCFM	Total Sys. KW**			
		Total	Sensit			Total	Sensit			Total	Sensit			Total	Sensit			Total	Sensit			Total	Sensit	
STAGE 5																								
75 (23.9)	72 (22.2)	23.68	9.99	2.51	825	25.12	10.51	2.21	825	26.43	11.00	1.90	825	27.77	11.50	1.62	825	29.08	11.99	1.34	825	30.34	12.47	1.07
	67 (19.4)	21.55	13.82	2.50		22.88	14.39	2.21		24.10	14.93	1.92		25.35	15.48	1.65		26.55	16.01	1.39		27.72	16.54	1.13
	63 (17.2)	19.97	16.81	2.49		21.22	17.43	2.22		22.38	18.00	1.93		23.54	18.59	1.67		24.67	19.16	1.42		25.77	19.72	1.17
	57 (13.9)	18.96	18.96	2.48		19.97	19.97	2.21		20.91	20.91	1.94		21.84	21.84	1.69		22.75	22.75	1.45		23.62	23.62	1.21
	67 (19.4)	23.52	13.77	2.50		24.94	14.33	2.20		26.25	14.85	1.90		27.59	15.38	1.61		28.89	15.91	1.34		30.15	16.42	1.07
80 (26.7)	67 (19.4)	21.46	17.56	2.50	825	22.78	18.18	2.21	825	24.00	18.75	1.92	825	25.24	19.33	1.65	825	26.45	19.90	1.39	825	27.61	20.46	1.13
	63 (17.2)	20.19	20.19	2.49		21.30	21.10	2.22		22.43	21.76	1.93		23.57	22.40	1.67		24.68	23.02	1.42		25.77	23.62	1.17
	57 (13.9)	20.15	20.15	2.49		21.20	21.20	2.22		22.18	22.18	1.93		23.15	23.15	1.67		24.09	24.09	1.43		25.00	25.00	1.19
	67 (19.4)	15.55	6.67	1.25		16.54	7.02	1.17		17.29	7.30	1.03		18.23	7.64	0.91		19.14	7.98	0.77		20.05	8.32	0.61
	63 (17.2)	14.11	9.43	1.25		15.02	9.82	1.18		15.76	10.15	1.05		16.63	10.52	0.95		17.47	10.89	0.82		18.29	11.25	0.67
75 (23.9)	67 (19.4)	13.09	11.60	1.25	650	13.94	12.02	1.19	650	14.67	12.38	1.06	650	15.47	12.78	0.97	650	16.26	13.17	0.85	650	17.02	13.56	0.71
	57 (13.9)	12.65	12.65	1.25		13.36	13.36	1.20		13.97	13.97	1.07		14.62	14.62	0.98		15.26	15.26	0.87		15.89	15.89	0.75
	67 (19.4)	15.43	9.41	1.24		16.40	9.79	1.17		17.14	10.08	1.03		18.08	10.45	0.91		18.99	10.81	0.77		19.94	11.19	0.61
	63 (17.2)	14.07	12.14	1.25		14.97	12.56	1.18		15.70	12.91	1.05		16.56	13.31	0.94		17.39	13.70	0.82		18.21	14.09	0.67
	57 (13.9)	13.49	13.49	1.25		14.23	14.23	1.19		14.84	14.84	1.06		15.54	15.49	0.96		16.30	15.95	0.84		17.05	16.38	0.71
75 (23.9)	67 (19.4)	12.12	5.39	0.73	650	12.92	5.68	0.75	650	10.55	4.66	0.46	650	11.18	4.89	0.44	650	11.84	5.13	0.39	650	12.52	5.37	0.28
	63 (17.2)	10.98	7.95	0.74		11.73	8.27	0.77		9.58	6.85	0.47		10.16	7.10	0.47		10.74	7.35	0.43		11.36	7.61	0.34
	57 (13.9)	10.22	9.94	0.74		10.91	10.29	0.77		8.93	8.56	0.49		9.46	8.83	0.49		10.00	9.10	0.46		10.55	9.37	0.38
	67 (19.4)	10.14	10.14	0.74		10.74	10.74	0.78		8.82	8.82	0.49		9.29	9.29	0.50		9.75	9.75	0.47		10.21	10.21	0.40
	57 (13.9)	11.99	7.94	0.73		12.79	8.25	0.75		10.41	6.81	0.46		11.06	7.06	0.44		11.73	7.32	0.38		12.41	7.59	0.28
80 (26.7)	67 (19.4)	10.97	10.45	0.74	650	11.70	10.80	0.76	650	9.55	8.98	0.47	650	10.13	9.25	0.47	650	10.71	9.53	0.43	650	11.32	9.81	0.34
	63 (17.2)	10.83	10.83	0.74		11.46	11.46	0.77		9.40	9.40	0.48		9.89	9.89	0.48		10.37	10.37	0.44		10.87	10.87	0.36
	57 (13.9)	10.82	10.82	0.74		11.44	11.44	0.77		9.39	9.39	0.48		9.87	9.87	0.48		10.35	10.35	0.44		10.85	10.85	0.36
	67 (19.4)	12.12	5.39	0.73		12.92	5.68	0.75		10.55	4.66	0.46		11.18	4.89	0.44		11.84	5.13	0.39		12.52	5.37	0.28
	63 (17.2)	10.98	7.95	0.74		11.73	8.27	0.77		9.58	6.85	0.47		10.16	7.10	0.47		10.74	7.35	0.43		11.36	7.61	0.34

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage
Stage 1 – Compressor speed limited to stage two at 105 and 115 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

EDB °F (°C)	EVAP. AIR	24VNA96 / FE5AHN005 Efficiency Mode Condenser Entering Air Temperature F (°C)																		
		115 (46.1)			105 (40.5)			95 (35)			85 (29.4)			75 (23.9)			65 (18.3)			
		ID SCFM	Capacity MBtuh Total	Total Sys. KW** Sens†	ID SCFM	Capacity MBtuh Total	Total Sys. KW** Sens†	ID SCFM	Capacity MBtuh Total	Total Sys. KW** Sens†	ID SCFM	Capacity MBtuh Total	Total Sys. KW** Sens†	ID SCFM	Capacity MBtuh Total	Total Sys. KW** Sens†	ID SCFM	Capacity MBtuh Total	Total Sys. KW** Sens†	
STAGE 5																				
75 (23.9)	72 (22.2)	34.24	14.18	4.44	1050	36.41	14.99	3.89	1050	38.29	15.70	3.36	1050	40.30	16.47	2.87	1050	42.28	17.24	2.41
	67 (19.4)	31.38	19.07	4.38		33.85	19.95	3.85		35.13	20.75	3.34		36.99	21.60	2.87		38.79	22.42	2.43
	63 (17.2)	29.21	22.90	4.33		31.07	23.84	3.81		32.74	24.70	3.31		34.48	25.59	2.86		36.17	26.47	2.44
	57 (13.9)	27.05	27.05	4.27		28.50	28.50	3.77		29.85	29.85	3.28		31.20	31.20	2.84		32.85	32.25	2.44
	72 (22.2)	34.04	18.92	4.44		36.21	19.79	3.88		38.09	20.56	3.35		40.10	21.39	2.86		42.08	22.22	2.41
80 (26.7)	67 (19.4)	31.25	23.78	4.38	33.23	24.72	3.84	35.00	25.57	3.33	36.86	26.47	2.86	38.66	27.35	2.42				
	63 (17.2)	29.21	27.55	4.33	31.05	28.56	3.81	32.70	29.48	3.31	34.43	30.44	2.86	36.11	31.38	2.43				
	57 (13.9)	28.61	28.61	4.32	30.14	30.14	3.80	31.53	31.53	3.30	32.95	32.95	2.85	34.31	34.31	2.44				
	72 (22.2)	21.81	9.32	1.96	23.25	9.85	1.83	24.29	10.24	1.67	25.66	10.75	1.50	27.01	11.26	1.31				
	67 (19.4)	19.85	13.12	1.96	21.18	13.71	1.84	22.21	14.19	1.68	23.48	14.77	1.52	24.72	15.33	1.35				
75 (23.9)	63 (17.2)	18.41	16.08	1.95	19.86	16.73	1.85	20.68	17.29	1.68	21.87	17.91	1.54	23.02	18.53	1.37				
	57 (13.9)	17.71	17.71	1.95	18.75	18.75	1.85	19.63	19.63	1.68	20.61	20.61	1.54	21.57	21.57	1.39				
	72 (22.2)	21.64	13.06	1.95	23.07	13.65	1.83	24.08	14.08	1.66	25.46	14.85	1.49	26.81	15.21	1.31				
	67 (19.4)	19.77	16.83	1.95	21.09	17.48	1.84	22.11	18.01	1.67	23.37	18.64	1.52	24.60	19.26	1.35				
	63 (17.2)	18.86	18.86	1.95	19.85	19.95	1.84	20.82	20.82	1.68	21.94	21.87	1.53	23.07	22.38	1.37				
80 (26.7)	57 (13.9)	18.83	18.83	1.95	19.91	19.91	1.84	20.79	20.79	1.68	21.82	21.82	1.53	22.82	22.82	1.37				
	72 (22.2)	14.74	6.58	0.98	15.80	6.96	1.00	16.82	7.41	0.88	17.79	7.80	0.80	18.74	8.11	0.73				
	67 (19.4)	13.36	9.71	0.98	14.34	10.16	1.02	15.32	10.64	0.92	16.29	11.11	0.84	17.24	11.60	0.76				
	63 (17.2)	12.47	12.13	0.98	13.37	12.65	1.03	14.37	13.18	1.03	15.32	13.88	0.95	16.29	14.62	0.87				
	57 (13.9)	12.37	12.37	0.98	13.18	13.18	1.03	14.18	14.18	1.03	15.18	15.18	0.95	16.18	16.18	0.87				
75 (23.9)	72 (22.2)	14.58	9.69	0.97	15.63	10.12	1.00	16.67	10.67	0.92	17.64	11.17	0.84	18.62	11.66	0.76				
	67 (19.4)	13.36	12.75	0.98	14.32	13.27	1.02	15.29	14.28	0.93	16.24	15.19	0.85	17.19	16.14	0.77				
	63 (17.2)	13.20	13.20	0.98	14.04	14.04	1.02	14.86	14.86	0.93	15.68	15.68	0.85	16.51	16.51	0.77				
	57 (13.9)	13.18	13.18	0.98	14.02	14.02	1.02	14.82	14.82	0.93	15.64	15.64	0.85	16.40	16.40	0.77				
	72 (22.2)	14.74	6.58	0.98	15.80	6.96	1.00	16.82	7.41	0.88	17.79	7.80	0.80	18.74	8.11	0.73				
80 (26.7)	67 (19.4)	13.36	9.71	0.98	14.34	10.16	1.02	15.32	10.64	0.92	16.29	11.11	0.84	17.24	11.60	0.76				
	63 (17.2)	12.47	12.13	0.98	13.37	12.65	1.03	14.37	13.18	1.03	15.32	13.88	0.95	16.29	14.62	0.87				
	57 (13.9)	12.37	12.37	0.98	13.18	13.18	1.03	14.18	14.18	1.03	15.18	15.18	0.95	16.18	16.18	0.87				
	72 (22.2)	14.58	9.69	0.97	15.63	10.12	1.00	16.67	10.67	0.92	17.64	11.17	0.84	18.62	11.66	0.76				
	67 (19.4)	13.36	12.75	0.98	14.32	13.27	1.02	15.29	14.28	0.93	16.24	15.19	0.85	17.19	16.14	0.77				

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage
Stage 1 — Compressor speed limited to stage two at 105 and 115 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

EDB °F (°C)	EVAR AIR °F (°C)	24VNA948 / FE4BNE06 Efficiency Mode Condenser Entering Air Temperature °F (°C)																										
		115 (46.1)				105 (40.5)				95 (35)				85 (29.4)				75 (23.9)				65 (18.3)						
		ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**			
STAGE 5																												
75 (23.9)	72 (22.2)	1400	44.82	18.57	5.52	47.96	19.76	4.88	50.99	20.91	4.29	53.98	22.06	3.74	56.89	23.19	3.23	1400	58.89	23.19	3.23	59.70	24.29	2.75	1400	54.60	31.27	2.75
	67 (19.4)	1400	40.99	24.95	5.42	43.86	26.26	4.80	46.65	27.54	4.23	49.36	28.80	3.70	52.01	30.04	3.21	1400	52.01	30.04	3.21	54.60	31.27	2.75	1400	50.78	36.72	2.74
	63 (17.2)	1400	38.13	29.97	5.34	40.79	31.36	4.74	43.37	32.72	4.18	45.91	34.07	3.67	48.37	35.40	3.19	1400	48.37	35.40	3.19	50.78	36.72	2.74	1400	45.70	44.59	2.73
	57 (13.9)	1400	35.29	35.29	5.26	37.41	37.41	4.66	39.46	39.46	4.12	41.45	41.45	3.62	43.58	43.09	3.16	1400	43.58	43.09	3.16	45.70	44.59	2.73	1400	59.48	31.07	2.75
	72 (22.2)	1400	44.60	24.79	5.51	47.74	26.09	4.88	50.77	27.36	4.28	53.76	28.82	3.73	56.66	29.86	3.22	1400	53.76	28.82	3.22	54.45	37.98	2.75	1400	54.45	37.98	2.75
80 (26.7)	67 (19.4)	1400	40.84	31.14	5.42	43.71	32.55	4.80	46.50	33.94	4.23	49.21	35.31	3.70	51.86	36.65	3.20	1400	49.21	35.31	3.20	54.45	37.98	2.75	1400	50.70	43.40	2.74
	63 (17.2)	1400	38.13	36.06	5.34	40.76	37.59	4.74	43.33	39.07	4.18	45.84	40.54	3.67	48.30	41.98	3.18	1400	45.84	40.54	3.18	50.70	43.40	2.74	1400	47.82	47.82	2.73
	57 (13.9)	1400	37.36	37.36	5.32	39.59	39.59	4.72	41.72	41.72	4.16	43.81	43.81	3.64	45.84	45.84	3.17	1400	43.81	43.81	3.17	47.82	47.82	2.73	1400	39.85	16.55	1.49
	72 (22.2)	1200	29.42	12.82	2.82	31.80	13.43	2.56	33.63	14.20	2.26	35.75	15.00	2.00	37.82	15.78	1.74	1200	35.75	15.00	2.00	39.85	16.55	1.49	1200	36.44	22.40	1.52
	67 (19.4)	1200	26.82	17.86	2.80	28.83	18.79	2.56	30.73	19.68	2.27	32.66	20.60	2.02	34.57	21.50	1.77	1200	30.73	19.68	2.27	36.44	22.40	1.52	1200	33.91	26.99	1.55
80 (26.7)	63 (17.2)	1200	24.03	24.03	2.78	25.61	25.61	2.55	27.12	27.12	2.26	28.62	28.62	2.03	30.11	30.11	1.80	1200	27.12	27.12	2.26	31.55	31.55	1.57	1200	31.55	31.55	1.57
	57 (13.9)	1200	29.22	17.78	2.81	31.39	18.70	2.55	33.41	19.57	2.25	35.52	20.47	2.00	37.60	21.37	1.74	1200	33.41	19.57	2.25	39.62	22.25	1.48	1200	36.30	28.05	1.52
	67 (19.4)	1200	26.71	22.96	2.80	28.71	24.01	2.56	30.60	25.01	2.26	32.52	26.03	2.01	34.42	27.05	1.77	1200	30.60	25.01	2.26	36.30	28.05	1.52	1200	33.93	32.55	1.55
	63 (17.2)	1200	25.56	25.56	2.80	27.23	27.23	2.55	28.80	28.80	2.26	30.48	30.24	2.02	32.21	31.42	1.78	1200	28.80	28.80	2.26	33.93	32.55	1.55	1200	33.43	33.43	1.55
	57 (13.9)	1200	25.52	25.52	2.80	27.19	27.19	2.55	28.76	28.76	2.26	30.35	30.35	2.02	31.90	31.90	1.78	1200	28.76	28.76	2.26	33.43	33.43	1.55	1200	23.61	10.07	0.57
75 (23.9)	72 (22.2)	1100	25.50	10.99	2.21	27.46	11.73	2.07	19.62	8.56	0.95	20.96	9.06	0.84	22.29	9.57	0.72	875	19.62	8.56	0.95	23.61	10.07	0.57	875	21.53	14.21	0.62
	67 (19.4)	1100	23.22	15.65	2.21	25.04	16.51	2.08	17.88	12.38	0.98	19.11	12.99	0.88	20.32	13.60	0.76	875	17.88	12.38	0.98	21.53	14.21	0.62	875	20.07	17.46	0.66
	63 (17.2)	1100	21.57	19.30	2.21	23.24	20.26	2.08	16.68	15.37	1.00	17.82	16.07	0.90	18.95	16.77	0.79	875	16.68	15.37	1.00	20.07	17.46	0.66	875	19.33	19.33	0.68
	57 (13.9)	1100	20.89	20.89	2.20	22.32	22.32	2.08	16.33	16.33	1.00	17.34	17.34	0.91	18.34	18.34	0.81	875	16.33	16.33	1.00	19.33	19.33	0.68	875	23.43	14.14	0.57
	72 (22.2)	1100	25.31	15.59	2.21	27.26	16.44	2.06	19.42	12.31	0.95	20.76	12.92	0.84	22.09	13.52	0.71	875	19.42	12.31	0.95	23.43	14.14	0.57	875	21.44	18.21	0.62
80 (26.7)	67 (19.4)	1100	23.13	20.20	2.21	24.93	21.18	2.07	17.82	16.09	0.98	19.04	16.80	0.88	20.25	17.51	0.76	875	17.82	16.09	0.98	21.44	18.21	0.62	875	20.50	20.50	0.65
	63 (17.2)	1100	22.25	22.25	2.21	23.77	23.77	2.08	17.35	17.35	0.98	18.41	18.41	0.89	19.46	19.46	0.78	875	17.35	17.35	0.98	20.50	20.50	0.65	875	20.47	20.47	0.65
	57 (13.9)	1100	22.21	22.21	2.21	23.73	23.73	2.08	17.32	17.32	0.98	18.39	18.39	0.89	19.43	19.43	0.78	875	17.32	17.32	0.98	20.47	20.47	0.65	875	19.43	19.43	0.78

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage
Stage 1 – Compressor speed limited to stage two at 105 and 115 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

24VNA948

COOLING INDOOR MODEL	CAPACITY	POWER	FURNACE MODEL
*FE4ANB006L	1.00	1.00	
FE4AN(B)F005L	0.98	0.98	
CAP**4817AL*	0.97	1.01	58CV(A.X)090-16
CSPH*4812AL*	0.98	1.03	58CV(A.X)090-16
CSPH*6012AL*	0.99	1.03	58CV(A.X)090-16
CAP**4821AL*	0.97	1.01	58CV(A.X)110-20
CAP**6021AL*	0.99	1.06	58CV(A.X)110-20
CNPV*4821AL*	0.97	1.01	58CV(A.X)110-20
CNPV*4821AL*	0.97	1.01	58CV(A.X)110-20
CSPH*4812AL*	0.98	1.03	58CV(A.X)110-20
CAP**4824AL*	0.97	1.00	58CV(A.X)135-22
CAP**4824AL*	0.97	1.03	58CV(A.X)135-22
CAP**6024AL*	0.99	1.06	58CV(A.X)135-22
CNPV*6024AL*	0.99	1.04	58CV(A.X)135-22
CNPV*6124AL*	1.00	1.05	58CV(A.X)135-22
CNPV*4824AL*	0.98	1.03	58CV(A.X)155-22
CNPV*6024AL*	0.99	1.06	58CV(A.X)155-22
CNPV*6124AL*	0.98	1.00	58CV(A.X)155-22
CNPV*4824AL*	0.99	1.04	58CV(A.X)155-22
CNPV*6024AL*	0.98	1.03	58CV(A.X)155-22
CNPV*6124AL*	0.97	1.01	59"N*A080V21**20
CAP**6021AL*	0.99	1.04	59"N*A080V21**20
CNPV*4821AL*	0.97	1.06	59"N*A080V21**20
CNPV*6012AL*	0.97	1.01	59"N*A080V21**20
CSPH*4812AL*	0.98	1.03	59"N*A080V21**20
CSPH*6012AL*	0.99	1.06	59"N*A080V21**20
CAP**6021AL*	0.97	1.01	59"N*A100V21**22
CNPV*4821AL*	0.97	1.01	59"N*A100V21**22
CNPV*6012AL*	0.98	1.03	59"N*A100V21**22
CSPH*4812AL*	0.99	1.06	59"N*A100V21**22
CSPH*6012AL*	0.99	1.04	59"N*A120V24**22
CAP**6024AL*	0.99	1.04	59"N*A120V24**22
CNPV*6024AL*	0.99	1.04	59"N*A120V24**22
CNPV*6124AL*	0.97	1.01	59"N*A120V24**22
CNPV*4824AL*	0.99	1.01	59"N*A120V24**22
CNPV*6024AL*	0.99	1.04	59"N*A120V24**22
CNPV*6124AL*	0.98	1.05	59"N*A120V24**22
CNPV*4824AL*	0.98	1.03	59"N*A120V24**22
CNPV*6024AL*	0.97	1.06	59MN7A060V21**20
CNPV*4824AL*	0.97	1.06	59MN7A060V21**20
CNPV*6024AL*	0.97	1.06	59MN7A060V21**20
CNPV*4824AL*	0.97	1.06	59MN7A060V21**20
CSPH*6012AL*	0.99	1.04	

2-STAGE (HI-Stage 5, Lo-Stage 2)		2-STAGE (HI-Stage 5, Lo-Stage 2)		2-STAGE (HI-Stage 5, Lo-Stage 2)		2-STAGE (HI-Stage 5, Lo-Stage 2)					
Cooling Indoor Model	High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model	Cooling Indoor Model	High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model
*FV4CNB006L	1.00	1.00	1.00	1.00							
FV4CN(B)F005L	0.99	0.99	0.99	1.03							
CAP**4817AL*	0.96	1.11	0.97	1.12	58PH*070-16						
CSPH*4812AL*	0.97	1.06	0.98	1.13	58PH*070-16						
CAP**4821AL*	0.96	1.00	0.98	1.06	58PH*090-16						
CAP**6021AL*	0.99	1.04	0.98	1.05	58PH*090-16						
CNPV*4821AL*	0.97	1.01	0.98	1.06	58PH*090-16						
CNPV*4821AL*	0.97	1.01	0.98	1.06	58PH*090-16						
CSPH*4812AL*	0.97	1.01	0.98	1.06	58PH*110-20						
CAP**6021AL*	0.96	1.00	0.98	1.05	58PH*110-20						
CNPV*4821AL*	0.97	1.01	0.98	1.05	58PH*110-20						
CNPV*4821AL*	0.97	1.01	0.98	1.05	58PH*110-20						
CSPH*4812AL*	0.97	0.99	0.99	1.10	58PH*110-20						
CAP**6024AL*	0.99	0.99	0.99	1.10	58PH*110-20						
CNPV*4812AL*	0.97	1.01	0.99	1.11	58PH*135-20						
CAP**4821AL*	0.96	1.00	0.97	1.05	58CTW090-16						
CAP**6021AL*	0.99	1.04	0.98	1.04	58CTW090-16						
CNPV*4812AL*	0.97	1.01	0.98	1.04	58CTW090-16						
CNPV*4821AL*	0.97	1.01	0.98	1.04	58CTW090-16						
CSPH*4812AL*	0.97	1.01	0.98	1.04	58CTW090-16						
CAP**4821AL*	0.99	0.99	0.98	1.02	58CTW110-22						
CNPV*4821AL*	0.97	1.01	0.98	1.03	58CTW110-22						
CNPV*4821AL*	0.97	1.01	0.98	1.03	58CTW110-22						
CSPH*4812AL*	0.98	1.02	0.98	1.03	58CTW110-22						
CSPH*6012AL*	1.00	1.00	0.99	1.02	58CTW135-22						
CAP**6024AL*	0.99	0.99	0.98	1.02	58CTW135-22						
CNPV*6024AL*	0.99	0.99	0.98	1.02	58CTW135-22						
CNPV*6124AL*	1.00	1.05	0.98	1.02	58CTW135-22						
CNPV*4824AL*	0.97	1.01	0.98	1.02	58CTW135-22						
CNPV*6024AL*	0.99	0.99	0.99	1.02	58CTW135-22						
CNPV*6124AL*	1.00	1.00	1.00	1.02	58CTW135-22						
CSPH*6012AL*	1.00	1.00	0.99	1.02	58CTW135-22						
CAP**4817AL*	0.97	1.01	0.98	1.06	59"P2A080E17**16						
CSPH*4812AL*	0.97	1.01	0.98	1.07	59"P2A080E17**16						
CAP**4821AL*	0.97	1.01	0.97	1.03	59"P2A080E21**20						
CAP**6021AL*	0.99	0.99	0.98	1.03	59"P2A080E21**20						
CNPV*4821AL*	0.97	1.01	0.98	1.03	59"P2A080E21**20						
CNPV*4821AL*	0.97	1.01	0.98	1.03	59"P2A080E21**20						
CSPH*4812AL*	0.98	1.02	0.98	1.04	59"P2A080E21**20						
CSPH*4812AL*	0.98	1.02	0.98	1.04	59"P2A080E21**20						
CAP**6021AL*	0.99	0.99	0.98	1.03	59"P2A100E21**20						
CNPV*4821AL*	0.97	1.01	0.98	1.03	59"P2A100E21**20						
CNPV*4821AL*	0.97	1.01	0.98	1.03	59"P2A100E21**20						
CSPH*4812AL*	0.98	1.02	0.98	1.04	59"P2A100E21**20						
CSPH*4812AL*	0.98	1.02	0.98	1.04	59"P2A100E21**20						
CAP**6024AL*	1.00	1.00	0.99	1.03	59"P2A120E24**20						
CAP**4824AL*	0.97	1.01	0.98	1.04	59"P2A120E24**20						
CNPV*4824AL*	0.99	0.99	0.99	1.03	59"P2A120E24**20						
CNPV*6124AL*	1.00	1.05	0.98	1.03	59"P2A120E24**20						
CNPV*4824AL*	0.97	1.01	0.98	1.04	59"P2A120E24**20						
CNPV*6024AL*	0.99	0.99	0.99	1.03	59"P2A120E24**20						
CNPV*6124AL*	1.00	1.00	0.99	1.02	59"P2A120E24**20						
CSPH*4812AL*	0.98	1.02	0.98	1.04	59"P2A120E24**20						

2-STAGE (HI-Stage 5, Lo-Stage 2)		2-STAGE (HI-Stage 5, Lo-Stage 2)		2-STAGE (HI-Stage 5, Lo-Stage 2)		2-STAGE (HI-Stage 5, Lo-Stage 2)					
Cooling Indoor Model	High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model	Cooling Indoor Model	High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model
CSPH*6012AL*	1.00	1.00	0.99	1.03	59*P5A120E24**20						
CAP**4817AL*	0.96	1.05	0.97	1.08	59*P5A090E17**16						
CSPH*4812AL*	0.97	1.06	0.97	1.08	59*P5A090E17**16						
CNPV*4821AL*	0.97	1.01	0.96	1.02	59*P5A090E21**20						
CNPV*4821AL*	0.97	1.01	0.96	1.02	59*P5A090E21**20						
CSPH*4812AL*	0.97	1.01	0.96	1.02	59*P5A090E21**20						
CAP**4821AL*	0.96	1.00	0.98	1.11	59*P5A100E21**20						
CAP**6021AL*	0.99	1.04	0.99	1.10	59*P5A100E21**20						
CAP**6021AL*	0.99	1.04	0.99	1.10	59*P5A100E21**20						
CNPV*4821AL*	0.97	1.01	0.99	1.11	59*P5A100E21**20						
CNPV*4821AL*	0.97	1.01	0.99	1.11	59*P5A100E21**20						
CSPH*4812AL*	0.97	1.01	0.99	1.11	59*P5A100E21**20						
CSPH*6012AL*	0.96	0.99	1.00	1.10	59*P5A100E21**20						
CAP**6024AL*	0.99	1.04	0.99	1.14	59*P5A120E24**22						

See notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

EDB °F (°C)	EVAR AIR °F (°C)	24VNA960 / FE4BNB00L Efficiency Mode Condenser Entering Air Temperature °F (°C)																									
		115 (46.1)				105 (40.5)				95 (35)				85 (29.4)				75 (23.9)				65 (18.3)					
		ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtuh Total	Sens†	Total Sys. KW**		
STAGE 5																											
75 (23.9)	72 (22.2)		55.38	22.79	7.70	59.00	24.17	6.73	62.54	25.53	5.88	65.96	26.86	5.13	69.30	28.16	4.47										
	67 (19.4)	1600	50.63	30.18	7.50	53.95	31.68	6.54	57.12	33.14	5.70	60.22	34.57	4.96	63.25	35.99	4.32	1600									
	63 (17.2)		47.11	36.00	7.35	50.18	37.58	6.40	53.13	39.12	5.57	55.99	40.62	4.84	58.78	42.11	4.21	1600									
	57 (13.9)		43.16	43.16	7.19	45.55	45.55	6.23	47.97	47.63	5.40	50.44	49.37	4.69	52.86	51.01	4.06										
	72 (22.2)		55.24	30.04	7.70	58.86	31.53	6.73	62.40	33.00	5.88	65.82	34.44	5.13	68.15	35.85	4.47										
80 (26.7)	67 (19.4)	1600	50.50	37.37	7.50	53.83	38.98	6.54	57.00	40.53	5.70	60.10	42.07	4.96	63.13	43.59	4.32	1600									
	63 (17.2)		47.09	43.10	7.35	50.13	44.81	6.40	53.07	46.46	5.57	55.91	48.08	4.84	58.70	49.67	4.21	1600									
	57 (13.9)		45.62	45.62	7.29	48.12	48.12	6.33	50.51	50.51	5.49	52.83	52.83	4.76	55.06	55.06	4.12										
	72 (22.2)		35.94	15.07	3.39	38.40	15.98	3.08	40.44	16.73	2.76	42.79	17.61	2.51	45.10	18.48	2.29										
	67 (19.4)	1350	32.49	20.54	3.35	34.72	21.48	3.05	36.67	22.32	2.72	38.80	23.24	2.47	40.88	24.15	2.24	1350									
80 (26.7)	63 (17.2)		29.95	24.83	3.33	32.01	25.81	3.03	33.87	26.70	2.69	35.85	27.65	2.44	37.78	28.59	2.22	1350									
	57 (13.9)		28.14	28.14	3.32	29.76	29.76	3.02	31.24	31.24	2.67	32.75	32.75	2.42	34.21	34.21	2.19										
	72 (22.2)		35.82	20.59	3.39	38.29	21.54	3.08	40.32	22.34	2.76	42.67	23.26	2.51	44.98	24.17	2.29										
	67 (19.4)	1350	32.39	26.01	3.35	34.62	26.99	3.05	36.56	27.87	2.72	38.70	28.83	2.47	40.78	29.77	2.24	1350									
	63 (17.2)		30.07	30.04	3.29	32.09	31.18	3.03	33.90	32.16	2.69	35.85	33.17	2.44	37.76	34.16	2.22										
75 (23.9)	72 (22.2)		26.64	11.34	1.89	28.56	12.02	1.84	20.89	8.78	1.03	22.26	9.26	1.00	23.59	9.73	0.91										
	67 (19.4)	1200	23.86	15.71	1.89	25.60	16.40	1.84	18.63	11.93	1.02	19.89	12.40	1.00	21.11	12.85	0.92	975									
	63 (17.2)		21.85	19.14	1.89	23.45	19.83	1.84	16.95	14.38	1.01	18.11	14.83	1.00	19.24	15.26	0.92	975									
	57 (13.9)		20.91	20.91	1.88	22.14	22.14	1.84	15.97	15.97	1.01	16.81	16.81	1.00	17.62	17.62	0.94										
	72 (22.2)		26.55	15.84	1.89	28.46	16.52	1.84	20.81	12.06	1.03	22.18	12.52	1.00	23.51	12.97	0.91										
80 (26.7)	67 (19.4)	1200	23.79	20.16	1.89	25.52	20.85	1.84	18.58	15.17	1.02	19.83	15.62	1.00	21.05	16.05	0.92	975									
	63 (17.2)		22.48	22.48	1.89	23.77	23.77	1.84	17.25	17.25	1.01	18.20	17.98	1.00	19.28	18.43	0.92	975									
	57 (13.9)		22.44	22.44	1.89	23.72	23.72	1.84	17.21	17.21	1.01	18.08	18.08	1.00	18.91	18.91	0.93										
	72 (22.2)		26.64	11.34	1.89	28.56	12.02	1.84	20.89	8.78	1.03	22.26	9.26	1.00	23.59	9.73	0.91										
	67 (19.4)	1200	23.86	15.71	1.89	25.60	16.40	1.84	18.63	11.93	1.02	19.89	12.40	1.00	21.11	12.85	0.92	975									

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage
Stage 1 – Compressor speed limited to stage two at 105 and 115 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - EFFICIENCY MODE CONTINUED

24VNA960

COOLING INDOOR MODEL		CAPACITY	POWER	FURNACE MODEL	
*FE4ANB006L	1.00	1.00			
CAP**6021AL*	0.99	0.99	58CV(A.X)110-20		
CAP**6024AL*	0.99	0.99	58CV(A.X)110-20		
CNPH*6024AL*	0.99	1.04	58CV(A.X)110-20		
CNPH*6124AL*	0.99	1.04	58CV(A.X)110-20		
CNPV*6024AL*	0.98	0.98	58CV(A.X)110-20		
CNPV*6124AL*	1.00	1.00	58CV(A.X)110-20		
CSPH*6012AL*	1.00	1.00	58CV(A.X)135-22		
CAP**6024AL*	0.99	0.99	58CV(A.X)135-22		
CNPH*6024AL*	0.99	0.99	58CV(A.X)135-22		
CNPH*6124AL*	1.00	1.00	58CV(A.X)135-22		
CNPV*6024AL*	0.98	0.98	58CV(A.X)135-22		
CNPV*6124AL*	1.00	1.00	58CV(A.X)135-22		
CSPH*6012AL*	1.00	1.00	58CV(A.X)155-22		
CAP**6024AL*	1.00	1.00	58CV(A.X)155-22		
CNPH*6024AL*	1.00	1.00	58CV(A.X)155-22		
CNPH*6124AL*	1.00	1.00	58CV(A.X)155-22		
CNPV*6024AL*	0.99	0.99	58CV(A.X)155-22		
CNPV*6124AL*	1.00	1.00	58CV(A.X)155-22		
CSPH*6012AL*	1.00	1.00	58CV(A.X)155-22		
CAP**6021AL*	0.99	1.04	59*N*A080V21**20		
CAP**6024AL*	0.99	1.04	59*N*A080V21**20		
CNPH*6024AL*	0.99	1.04	59*N*A080V21**20		
CNPH*6124AL*	0.99	1.04	59*N*A080V21**20		
CNPV*6024AL*	0.99	1.04	59*N*A080V21**20		
CNPV*6124AL*	1.00	1.04	59*N*A080V21**20		
CSPH*6012AL*	1.00	1.04	59*N*A100V21**22		
CAP**6024AL*	0.99	1.04	59*N*A100V21**22		
CNPH*6024AL*	0.99	1.04	59*N*A100V21**22		
CNPH*6124AL*	0.99	1.04	59*N*A100V21**22		
CNPV*6024AL*	0.98	0.98	59*N*A100V21**22		
CNPV*6124AL*	1.00	1.00	59*N*A100V21**22		
CSPH*6012AL*	1.00	1.00	59*N*A120V24**22		
CAP**6024AL*	0.99	1.04	59*N*A120V24**22		
CNPH*6024AL*	0.99	1.04	59*N*A120V24**22		
CNPH*6124AL*	0.99	1.04	59*N*A120V24**22		
CNPV*6024AL*	0.99	1.04	59*N*A120V24**22		
CNPV*6124AL*	1.00	1.04	59*N*A120V24**22		
CSPH*6012AL*	1.00	1.03	59*N*A120V24**22		
CAP**6021AL*	0.99	1.00	59*N*A120V24**22		
CSPH*6012AL*	1.00	1.00	59*N*A120V24**22		
CAP**6024AL*	0.98	1.03	59MN7A060V21**20		
CNPH*6024AL*	0.98	1.09	59MN7A060V21**20		
CNPH*6124AL*	0.98	1.09	59MN7A060V21**20		
CNPV*6024AL*	0.97	1.02	59MN7A060V21**20		
CNPV*6124AL*	0.99	1.04	59MN7A060V21**20		
CSPH*6012AL*	0.99	1.04	59MN7A060V21**20		

2 - STAGE (HI-Stage 5, Lo-Stage 2)					
Cooling Indoor Model	High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model
*FV4CNB006L	1.00	1.00	1.00	1.00	
CAP**6021AL*	1.01	1.06	1.01	1.07	58PH*110-20
CSPH*6012AL*	1.02	1.07	1.00	1.04	58PH*110-20
CAP**6024AL*	1.01	1.06	1.00	1.11	58PH*135-20
CNPH*6024AL*	1.01	1.06	1.01	1.06	58PH*135-20
CNPH*6124AL*	1.01	1.06	1.01	1.12	58PH*135-20
CNPV*6024AL*	1.00	1.05	1.01	1.06	58PH*135-20
CNPV*6124AL*	1.02	1.07	1.00	1.03	58PH*135-20
CSPH*6012AL*	1.02	1.07	1.01	1.05	58PH*135-20
CAP**6021AL*	1.01	1.06	1.01	1.07	58CTW110-22
CSPH*6012AL*	1.02	1.07	1.00	1.04	58CTW110-22
CAP**6024AL*	1.01	1.06	1.01	1.06	58CTW135-22
CNPH*6024AL*	1.01	1.06	1.01	1.06	58CTW135-22
CNPH*6124AL*	1.01	1.06	1.01	1.06	58CTW135-22
CNPV*6024AL*	1.00	1.05	1.01	1.06	58CTW135-22
CNPV*6124AL*	1.02	1.07	1.01	1.04	58CTW135-22
CSPH*6012AL*	1.02	1.07	1.00	1.04	58CTW135-22
CAP**6021AL*	1.01	1.06	1.01	1.07	59*P2A080E21**20
CSPH*6012AL*	1.02	1.07	1.00	1.05	59*P2A100E21**20
CAP**6024AL*	1.01	1.06	1.01	1.07	59*P2A120E24**20
CNPH*6024AL*	1.01	1.06	1.01	1.07	59*P2A120E24**20
CNPH*6124AL*	1.01	1.06	1.01	1.07	59*P2A120E24**20
CNPV*6024AL*	1.00	1.05	1.01	1.07	59*P2A120E24**20
CNPV*6124AL*	1.02	1.07	1.00	1.04	59*P2A120E24**20
CSPH*6012AL*	1.02	1.07	1.00	1.05	59*P2A120E24**20
CAP**6021AL*	0.99	1.04	1.01	1.11	59*P2A120E24**20
CSPH*6012AL*	1.00	1.05	1.01	1.10	59*P2A120E24**20
CAP**6024AL*	1.00	1.05	1.01	1.11	59*P2A120E24**20
CNPH*6024AL*	1.00	1.05	1.01	1.11	59*P2A120E24**20
CNPH*6124AL*	1.00	1.05	1.01	1.11	59*P2A120E24**20
CNPV*6024AL*	1.00	1.05	1.01	1.10	59*P2A120E24**20
CNPV*6124AL*	1.00	1.05	1.01	1.10	59*P2A120E24**20
CSPH*6012AL*	1.00	1.05	1.01	1.11	59*P2A120E24**20
CAP**6024AL*	0.99	1.04	1.01	1.11	59*P2A120E24**20
CNPV*6124AL*	1.00	1.05	1.01	1.09	59*P2A120E24**20
CSPH*6012AL*	1.00	1.05	1.01	1.10	59*P2A120E24**20
CSPH*6012AL*	1.01	1.06	1.00	1.11	59*P2A120E24**20
CAP**6024AL*	0.99	1.04	1.01	1.11	59*P2A120E24**20
CNPH*6124AL*	1.00	1.05	1.01	1.10	59*P2A120E24**20
CNPV*6024AL*	0.98	1.03	1.01	1.10	59*P2A120E24**20
CNPV*6124AL*	1.00	1.05	1.01	1.09	59*P2A120E24**20
CSPH*6012AL*	1.00	1.05	1.01	1.08	59*P2A120E24**20
CAP**6024AL*	0.99	1.04	1.01	1.09	OVLAAB060154
CNPV*6024AL*	0.99	1.04	1.01	1.09	OVLAAB060154
CNPV*6124AL*	1.01	1.06	1.01	1.07	OVLAAB060154
CNPV*6124AL*	1.01	1.06	1.01	1.11	OVMAAB060154
CSPH*6012AL*	1.01	1.06	1.00	1.11	OVMAAB060154

See notes on page 34

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE

EDB ° F (° C)	EVAP. AIR ° F (° C)	105 (40.5)				85 (35)				75 (23.9)				65 (18.3)			
		Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	
		Total	Sensit		Total	Sensit		Total	Sensit		Total	Sensit		Total	Sensit		
		ID SCFM	Total Sys. KW		ID SCFM	Total Sys. KW		ID SCFM	Total Sys. KW		ID SCFM	Total Sys. KW		ID SCFM	Total Sys. KW		
		STAGE 5				STAGE 3				STAGE 1 - FEANP005 ONLY				STAGE 1 - ALL OTHER INDOOR COMBINATIONS			
75 (23.9)	72 (22.2)	18.41	7.66	1.92	24.19	9.83	2.05	25.62	10.41	1.59	27.05	11.00	1.19	28.58	11.63	0.84	
	67	16.71	10.40	1.94	22.02	12.63	2.06	23.35	13.37	1.62	24.68	14.13	1.23	26.09	15.02	0.89	
	63	15.50	12.56	1.95	20.40	14.80	2.07	21.64	15.67	1.63	22.89	16.56	1.25	24.23	17.65	0.92	
	57	14.52	14.52	1.95	18.30	18.00	2.07	19.43	19.04	1.65	20.56	20.13	1.28	21.81	21.49	0.95	
	57 (13.9)	18.29	10.37	1.91	24.08	12.57	2.04	25.50	13.30	1.59	26.92	14.05	1.19	28.43	14.92	0.84	
80 (26.7)	72 (22.2)	16.65	13.09	1.94	21.95	15.35	2.06	23.28	16.24	1.62	24.60	17.16	1.23	26.00	18.28	0.89	
	67	15.55	15.22	1.95	20.38	17.52	2.07	21.62	18.53	1.63	22.87	19.59	1.25	24.20	20.91	0.92	
	63	15.42	15.42	1.95	19.24	19.24	2.07	20.39	20.39	1.64	21.57	21.57	1.27	22.92	22.92	0.94	
	57	15.17	6.19	1.32	15.89	6.46	1.09	16.82	6.84	0.91	17.81	7.24	0.73	18.87	7.88	0.54	
	57 (13.9)	13.78	8.02	1.34	14.47	8.33	1.11	15.33	8.80	0.93	16.24	9.32	0.76	17.22	9.94	0.59	
75 (23.9)	72 (22.2)	12.75	9.46	1.34	13.41	9.80	1.12	14.22	10.33	0.95	15.07	10.96	0.79	16.00	11.72	0.62	
	67	11.46	11.46	1.35	12.02	11.94	1.12	12.74	12.57	0.97	13.52	13.34	0.82	14.39	14.31	0.66	
	63	15.10	8.00	1.32	15.81	8.29	1.09	16.74	8.75	0.91	17.72	9.27	0.72	18.78	9.88	0.54	
	57	13.74	9.82	1.34	14.42	10.15	1.11	15.28	10.70	0.93	16.19	11.34	0.76	17.16	12.14	0.59	
	57 (13.9)	12.73	11.26	1.34	13.39	11.61	1.12	14.20	12.23	0.95	15.05	12.97	0.79	15.98	13.90	0.62	
80 (26.7)	72 (22.2)	12.15	12.15	1.34	12.69	12.69	1.12	13.42	13.42	0.96	14.24	14.24	0.80	15.18	15.18	0.64	
	67	11.66	4.74	0.81	9.26	3.75	0.47	9.75	3.95	0.47	10.23	4.15	0.43	10.72	4.35	0.36	
	63	10.56	6.08	0.83	8.39	4.68	0.48	8.84	4.89	0.49	9.27	5.09	0.47	9.70	5.30	0.40	
	57	9.75	7.13	0.83	7.74	5.40	0.49	8.15	5.61	0.51	8.56	5.83	0.49	8.96	6.04	0.44	
	57 (13.9)	8.68	8.68	0.84	6.85	6.46	0.49	7.22	6.68	0.52	7.59	6.90	0.52	7.95	7.12	0.48	
75 (23.9)	72 (22.2)	11.61	6.08	0.81	9.23	4.68	0.47	9.72	4.88	0.47	10.20	5.09	0.43	10.68	5.30	0.36	
	67	10.53	7.41	0.83	8.37	5.60	0.48	8.81	5.82	0.49	9.25	6.03	0.47	9.68	6.24	0.40	
	63	9.73	8.46	0.83	7.72	6.32	0.49	8.14	6.54	0.51	8.54	6.76	0.49	8.95	6.98	0.44	
	57	9.21	9.21	0.83	7.09	7.09	0.49	7.40	7.40	0.52	7.70	7.70	0.51	8.00	8.00	0.48	
	57 (13.9)	11.66	4.74	0.81	8.99	3.64	0.47	9.59	3.89	0.48	10.23	4.15	0.43	10.66	4.33	0.36	
80 (26.7)	72 (22.2)	10.56	6.08	0.83	8.13	4.46	0.48	8.68	4.76	0.50	9.04	4.92	0.48	9.65	5.25	0.41	
	67	9.75	7.13	0.83	7.49	5.09	0.49	8.00	5.44	0.51	8.34	5.68	0.50	8.91	5.98	0.44	
	63	8.68	8.68	0.84	6.63	6.02	0.49	7.09	6.43	0.52	7.39	6.56	0.52	7.90	7.04	0.48	
	57	11.61	6.08	0.81	8.96	4.47	0.47	9.55	4.76	0.47	10.20	5.09	0.43	10.62	5.26	0.36	
	57 (13.9)	10.53	7.41	0.83	8.11	5.28	0.48	8.66	5.63	0.50	9.02	5.78	0.48	9.63	6.18	0.41	
75 (23.9)	72 (22.2)	9.73	8.46	0.83	7.48	5.91	0.49	7.99	6.31	0.51	8.33	6.44	0.50	8.89	6.91	0.44	
	67	9.21	9.21	0.83	6.73	6.73	0.49	7.19	7.19	0.52	7.40	7.40	0.52	7.93	7.93	0.48	
	63	11.66	4.74	0.81	8.99	3.64	0.47	9.59	3.89	0.48	10.23	4.15	0.43	10.66	4.33	0.36	
	57	10.56	6.08	0.83	8.13	4.46	0.48	8.68	4.76	0.50	9.04	4.92	0.48	9.65	5.25	0.41	
	57 (13.9)	9.75	7.13	0.83	7.49	5.09	0.49	8.00	5.44	0.51	8.34	5.68	0.50	8.91	5.98	0.44	
80 (26.7)	72 (22.2)	8.68	8.68	0.84	6.63	6.02	0.49	7.09	6.43	0.52	7.39	6.56	0.52	7.90	7.04	0.48	
	67	11.61	6.08	0.81	8.96	4.47	0.47	9.55	4.76	0.47	10.20	5.09	0.43	10.62	5.26	0.36	
	63	10.53	7.41	0.83	8.11	5.28	0.48	8.66	5.63	0.50	9.02	5.78	0.48	9.63	6.18	0.41	
	57	9.73	8.46	0.83	7.48	5.91	0.49	7.99	6.31	0.51	8.33	6.44	0.50	8.89	6.91	0.44	
	57 (13.9)	9.21	9.21	0.83	6.73	6.73	0.49	7.19	7.19	0.52	7.40	7.40	0.52	7.93	7.93	0.48	

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage

Stage 1 — Compressor speed limited to stage two at 105 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE

24VVA924B / FEANF002L Comfort + Dehumidify Mode
Condenser Entering Air Temperature F (°C)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	105 (40.5)				95 (35)				85 (29.4)				75 (23.9)				65 (18.3)			
		Capacity MBtuh		Total Sys. KW	ID SCFM	Capacity MBtuh		Total Sys. KW	ID SCFM	Capacity MBtuh		Total Sys. KW	ID SCFM	Capacity MBtuh		Total Sys. KW	ID SCFM	Capacity MBtuh		Total Sys. KW	
		Total	Sensit			Total	Sensit			Total	Sensit			Total	Sensit			Total	Sensit		Total
75 (23.9)	72 (22.2)	24.23	9.92	2.44	25.33	10.31	2.12	26.93	10.95	1.84	28.54	11.60	1.58	30.28	12.32	1.33	708	708	708	1.33	
	67 (19.4)	22.01	12.96	2.42	23.01	13.22	2.10	24.45	14.00	1.83	25.91	14.82	1.58	27.51	15.77	1.34					
	63 (17.2)	20.38	15.34	2.39	21.31	15.50	2.08	22.64	16.40	1.82	24.00	17.33	1.57	25.48	18.47	1.35					
	57 (13.9)	18.45	18.45	2.36	19.08	18.80	2.05	20.28	19.87	1.80	21.49	20.99	1.57	22.82	22.37	1.36					
	72 (22.2)	24.17	12.95	2.44	25.27	13.22	2.12	26.87	14.00	1.84	28.48	14.82	1.58	30.22	15.77	1.33					
80 (26.7)	67 (19.4)	21.96	15.96	2.42	22.96	16.09	2.10	24.40	17.02	1.83	25.86	17.99	1.58	27.45	19.17	1.34	708	708	708	1.34	
	63 (17.2)	20.36	18.31	2.39	21.28	18.35	2.08	22.61	19.39	1.82	23.97	20.49	1.57	25.45	21.85	1.35					
	57 (13.9)	19.56	19.56	2.38	20.08	20.08	2.07	21.29	21.29	1.81	22.54	22.54	1.57	23.97	23.97	1.35					
	72 (22.2)	16.80	6.88	1.49	17.53	7.13	1.28	18.69	7.80	1.10	19.82	8.06	0.92	21.04	8.55	0.76					
	67 (19.4)	15.18	8.96	1.50	15.85	9.13	1.28	16.89	9.72	1.11	17.91	10.28	0.95	18.99	10.93	0.79					
75 (23.9)	63 (17.2)	13.98	10.59	1.50	14.80	10.69	1.28	15.56	11.37	1.13	16.49	12.01	0.97	17.48	12.77	0.82	484	484	484	0.82	
	57 (13.9)	12.83	12.83	1.49	12.99	12.94	1.29	13.83	13.75	1.14	14.64	14.51	1.00	15.53	15.43	0.86					
	72 (22.2)	16.75	8.99	1.49	17.48	9.16	1.28	18.64	9.75	1.10	19.77	10.32	0.92	20.98	10.97	0.76					
	67 (19.4)	15.14	11.05	1.50	15.81	11.13	1.28	16.85	11.84	1.11	17.87	12.51	0.95	18.95	13.31	0.79					
	63 (17.2)	13.97	12.86	1.50	14.59	12.68	1.28	15.54	13.48	1.13	16.47	14.23	0.97	17.46	15.14	0.82					
80 (26.7)	57 (13.9)	13.43	13.43	1.50	13.78	13.78	1.29	14.66	14.66	1.13	15.51	15.51	0.99	16.47	16.47	0.84	484	484	484	0.84	
	72 (22.2)	13.91	5.70	1.21	8.34	3.43	0.52	8.89	3.65	0.44	9.31	3.80	0.37	9.90	4.05	0.29					
	67 (19.4)	12.50	7.42	1.22	7.48	4.49	0.53	7.97	4.78	0.46	8.34	4.91	0.40	8.86	5.24	0.33					
	63 (17.2)	11.48	8.77	1.22	6.85	5.34	0.53	7.30	5.67	0.47	7.63	5.79	0.41	8.11	6.18	0.35					
	57 (13.9)	10.41	10.41	1.22	6.25	6.25	0.54	6.65	6.65	0.48	6.87	6.87	0.43	7.32	7.32	0.37					
75 (23.9)	72 (22.2)	13.87	7.46	1.21	8.31	4.53	0.52	8.86	4.82	0.44	9.28	4.96	0.37	9.87	5.29	0.29	245	245	245	0.29	
	67 (19.4)	12.47	9.17	1.22	7.45	5.59	0.53	7.94	5.94	0.46	8.31	6.06	0.40	8.83	6.48	0.33					
	63 (17.2)	11.48	10.51	1.22	6.85	6.43	0.53	7.30	6.83	0.47	7.62	6.93	0.41	8.10	7.41	0.35					
	57 (13.9)	11.08	11.08	1.22	6.68	6.68	0.54	7.10	7.10	0.48	7.33	7.33	0.42	7.81	7.81	0.36					
	72 (22.2)	13.91	5.70	1.21	8.34	3.43	0.52	8.89	3.65	0.44	9.31	3.80	0.37	9.90	4.05	0.29					
80 (26.7)	67 (19.4)	12.50	7.42	1.22	7.48	4.49	0.53	7.97	4.78	0.46	8.34	4.91	0.40	8.86	5.24	0.33	245	245	245	0.33	
	63 (17.2)	11.48	8.77	1.22	6.85	5.34	0.53	7.30	5.67	0.47	7.63	5.79	0.41	8.11	6.18	0.35					
	57 (13.9)	10.41	10.41	1.22	6.25	6.25	0.54	6.65	6.65	0.48	6.87	6.87	0.43	7.32	7.32	0.37					
	72 (22.2)	13.87	7.46	1.21	8.31	4.53	0.52	8.86	4.82	0.44	9.28	4.96	0.37	9.87	5.29	0.29					
	67 (19.4)	12.47	9.17	1.22	7.45	5.59	0.53	7.94	5.94	0.46	8.31	6.06	0.40	8.83	6.48	0.33					
80 (26.7)	63 (17.2)	11.48	10.51	1.22	6.85	6.43	0.53	7.30	6.83	0.47	7.62	6.93	0.41	8.10	7.41	0.35	245	245	245	0.35	
	57 (13.9)	11.08	11.08	1.22	6.68	6.68	0.54	7.10	7.10	0.48	7.33	7.33	0.42	7.81	7.81	0.36					

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage
Stage 1 – Compressor speed limited to stage two at 105 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE

EDB ° F (° C)	EVAP. AIR EWB ° F (° C)		105 (40.5)				85 (35)				75 (23.9)				65 (18.3)			
			Capacity MBtuh		Total Sys. KW		Capacity MBtuh		Total Sys. KW		Capacity MBtuh		Total Sys. KW		Capacity MBtuh		Total Sys. KW	
			Total	Sensit	Total	Sensit	Total	Sensit	Total	Sensit	Total	Sensit	Total	Sensit	Total	Sensit	Total	Sensit
			ID SCFM	Total Sys. KW	ID SCFM	Total Sys. KW	ID SCFM	Total Sys. KW	ID SCFM	Total Sys. KW	ID SCFM	Total Sys. KW	ID SCFM	Total Sys. KW	ID SCFM	Total Sys. KW		
75 (23.9)	72 (22.2)	8.01	19.25	25.24	10.26	1.88	26.68	10.84	1.61	28.11	11.43	1.34	29.64	12.06	1.07			
	67 (19.4)	10.88	17.48	22.98	13.18	1.89	24.31	13.92	1.63	25.64	14.68	1.38	27.06	15.57	1.13			
	63 (17.2)	13.13	16.21	21.29	15.45	1.90	22.54	16.31	1.65	23.79	17.21	1.41	25.13	18.30	1.17			
	57 (13.9)	15.18	15.18	19.10	18.78	1.90	20.23	19.83	1.66	21.37	20.92	1.44	22.62	22.29	1.21			
	72 (22.2)	10.84	19.12	25.12	13.12	1.88	26.55	13.85	1.60	27.98	14.60	1.33	29.49	15.47	1.07			
80 (26.7)	67 (19.4)	13.69	17.42	22.91	16.02	1.89	24.24	16.91	1.63	25.56	17.83	1.38	26.97	18.96	1.13			
	63 (17.2)	15.91	16.26	21.26	18.28	1.90	22.51	19.29	1.65	23.76	20.35	1.41	25.10	21.68	1.17			
	57 (13.9)	16.12	16.12	20.08	20.08	1.90	21.23	21.23	1.66	22.41	22.41	1.42	23.77	23.77	1.19			
	72 (22.2)	6.37	15.62	16.33	6.64	1.03	17.27	7.02	0.91	18.26	7.42	0.78	19.32	7.87	0.62			
	67 (19.4)	8.25	14.19	14.88	8.57	1.04	15.74	9.03	0.94	16.66	9.56	0.82	17.64	10.18	0.68			
75 (23.9)	63 (17.2)	9.74	13.12	13.79	10.07	1.05	14.60	10.61	0.96	15.46	11.23	0.85	16.38	12.00	0.71			
	57 (13.9)	11.80	11.80	12.35	12.27	1.06	13.08	12.91	0.97	13.87	13.68	0.88	14.74	14.85	0.76			
	72 (22.2)	8.23	15.55	16.25	8.52	1.02	17.19	8.98	0.91	18.17	9.50	0.78	19.23	10.12	0.62			
	67 (19.4)	10.11	14.14	14.83	10.44	1.04	15.69	10.99	0.94	16.60	11.63	0.82	17.57	12.43	0.67			
	63 (17.2)	11.59	13.11	13.77	11.94	1.05	14.58	12.56	0.96	15.44	13.30	0.85	16.36	14.24	0.71			
57 (13.9)	12.51	12.51	13.05	13.05	1.05	13.78	13.78	0.97	14.60	14.60	0.86	15.55	15.55	0.74				
75 (23.9)	72 (22.2)	2.59	6.36	9.26	3.75	0.47	9.75	3.95	0.47	10.23	4.15	0.43	10.72	4.35	0.36			
	67 (19.4)	6.18	10.72	8.39	4.68	0.48	8.84	4.89	0.49	9.27	5.09	0.47	9.70	5.30	0.40			
	63 (17.2)	7.24	9.90	7.74	5.40	0.49	8.15	5.61	0.51	8.56	5.83	0.49	8.96	6.04	0.44			
	57 (13.9)	8.81	8.82	6.85	6.46	0.49	7.22	6.68	0.52	7.59	6.90	0.52	7.95	7.12	0.48			
	72 (22.2)	6.17	11.79	9.23	4.68	0.47	9.72	4.88	0.47	10.20	5.09	0.43	10.68	5.30	0.36			
80 (26.7)	67 (19.4)	7.53	10.69	8.37	5.60	0.48	8.81	5.82	0.49	9.25	6.03	0.47	9.68	6.24	0.40			
	63 (17.2)	8.60	9.88	7.72	6.32	0.49	8.14	6.54	0.51	8.54	6.76	0.49	8.95	6.98	0.44			
	57 (13.9)	9.35	9.35	7.09	7.09	0.49	7.40	7.40	0.52	7.70	7.70	0.51	8.00	8.00	0.48			
	72 (22.2)	1.29	3.18	8.99	3.64	0.47	9.59	3.89	0.48	9.99	4.06	0.44	10.66	4.33	0.36			
	67 (19.4)	6.18	10.72	8.13	4.46	0.48	8.68	4.76	0.50	9.04	4.92	0.48	9.65	5.25	0.41			
75 (23.9)	63 (17.2)	7.24	9.90	7.49	5.09	0.49	8.00	5.44	0.51	8.34	5.68	0.50	8.91	5.98	0.44			
	57 (13.9)	8.81	8.82	6.63	6.02	0.49	7.09	6.43	0.52	7.39	6.56	0.52	7.90	7.04	0.48			
	72 (22.2)	6.17	11.79	8.96	4.47	0.47	9.55	4.76	0.47	9.96	4.92	0.44	10.62	5.26	0.36			
	67 (19.4)	7.53	10.69	8.11	5.28	0.48	8.66	5.63	0.50	9.02	5.78	0.48	9.63	6.18	0.41			
	63 (17.2)	8.60	9.88	7.48	5.91	0.49	7.99	6.31	0.51	8.33	6.44	0.50	8.89	6.91	0.44			
57 (13.9)	9.35	9.35	6.73	6.73	0.49	7.19	7.19	0.52	7.40	7.40	0.52	7.93	7.93	0.48				

STAGE 1 - ALL OTHER INDOOR COMBINATIONS

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage

Stage 1 - Compressor speed limited to stage two at 105 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE CONTINUED

24VNA925

COOLING INDOOR MODEL	CAPACITY	POWER	FURNACE MODEL
*FE4AN(B,F)005L	1.00	1.00	
FE4AN(B,F)003L	0.96	0.98	
FE4AN(B)006L	0.98	1.07	
FE4AN(B)002L	0.96	0.98	
CAP**3614AL*	0.98	1.01	58CV(A,X)070-12
CAP**3617AL*	0.98	1.01	58CV(A,X)070-12
CNPV*3617AL*	0.98	1.02	58CV(A,X)070-12
CNPV*3617AL*	0.97	0.99	58CV(A,X)070-12
CNPV*3717AL*	0.98	1.00	58CV(A,X)070-12
CNPV*4217AL*	0.96	0.98	58CV(A,X)070-12
CSPH**3612AL*	1.00	1.02	58CV(A,X)090-12
CSPH**4212AL*	1.00	1.02	58CV(A,X)070-12
CAP**3617AL*	0.98	1.01	58CV(A,X)090-16
CAP**3621AL*	0.98	1.01	58CV(A,X)090-16
CAP**4221AL*	0.99	0.99	58CV(A,X)090-16
CNPV*3617AL*	0.98	1.01	58CV(A,X)090-16
CNPV*3617AL*	0.97	0.99	58CV(A,X)090-16
CNPV*3621AL*	0.97	0.99	58CV(A,X)090-16
CNPV*3717AL*	0.98	0.98	58CV(A,X)090-16
CNPV*4217AL*	0.96	0.98	58CV(A,X)090-16
CNPV*4217AL*	0.98	0.98	58CV(A,X)090-16
CSPH**3612AL*	1.00	1.00	58CV(A,X)090-16
CSPH**4212AL*	1.01	1.01	58CV(A,X)090-16
CAP**3617AL*	0.98	1.02	59*N*A060V17**14
CAP**3621AL*	0.98	1.01	59*N*A060V17**14
CAP**4221AL*	0.98	1.01	59*N*A060V17**14
CNPV*3617AL*	0.98	1.11	59*N*A060V17**14
CNPV*4221AL*	0.98	1.12	59*N*A060V17**14
CNPV*3617AL*	0.94	1.02	59*N*A060V17**14
CNPV*3717AL*	0.94	1.02	59*N*A060V17**14
CNPV*4217AL*	0.95	1.00	59*N*A060V17**14
CNPV*4221AL*	0.95	1.03	59*N*A060V17**14
CSPH**3612AL*	0.99	1.02	59*N*A060V17**14
CSPH**4212AL*	1.00	1.02	59*N*A060V17**14
CAP**3617AL*	0.98	1.01	59*N*A080V17**14
CAP**3621AL*	0.98	1.01	59*N*A080V17**14
CAP**4221AL*	0.99	1.02	59*N*A080V17**14
CNPV*3617AL*	0.98	1.07	59*N*A080V17**14
CNPV*4221AL*	0.99	1.08	59*N*A080V17**14
CNPV*3617AL*	0.95	1.03	59*N*A080V17**14
CNPV*3717AL*	0.98	1.00	59*N*A080V17**14
CNPV*4217AL*	0.98	1.00	59*N*A080V17**14
CNPV*4221AL*	1.00	1.02	59*N*A080V17**20
CAP**3621AL*	0.98	1.02	59MN7A060V21**20
CAP**4224AL*	0.99	1.02	59MN7A060V21**20

2-STAGE (HI-Stage 5, Lo-Stage 2)					
Cooling Indoor Model	High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model
FV4CN(B,F)003L	0.94	0.98	0.99	0.94	
FV4CN(B)002L	0.94	0.98	1.00	0.97	
CAP**2414AL*	0.94	1.02	1.08	1.12	58PH*045-08
CAP**2417AL*	0.94	1.02	1.09	1.12	58PH*045-08
CAP**3014AL*	0.95	0.99	1.08	1.11	58PH*045-08
CAP**3017AL*	0.95	0.99	1.09	1.11	58PH*045-08
CNPV*2414AL*	0.93	1.01	1.08	1.12	58PH*045-08
CNPV*2417AL*	0.93	1.01	1.08	1.12	58PH*045-08
CNPV*3014AL*	0.95	1.03	1.08	1.11	58PH*045-08
CNPV*3017AL*	0.95	1.03	1.09	1.11	58PH*045-08
CNPV*3117AL*	0.95	0.99	1.12	1.11	58PH*045-08
CAP**2414AL*	0.93	0.97	1.08	1.08	58CTW045-12
CAP**2417AL*	0.94	0.98	1.08	1.07	58CTW045-12
CAP**3014AL*	0.93	0.96	1.10	1.09	58CTW045-12
CAP**3017AL*	0.93	0.97	1.11	1.09	58CTW045-12
CNPV*2414AL*	0.93	1.01	1.08	1.07	58CTW045-12
CNPV*2417AL*	0.93	1.01	1.10	1.09	58CTW045-12
CNPV*3014AL*	0.93	0.97	1.11	1.09	58CTW045-12
CNPV*3017AL*	0.94	0.98	1.12	1.06	58CTW045-12
CSPH**3012AL*	0.93	0.96	1.11	1.08	58CTW045-12
CAP**2414AL*	0.93	0.96	1.11	1.09	58CTW070-16
CNPV*2417AL*	0.93	0.97	1.11	1.08	58CTW070-16
CNPV*3017AL*	0.96	1.04	1.09	1.07	58CTW070-16
CNPV*3117AL*	0.93	1.01	1.11	1.08	58CTW070-16
CNPV*4217AL*	0.93	1.01	1.08	1.07	58CTW070-16
CNPV*3017AL*	0.93	0.97	1.11	1.05	58CTW070-16
CNPV*3117AL*	0.95	0.99	1.12	1.08	58CTW070-16
CSPH**2412AL*	0.97	1.05	1.09	1.08	58CTW070-16
CSPH**3012AL*	0.93	0.97	1.11	1.07	58CTW070-16
CSPH**2412AL*	0.94	0.98	1.13	1.15	58CTW090-16
CSPH**3012AL*	0.95	0.99	1.14	1.12	58CTW090-16
CAP**2414AL*	0.95	1.03	1.08	1.13	59*P2A040E14**10
CAP**2417AL*	0.93	1.01	1.08	1.13	59*P2A040E14**10
CAP**3014AL*	0.94	1.02	1.07	1.12	59*P2A040E14**10
CNPV*2414AL*	0.93	1.01	1.07	1.13	59*P2A040E14**10
CNPV*2417AL*	0.93	1.01	1.07	1.13	59*P2A040E14**10
CNPV*3014AL*	0.94	1.02	1.07	1.12	59*P2A040E14**10
CNPV*3017AL*	0.95	1.03	1.08	1.12	59*P2A040E14**10
CNPV*3117AL*	0.94	0.98	1.11	1.11	59*P2A040E14**10
CSPH**2412AL*	0.96	1.04	1.10	1.23	59*P2A040E14**10
CSPH**3012AL*	0.97	1.05	1.09	1.11	59*P2A040E14**10
CAP**2417AL*	0.93	1.01	1.07	1.12	59*P2A040E17**12
CAP**3017AL*	0.95	1.03	1.08	1.13	59*P2A040E17**12
CNPV*2417AL*	0.95	1.08	1.08	1.13	59*P2A040E17**12
CNPV*3017AL*	0.97	1.05	1.09	1.10	59*P2A040E17**12
CNPV*3117AL*	0.93	1.01	1.07	1.13	59*P2A040E17**12
CNPV*4217AL*	0.95	1.03	1.08	1.12	59*P2A040E17**12
CSPH**3117AL*	0.97	1.05	1.09	1.10	59*P2A040E17**12
CSPH**2412AL*	0.96	1.04	1.10	1.25	59*P2A040E17**12
CAP**2414AL*	0.94	0.98	1.09	1.10	59*P2A060E14**12
CAP**2417AL*	0.95	0.99	1.10	1.10	59*P2A060E14**12
CAP**3014AL*	0.93	0.97	1.11	1.11	59*P2A060E14**12

2-STAGE (HI-Stage 5, Lo-Stage 2)					
Cooling Indoor Model	High Speed Cap.	Power	Low Speed Cap.	Power	Furnace Model
CAP**3017AL*	0.94	0.98	1.12	1.11	59*P2A060E14**12
CNPV*2414AL*	0.94	1.02	1.09	1.09	59*P2A060E14**12
CNPV*2417AL*	0.94	1.02	1.09	1.09	59*P2A060E14**12
CNPV*3014AL*	0.93	1.01	1.11	1.11	59*P2A060E14**12
CNPV*3017AL*	0.94	0.98	1.12	1.11	59*P2A060E14**12
CNPV*3117AL*	0.96	1.00	1.13	1.09	59*P2A060E14**12
CSPH**2412AL*	0.95	0.99	1.09	1.10	59*P2A060E14**12
CSPH**3012AL*	0.94	0.98	1.12	1.10	59*P2A060E14**12
CNPV*2417AL*	0.96	1.04	1.11	1.13	59*P2A060E17**14
CSPH**2412AL*	0.95	0.99	1.13	1.15	59*P2A060E17**14
CNPV*2417AL*	0.96	1.04	1.10	1.10	59*P2A060E17**16
CSPH**2412AL*	0.94	0.98	1.12	1.12	59*P2A060E14**10
CAP**2414AL*	0.93	1.06	1.07	1.17	59*P5A040E14**10
CAP**2417AL*	0.94	1.07	1.07	1.17	59*P5A040E14**10
CAP**3014AL*	0.95	1.08	1.07	1.16	59*P5A040E14**10
CAP**3017AL*	0.95	1.08	1.07	1.15	59*P5A040E14**10
CNPV*2414AL*	0.93	1.11	1.07	1.17	59*P5A040E14**10
CNPV*2417AL*	0.93	1.11	1.07	1.17	59*P5A040E14**10
CNPV*3014AL*	0.95	1.08	1.07	1.16	59*P5A040E14**10
CNPV*3017AL*	0.95	1.08	1.07	1.15	59*P5A040E14**10
CNPV*3117AL*	0.98	1.11	1.08	1.13	59*P5A040E14**10
CSPH**2412AL*	0.95	1.08	1.07	1.17	59*P5A040E14**10
CSPH**3012AL*	0.95	1.08	1.08	1.15	59*P5A040E14**10
CAP**2417AL*	0.93	1.01	1.07	1.14	59*P5A040E17**12
CAP**3017AL*	0.93	1.01	1.07	1.13	59*P5A040E17**12
CNPV*2417AL*	0.94	1.12	1.08	1.15	59*P5A040E17**12
CNPV*3017AL*	0.93	1.06	1.07	1.13	59*P5A040E17**12
CNPV*3117AL*	0.96	1.04	1.09	1.12	59*P5A040E17**12
CNPV*4217AL*	0.92	1.04	1.07	1.14	59*P5A040E17**12
CNPV*3017AL*	0.93	1.01	1.07	1.13	59*P5A040E17**12
CNPV*3117AL*	0.96	1.04	1.09	1.12	59*P5A040E17**12
CSPH**2412AL*	0.93	1.01	1.10	1.23	59*P5A040E17**12
CSPH**3012AL*	0.93	1.01	1.08	1.13	59*P5A040E17**12
CNPV*2417AL*	0.96	1.09	1.10	1.17	59*P5A060E17**14
CSPH**2412AL*	0.97	1.05	1.10	1.16	59*P5A060E17**14

See notes on page 34

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE

EDB ° F (° C)	EVAP. AIR ° F (° C)	105 (40.5)				85 (35)				75 (23.9)				65 (18.3)			
		Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	Capacity MBtuh		Total Sys. KW	
		Total	Sensit	ID SCFM	Total	Sensit	ID SCFM	Total	Sensit	ID SCFM	Total	Sensit	ID SCFM	Total	Sensit	ID SCFM	
75 (23.9)	72 (22.2)	35.03	14.21	3.80	36.79	14.91	3.28	38.97	15.79	2.81	41.14	16.67	2.38	43.43	17.61	1.97	
	67 (19.4)	32.03	18.10	3.76	33.69	18.87	3.26	35.70	19.98	2.81	37.69	21.10	2.39	39.83	22.39	2.00	
	63 (17.2)	29.78	21.12	3.72	31.34	21.94	3.23	33.23	23.22	2.80	35.10	24.53	2.40	37.11	26.09	2.02	
	57 (13.9)	26.68	25.51	3.66	28.08	26.39	3.19	29.78	27.92	2.78	31.49	29.50	2.40	33.35	31.47	2.04	
	72 (22.2)	34.90	17.98	3.79	36.65	18.72	3.28	38.82	19.81	2.81	40.98	20.92	2.37	43.26	22.19	1.97	
80 (26.7)	67 (19.4)	31.95	21.83	3.75	33.80	22.64	3.25	35.61	23.95	2.81	37.60	25.30	2.39	39.72	26.91	2.00	
	63 (17.2)	29.73	24.84	3.72	31.29	25.70	3.23	33.16	27.18	2.80	35.04	28.72	2.39	37.04	30.61	2.02	
	57 (13.9)	27.71	27.71	3.68	28.95	28.95	3.20	30.66	30.66	2.78	32.41	32.41	2.40	34.42	34.42	2.04	
	72 (22.2)	21.74	8.83	1.80	22.72	9.22	1.63	24.20	9.82	1.47	25.61	10.39	1.30	27.10	11.00	1.09	
	67 (19.4)	19.76	11.28	1.80	20.72	11.74	1.64	22.09	12.54	1.49	23.39	13.27	1.33	24.77	14.10	1.14	
75 (23.9)	63 (17.2)	18.28	13.20	1.80	19.22	13.70	1.63	20.51	14.65	1.50	21.73	15.51	1.35	23.02	16.51	1.18	
	57 (13.9)	16.37	16.02	1.79	17.25	16.59	1.63	18.42	17.76	1.51	19.53	18.80	1.37	20.72	20.04	1.21	
	72 (22.2)	21.65	11.25	1.80	22.62	11.67	1.63	24.08	12.45	1.47	25.49	13.17	1.29	26.96	13.99	1.09	
	67 (19.4)	19.70	13.69	1.80	20.66	14.18	1.63	22.03	15.15	1.49	23.32	16.03	1.33	24.69	17.07	1.14	
	63 (17.2)	18.26	15.60	1.80	19.20	16.13	1.63	20.48	17.26	1.50	21.70	18.27	1.35	22.99	19.47	1.17	
80 (26.7)	57 (13.9)	17.18	17.18	1.80	17.96	17.96	1.63	19.20	19.20	1.50	20.34	20.34	1.36	21.61	21.61	1.20	
	72 (22.2)	14.50	5.90	0.99	9.48	3.84	0.49	10.07	4.08	0.49	10.66	4.32	0.45	11.47	4.65	0.35	
	67 (19.4)	13.17	7.58	1.00	8.59	4.79	0.50	9.13	5.04	0.52	9.66	5.30	0.49	10.39	5.71	0.41	
	63 (17.2)	12.18	8.91	1.00	7.92	5.53	0.51	8.42	5.80	0.53	8.92	6.07	0.51	9.60	6.55	0.45	
	57 (13.9)	10.89	10.84	1.01	7.02	6.61	0.52	7.46	6.90	0.55	7.91	7.19	0.54	8.52	7.77	0.49	
80 (26.7)	72 (22.2)	14.44	7.57	0.99	9.44	4.79	0.49	10.03	5.04	0.49	10.62	5.30	0.45	11.43	5.71	0.35	
	67 (19.4)	13.13	9.25	1.00	8.56	5.73	0.50	9.10	6.01	0.52	9.64	6.28	0.49	10.36	6.78	0.41	
	63 (17.2)	12.16	10.56	1.00	7.91	6.47	0.51	8.41	6.76	0.53	8.91	7.05	0.51	9.58	7.61	0.45	
	57 (13.9)	11.52	11.52	1.01	7.26	7.26	0.52	7.64	7.64	0.54	8.03	8.03	0.54	8.66	8.66	0.48	
	72 (22.2)	14.50	5.90	0.99	9.35	3.79	0.49	9.88	4.01	0.50	10.62	4.30	0.45	11.47	4.65	0.35	
75 (23.9)	67 (19.4)	13.17	7.58	1.00	8.46	4.68	0.50	8.94	4.90	0.52	9.62	5.27	0.49	10.39	5.71	0.41	
	63 (17.2)	12.18	8.91	1.00	7.80	5.37	0.51	8.25	5.59	0.53	8.88	6.02	0.51	9.60	6.55	0.45	
	57 (13.9)	10.89	10.84	1.01	6.91	6.39	0.52	7.30	6.60	0.55	7.87	7.12	0.54	8.52	7.77	0.49	
	72 (22.2)	14.44	7.57	0.99	9.31	4.68	0.49	9.84	4.90	0.50	10.58	5.27	0.45	11.43	5.71	0.35	
	67 (19.4)	13.13	9.25	1.00	8.44	5.57	0.50	8.92	5.79	0.52	9.60	6.23	0.49	10.36	6.78	0.41	
80 (26.7)	63 (17.2)	12.16	10.56	1.00	7.79	6.26	0.51	8.23	6.48	0.53	8.87	6.98	0.51	9.58	7.61	0.45	
	57 (13.9)	11.52	11.52	1.01	7.08	7.08	0.52	7.39	7.39	0.55	7.97	7.97	0.54	8.66	8.66	0.48	
	72 (22.2)	14.50	5.90	0.99	9.35	3.79	0.49	9.88	4.01	0.50	10.62	4.30	0.45	11.47	4.65	0.35	
	67 (19.4)	13.17	7.58	1.00	8.46	4.68	0.50	8.94	4.90	0.52	9.62	5.27	0.49	10.39	5.71	0.41	
	63 (17.2)	12.18	8.91	1.00	7.80	5.37	0.51	8.25	5.59	0.53	8.88	6.02	0.51	9.60	6.55	0.45	

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage

Stage 1 — Compressor speed limited to stage two at 105 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE

EDB °F (°C)	EVAP. AIR EWB °F (°C)	24VNA98 / FE4BNB06 Comfort + Dehumidify Mode Condenser Entering Air Temperature °F (°C)														
		105 (40.5)			95 (35)			85 (29.4)			75 (23.9)			65 (18.3)		
		ID SCFM	Capacity MBtuh Total	Total Sys. KW	ID SCFM	Capacity MBtuh Total	Total Sys. KW	ID SCFM	Capacity MBtuh Total	Total Sys. KW	ID SCFM	Capacity MBtuh Total	Total Sys. KW	ID SCFM	Capacity MBtuh Total	Total Sys. KW
STAGE 5																
75 (23.9)	72 (22.2)	46.42	18.85	4.71	49.80	20.23	4.17	53.09	21.57	3.65	56.46	22.96	3.19	58.44	23.68	2.67
	67 (19.4)	42.40	24.08	4.63	45.50	25.89	4.11	48.51	27.62	3.61	51.61	29.50	3.17	53.38	29.85	2.67
	63 (17.2)	39.38	28.15	4.57	42.27	30.30	4.06	45.08	32.33	3.58	47.99	34.60	3.15	49.62	34.64	2.66
	57 (13.9)	35.31	34.09	4.47	37.94	36.72	3.98	40.49	39.19	3.53	43.14	41.99	3.12	44.52	41.65	2.64
	72 (22.2)	46.28	23.95	4.71	49.62	25.75	4.16	52.90	27.46	3.65	56.25	29.32	3.19	58.25	29.68	2.67
80 (26.7)	67 (19.4)	42.29	29.13	4.63	45.38	31.35	4.10	48.38	33.45	3.61	51.47	35.79	3.17	53.26	35.77	2.67
	63 (17.2)	39.31	33.18	4.57	42.20	35.74	4.06	45.01	38.14	3.58	47.91	40.87	3.15	49.54	40.54	2.66
	57 (13.9)	36.80	36.80	4.51	39.58	39.58	4.01	42.24	42.24	3.55	45.10	45.10	3.13	45.76	45.76	2.65
	72 (22.2)	29.62	12.03	2.44	31.87	12.96	2.16	34.08	13.86	1.91	36.31	14.77	1.66	38.96	15.92	1.43
	67 (19.4)	26.97	15.41	2.44	29.06	16.68	2.16	31.09	17.85	1.92	33.14	19.06	1.68	35.59	20.85	1.46
75 (23.9)	63 (17.2)	24.98	18.04	2.43	26.95	19.58	2.15	28.84	20.96	1.92	30.75	22.40	1.70	33.06	24.69	1.49
	57 (13.9)	22.33	21.88	2.41	24.13	23.80	2.14	25.84	25.48	1.92	27.58	27.24	1.71	29.92	29.92	1.51
	72 (22.2)	29.51	15.35	2.44	31.74	16.60	2.15	33.93	17.76	1.91	36.15	18.96	1.66	38.77	20.72	1.43
	67 (19.4)	26.80	18.70	2.44	28.98	20.29	2.15	31.00	21.72	1.92	33.04	23.21	1.68	35.47	25.60	1.46
	63 (17.2)	34.45	25.97	4.20	28.90	23.17	2.15	28.79	24.81	1.92	30.70	26.53	1.70	33.02	29.42	1.49
80 (26.7)	57 (13.9)	30.79	29.76	4.10	33.37	32.41	3.78	35.77	34.73	3.46	38.24	37.17	3.15	41.59	41.26	2.86
	72 (22.2)	25.60	10.40	1.99	18.27	7.44	0.93	19.44	7.91	0.83	20.67	8.39	0.71	22.04	8.96	0.56
	67 (19.4)	23.27	13.31	1.99	16.64	9.65	0.95	17.72	10.17	0.86	18.84	10.76	0.75	20.11	11.51	0.61
	63 (17.2)	21.53	15.58	1.99	15.45	11.39	0.97	16.45	11.96	0.88	17.49	12.62	0.77	18.68	13.53	0.65
	57 (13.9)	19.26	18.92	1.98	13.90	13.90	0.98	14.76	14.58	0.90	15.69	15.35	0.81	16.77	16.48	0.70
75 (23.9)	72 (22.2)	25.60	10.40	1.99	18.26	7.44	0.93	19.44	7.91	0.83	20.67	8.39	0.71	22.04	8.96	0.56
	67 (19.4)	23.27	13.31	1.99	16.64	9.65	0.95	17.72	10.17	0.86	18.84	10.76	0.75	20.11	11.51	0.61
	63 (17.2)	21.53	15.58	1.99	15.45	11.39	0.97	16.45	11.96	0.88	17.49	12.62	0.77	18.68	13.53	0.65
	57 (13.9)	19.26	18.92	1.98	13.90	13.90	0.98	14.76	14.58	0.90	15.69	15.35	0.81	16.77	16.48	0.70
	72 (22.2)	25.60	10.40	1.99	18.26	7.44	0.93	19.44	7.91	0.83	20.67	8.39	0.71	22.04	8.96	0.56
80 (26.7)	67 (19.4)	23.27	13.31	1.99	16.64	9.65	0.95	17.72	10.17	0.86	18.84	10.76	0.75	20.11	11.51	0.61
	63 (17.2)	21.53	15.58	1.99	15.45	11.39	0.97	16.45	11.96	0.88	17.49	12.62	0.77	18.68	13.53	0.65
	57 (13.9)	19.26	18.92	1.98	13.90	13.90	0.98	14.76	14.58	0.90	15.69	15.35	0.81	16.77	16.48	0.70
	72 (22.2)	25.60	10.40	1.99	18.26	7.44	0.93	19.44	7.91	0.83	20.67	8.39	0.71	22.04	8.96	0.56
	67 (19.4)	23.27	13.31	1.99	16.64	9.65	0.95	17.72	10.17	0.86	18.84	10.76	0.75	20.11	11.51	0.61
75 (23.9)	63 (17.2)	21.53	15.58	1.99	15.45	11.39	0.97	16.45	11.96	0.88	17.49	12.62	0.77	18.68	13.53	0.65
	57 (13.9)	19.26	18.92	1.98	13.90	13.90	0.98	14.76	14.58	0.90	15.69	15.35	0.81	16.77	16.48	0.70
	72 (22.2)	25.60	10.40	1.99	18.26	7.44	0.93	19.44	7.91	0.83	20.67	8.39	0.71	22.04	8.96	0.56
	67 (19.4)	23.27	13.31	1.99	16.64	9.65	0.95	17.72	10.17	0.86	18.84	10.76	0.75	20.11	11.51	0.61
	63 (17.2)	21.53	15.58	1.99	15.45	11.39	0.97	16.45	11.96	0.88	17.49	12.62	0.77	18.68	13.53	0.65
80 (26.7)	57 (13.9)	19.26	18.92	1.98	13.90	13.90	0.98	14.76	14.58	0.90	15.69	15.35	0.81	16.77	16.48	0.70
	72 (22.2)	25.60	10.40	1.99	18.26	7.44	0.93	19.44	7.91	0.83	20.67	8.39	0.71	22.04	8.96	0.56
	67 (19.4)	23.27	13.31	1.99	16.64	9.65	0.95	17.72	10.17	0.86	18.84	10.76	0.75	20.11	11.51	0.61
	63 (17.2)	21.53	15.58	1.99	15.45	11.39	0.97	16.45	11.96	0.88	17.49	12.62	0.77	18.68	13.53	0.65
	57 (13.9)	19.26	18.92	1.98	13.90	13.90	0.98	14.76	14.58	0.90	15.69	15.35	0.81	16.77	16.48	0.70

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage
Stage 5 – Compressor speed limited to stage four at 65 outdoor. **Stage 1** – Compressor speed limited to stage two at 105 outdoor.

See additional notes on page 34

DETAILED COOLING CAPACITIES# - COMFORT + DEHUMIDIFY MODE

24VVA360 / FE4ENB0661 Comfort + Dehumidify Mode
Condenser Entering Air Temperature F (°C)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	105 (40.5)			95 (35)			85 (29.4)			75 (23.9)			65 (18.3)		
		Capacity MBtuh Total	Sensit	Total Sys. KW	Capacity MBtuh Total	Sensit	Total Sys. KW	Capacity MBtuh Total	Sensit	Total Sys. KW	Capacity MBtuh Total	Sensit	Total Sys. KW	Capacity MBtuh Total	Sensit	Total Sys. KW
75 (23.9)	⁷² (22.2)	57.74	23.45	6.51	61.60	25.02	5.73	65.43	26.57	5.06	69.11	28.06	4.43	71.73	29.06	3.80
	⁶⁷ (19.4)	52.75	29.96	6.32	56.26	31.94	5.56	59.74	33.92	4.89	63.08	35.74	4.28	65.39	36.48	3.66
	⁶³ (17.2)	49.06	35.05	6.19	52.31	37.35	5.43	55.53	39.67	4.77	58.62	41.74	4.17	60.75	42.26	3.56
	⁵⁷ (13.9)	44.14	42.48	6.02	47.05	45.25	5.27	49.93	48.04	4.62	52.69	50.49	4.02	54.52	50.74	3.43
80 (26.7)	⁷² (22.2)	57.61	29.82	6.52	61.47	31.80	5.74	65.28	33.78	5.06	68.97	35.61	4.43	71.59	36.37	3.80
	⁶⁷ (19.4)	52.65	36.25	6.32	56.15	38.64	5.56	59.62	41.04	4.89	62.96	43.19	4.28	65.29	43.67	3.66
	⁶³ (17.2)	48.99	41.31	6.19	52.23	44.02	5.43	55.45	46.75	4.77	58.54	49.15	4.17	60.67	49.42	3.56
	⁵⁷ (13.9)	45.90	45.90	6.08	48.92	48.92	5.33	51.93	51.93	4.67	54.72	54.72	4.07	55.91	55.91	3.46
75 (23.9)	⁷² (22.2)	36.98	15.01	3.25	39.25	15.94	2.79	41.77	16.95	2.44	44.28	17.97	2.13	47.05	19.11	1.87
	⁶⁷ (19.4)	33.40	19.03	3.22	35.55	20.23	2.75	37.83	21.50	2.39	40.10	22.76	2.09	42.62	24.30	1.84
	⁶³ (17.2)	30.77	22.16	3.21	32.82	23.59	2.72	34.94	25.04	2.37	37.04	26.50	2.06	39.38	28.36	1.81
	⁵⁷ (13.9)	27.31	26.75	3.18	29.19	28.48	2.69	31.09	30.22	2.34	32.99	31.96	2.04	35.10	34.26	1.79
80 (26.7)	⁷² (22.2)	36.89	19.10	3.25	39.15	20.27	2.79	41.66	21.53	2.44	44.17	22.80	2.13	46.93	24.34	1.87
	⁶⁷ (19.4)	33.32	23.06	3.22	35.47	24.51	2.75	37.74	26.01	2.39	40.02	27.53	2.09	42.53	29.47	1.84
	⁶³ (17.2)	30.72	26.18	3.21	32.77	27.85	2.72	34.89	29.54	2.37	36.99	31.25	2.06	39.33	33.50	1.81
	⁵⁷ (13.9)	28.74	28.74	3.19	30.65	30.65	2.70	32.58	32.58	2.35	34.53	34.53	2.05	36.85	36.85	1.80
75 (23.9)	⁷² (22.2)	27.11	11.00	2.21	19.91	8.07	1.22	20.99	8.50	1.01	22.49	9.11	0.80	24.02	9.73	0.59
	⁶⁷ (19.4)	24.28	13.80	2.21	17.69	10.04	1.21	18.67	10.45	1.01	20.04	11.19	0.81	21.43	11.97	0.61
	⁶³ (17.2)	22.21	15.99	2.20	16.05	11.57	1.21	16.97	11.96	1.01	18.23	12.81	0.82	19.53	13.71	0.62
	⁵⁷ (13.9)	19.51	19.20	2.20	13.98	13.85	1.20	14.76	14.19	1.02	15.88	15.20	0.84	17.03	16.27	0.65
80 (26.7)	⁷² (22.2)	27.04	13.93	2.21	19.86	10.20	1.22	20.94	10.61	1.01	22.43	11.35	0.80	23.96	12.13	0.59
	⁶⁷ (19.4)	24.22	16.71	2.21	17.65	12.16	1.21	18.63	12.54	1.01	19.99	13.42	0.81	21.39	14.35	0.61
	⁶³ (17.2)	22.18	18.88	2.20	16.04	13.68	1.21	16.95	14.04	1.01	18.21	15.03	0.82	19.50	16.08	0.62
	⁵⁷ (13.9)	20.65	20.65	2.20	14.90	14.90	1.20	15.50	15.50	1.02	16.63	16.63	0.83	17.82	17.82	0.64

Operation in this area is restricted to maintain reliable system operation and customer comfort. The system will default to the next available stage
Stage 5 – Compressor speed limited to stage four at 65 outdoor. **Stage 1** – Compressor speed limited to stage two at 105 outdoor.

See additional notes on page 34

GUIDE SPECIFICATIONS

GENERAL

System Description

Outdoor-mounted, air-cooled, split-system air conditioning unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, forward-swept blade propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

Quality Assurance

- Unit will be rated in accordance with the latest edition of AHRI Standard 240.
- Unit will be certified for capacity and efficiency, and listed in the latest AHRI directory.
- Unit construction will comply with latest edition of ASHRAE and with NEC.
- Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have C-UL approval.
- Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.
- Air-cooled condenser coils are pressure tested and the outdoor units are leak tested.
- Unit constructed in ISO9001 approved facility.

Delivery, Storage, and Handling

- Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

Warranty (for inclusion by specifying engineer)

- U.S. and Canada only.

PRODUCTS

Equipment

- Factory-assembled, single-piece, air-cooled air conditioning unit. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge Puron® (R-410A) refrigerant, and special features required prior to field start-up.

Unit Cabinet

- Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

Fans

- Condenser fan will be direct-drive propeller type, forward swept blade, discharging air upward.

AIR-COOLED, SPLIT-SYSTEM AIR CONDITIONER

24VNA9

- Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated.
- Shafts will be corrosion resistant.
- Fan blades will be statically and dynamically balanced.
- Condenser fan openings will be equipped with coated steel wire safety guards.

Compressor

- Compressor will be hermetically sealed.
- Compressor will be mounted on rubber vibration isolators.
- Compressor will be covered with a sound absorbing blanket.

Condenser Coil

- Condenser coil will be air cooled.
- Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

Refrigeration Components

- Refrigeration circuit components will include liquid-line front-seating shutoff valve with sweat connections, vapor-line front-seating shutoff valve with sweat connections, system charge of Puron® (R-410A) refrigerant, POE compressor oil, accumulator, charge compensator, electronic expansion valve, and reversing valve.
- Unit will be equipped with high-pressure switch, suction pressure transducer, and filter drier for Puron® refrigerant.

Operating Characteristics

- The capacity of the unit will meet or exceed _____ Btuh at a suction temperature of _____ °F (°C). The power consumption at full load will not exceed _____ kW.
- Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of _____ Btuh or greater at conditions of _____ CFM entering air temperature at the evaporator at _____ °F (°C) wet bulb and _____ °F (°C) dry bulb, and air entering the unit at _____ °F (°C).
- The system will have a SEER of _____ Btuh/watt or greater at DOE conditions.

Electrical Requirements

- Nominal unit electrical characteristics will be _____ v, single phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of _____ v to _____ v.
- Unit electrical power will be single point connection.
- Control circuit will be 24v.
- Compliant with IEC 61000-4-5 Transient Surge Requirement.

Special Features

- Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.
- Infinity control with appropriate software version is required for full featured operation.

SYSTEM DESIGN SUMMARY

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. This product is not qualified for low ambient cooling operation.
Minimum cooling outdoor operating temperatures:
 - Communicating systems: 40°F (4.44°C)
 - Non-communicating systems: 55°F (12.8°C)
3. For reliable operation, unit should be level in all horizontal planes.
4. This unit is qualified for up to 100 ft (30.5 m) equivalent length of line set without additional accessories.
5. If any refrigerant tubing is buried, provide a 6 in. (152.4 mm) vertical rise to the valve connections at the unit. Refrigerant tubing lengths up to 36 in. (914.4 mm) may be buried without further consideration. Do not bury refrigerant lines longer than 36 in. (914.4 mm).
6. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.
7. Do not apply capillary tube indoor coils to these units.
8. Puron refrigerant TXV required on indoor coil.