

control boiler through BMS system


Advanced Heating and Hot Water Systems

Elite FT Heating Boiler Submittal Sheet

P.O. Box 429 · 120 Braley Road · East Freetown, MA 02717 · 508-763-8071 · Fax: 508-763-3769

Elite FT Heating Boiler

| JOB NAME: | |
|--|---|
| LOCATION: | |
| ARCH. / ENGR.: | |
| WHOLESALER: | |
| MECH. CONTRACTOR: | |
| MODEL NUMBER: | |
| TYPE OF GAS: | |
| BTU/HR INPUT LOW - HIGH FIRE: | |
| NOTES: | |
| All Stainless Steel ASME "H" Stamped Construction National Board listed Low pressure drop, gasketless, vertical tube combustion heat exchanger design – provides maintenance-free operation on internal buildup of material inside the combustion chamber 30 PSI Relief Valve, EFT-55 – 199 80 PSI Relief Valve, EFT-285 and 399 models Combustion System Modulating burner with up to 5 to 1 turndown | Additional Features Superior condensate collection system with overflow protection switch Vents in Plastic PVC - CPVC - Stainless Steel – ULC S63 flexible polypropylene vent liner (chimney lining only) Vents up to 200 combined equivalent feet 12 Year Limited Warranty Manual reset high temperature limit Dry contact for alarm output Included wall mount bracket |
| Modulating burner with up to 5 to 1 turndown Up to 96.3% AFUE | Optional |
| High Grade Burner Design | |
| Spark Ignition Models Available for Natural or LP Gas | ☐ System / Pipe Sensor (Part # 7250P-324) |
| Dual Flame monitoring (Spark and Flame probe) | ☐ Indirect Water Heater Sensor (7250P-325) |
| Integrated Control System | 3" Polypro Flex Vent Kit (8400P-001) |
| Digital operating control with 2 line / 20 character LCD text display to program and monitor boiler operation | 3" (80mm) PP Concentric Vent Kit (KGAVT0601CVT) |
| Three boiler set point temperature inputs – Boiler Pump – System Pump – DHW Pump / Domestic Hot Water priority with timing | ☐ 3" Stainless Steel Termination Vent Kit (V1000) |
| Programmable settings: Outdoor Reset Curve – DHW Supply Set Point – Step Sequence for delayed response for | ☐ 4" Stainless Steel Termination Vent Kit (V2000) |
| smart zones – Boost Response - Cascade up to 8 boilers | ☐ Flow Switch (7450P-213) |
| Field Connection Board – Line voltage terminal strip with 120 VAC / 60 Hertz power / low voltage terminal strip with multiple contacts - Cascade wiring CAT 5 / CAT 3 | ☐ Condensate Neutralizer (7450P-212) |
| • 24 Volt monitoring | III 252 Compliant Law Water Cut Off Interface Vit |
| 0-10 VDC input for Building Management System Boiler output regulation (Adjustment of boiler output down | U.L. 353 Compliant Low Water Cut-Off Interface Kit w/ Manual Reset (7600P-104 for EFT55 – 110, 7600P-990 for EFT 155 – 399) |
| to 50 percent of rated capacity) Low water protection device Password Security - Flashing maintenance indicator with | ☐ Alarm System (7350P-602) to monitor any failure |
| optional programmed installer contact information Time Clock / Data logging – Last 10 fault codes with date | ☐ PC Connection Cable w / Software (7350P-320) |
| and timeCustomized freeze protection parameters | ☐ Vision II (7250P-319) |
| Modbus enable through external adapter to monitor or control boiler through PMS greaters. | Modbus (7350P-629) |

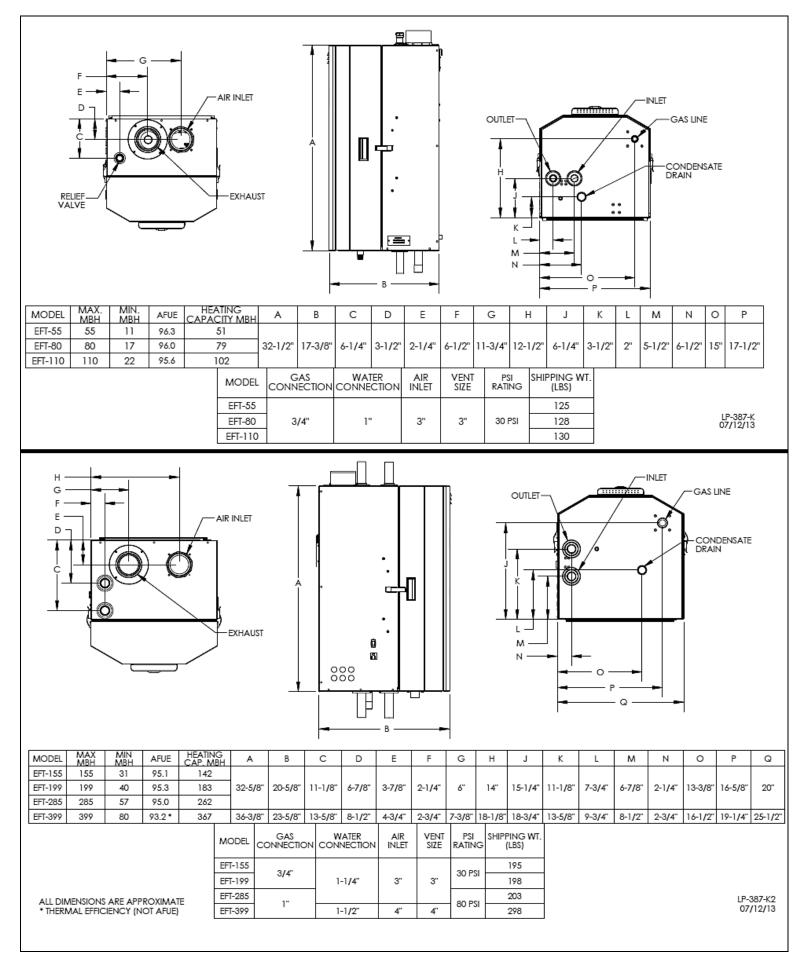

NOTE: HTP reserves the right to make product changes or updates without notice and will not be held liable for typographical errors in literature.